

**MARION COUNTY**

**DEPARTMENT OF PUBLIC WORKS**

**ENGINEERING STANDARDS**

**The Marion County Board of Commissioners  
Adopted These Standards on**

**April 11, 1990**

**These standards prepared by and under  
the auspices of the staff of the  
Public Works Department**

**Mary Grim, Secretary 3  
Jim Jirek, Graphics Technician  
Greg Kurtz, Acting Engineering Manager  
Deanna Peck, Office Specialist 2  
Cindy Schmitt, Civil Engineer I  
Harold Todd, Engineer Technician III**

**Willis G. Worcester, P.E.  
Senior Civil Engineer**

**Robert J. Hansen, P.E.  
Director of Public Works**

**Board of Commissioners**

**Randall Franke  
Garry Kunz  
Garry Heer**

# Table of Contents

Section	Description	Page
	Title Page	1
	Table Of Contents	2
I	Introduction	6
II	Definitions	7
III	Construction Plans	9
	A. General	9
	B. Preparation	9
	C. Submittal	10
	D. Preconstruction Conference	11
	E. As-Built Submittal	11
IV	Roadway Design Standards	12
	A. General	12
	B. Minimum Street Grades	12
	C. Curb and Pavement Radii	12
	D. Side Slopes on Roadway Section	13
	E. Horizontal Curves	13
	F. Sight Distance	13
	G. Structural Standards	15
	H. Driveway Access	15
	I. Privately Maintained Roads Within Public Right-Of-Ways	17
	J. Stop Sign Warrants	18
	K. Street Lights	21
	L. Guide Signs	21
	M. Roadway Delineation	28
	N. Bridges	32
V	Drainage Standards	33
	A. Design	33
	B. Plans	38
VI	Use Of The County Right-Of-Way By Others	40
VII	Check Lists For Subdivision Review	41
	Preliminary Plat	42
	Engineering Plan	44
	Final Plat (Hard Copy)	48
	Tables	
	Standard Drawings	

# Table Index

<b>Table</b>	<b>Title of Table</b>	<b>Page</b>
1	Urban Geometric Design Standards	12
2	Rural Geometric Design Standards	13
3	Cul-de-sac Standards	14
4	Sight Distance and Vertical Curve Standards	15
5	Pavement and Aggregate Structural Thickness	15
6	Driveway Dimensions	17
7	Delineator Warrants	30
8	Delineator Spacing on Horizontal Curves	31
9	Design Storm Frequency	33
10	Runoff Coefficients	33

# Standard Drawing Index

Sheet	Standard Drawing Name	Date
1	Typical Cross Sections For Urban Streets	10/26/93
2	Standard Utility Location For Urban Streets	10/26/93
3	Typical 22' Turnpike Section and Utility Location For Rural, Local and Collector Roads	10/26/93
4	Typical 28' Turnpike Section For Rural Arterial Roads	10/27/93
5	Typical Gravel Section For Privately Maintained Rural Roads	10/27/93
6A	Typical Cross Section For Paving Gravel Roads	10/26/93
6B	Typical Asphalt Penetration Macadam (0-11) Surfacing Details	10/27/93
7	Pavement Patching	10/28/93
8	Rumble Strips	10/28/93
9	Standard For Permanent Barricade	10/28/93
10	Authorized Hydrant Marker Installation Locations	11/19/93
11A	Accessible Route Driveways Detail	10/1/99
11B	Standard Curbed Section Driveway	10/1/99
11C	Standard Ramp Details	10/1/99
11D	Wheelchair Ramp Layout and Texturing	8/3/99
11E	Miscellaneous Sidewalk Details	10/1/99
11F	Standard Curbed Section Driveway	8/3/99
11G	Matching Existing Driveway Slopes	8/3/99
11H	Curb Removal and Drain Lines	8/4/99
11I	Sidewalk/Ramp Finishing and Expansion Joint Details	10/1/99
11J	Driveway Access To Non-Curbed (Turnpike) Street	5/4/99
12	90 deg Arterial Intersections and Major Commercial – Industrial Driveways	11/22/93
13	Arterial Intersections and Major Commercial – Industrial Driveways – Various Angles	11/23/93
14	Standard P.C.C. Curb and Gutter Sections	11/23/93
15	Standard Sidewalk Details	11/26/93

## Standard Drawing Index (continued)

Sheet	Standard Drawing Name	Date
16	Typical Bicycle and Wheelchair Ramps	11/23/93
17	Standard Catch Basin Details - Type 1 Catch Basin and Cleanout	11/26/93
18	Standard Catch Basin Details – Type 2 (Side Inlet) Catch Basin	6/22/94
19	Type 3 Catch Basin, Frame and Grate	6/23/94
20	Catch Basin Grates and Frames Types A and B	6/24/94
21A	Storm Drain - Standard Precast Manhole	6/25/94
21B	Storm Drain – Shallow Precast Manhole (H less than 4' – 0")	6/27/94
22	Storm Drain Manhole For Pipe 24" and Over	6/28/94
23	Standard Manhole Casting Details	6/30/94
24	Lateral Connection To Storm Drain Pipe	7/5/94
25	Pipe Bedding and Trench Backfill	7/5/94
26	Storm Sewer Design Sheet	7/6/94
27	Rainfall Intensity – Duration Curves	1/18/83
28	Peak Discharge Computation Sheet	7/6/94
29	Determination Of Required Detention Storage	6/7/94
30	Storm Water Detention - For Sites Of 5 Acres or Less (1 of 2)	7/6/94
30	Storm Water Detention – For Sites Of 5 Acres or Less (2 of 2)	10/10/85
31	Drafting Conventions	

# I. INTRODUCTION

These are the Public Works Engineering Standards of Marion County. They establish the general criteria and detailed standards used for work both within public right-of-ways and dedicated easements of the county. They shall govern:

- A. The design of roads, streets, and appurtenances in unincorporated areas within county right-of-ways and roadways in incorporated cities under county jurisdiction.
- B. The design of drainage facilities, including those associated with public right-of-ways, roads, paved driveways, and parking and loading areas on private property.
- C. The use of public right-of-ways and drainage easements for other purposes and facilities to insure that such other uses do not adversely affect the integrity, use and maintenance of the roadway and drainage facilities.
- D. Where improvements to public roadways and drainage facilities are required under the authority of the Marion County Zoning Ordinance and the Marion County Subdivision and Partitioning Ordinance, such improvements shall conform to these standards.

Interpretation and enforcement of these standards shall be the responsibility of the Marion County Department of Public Works.

These standards shall apply to new and reconstructed facilities. Funds will not be available in the foreseeable future to bring all existing facilities up to these standards.

These standards are intended as a working document to provide a common understanding for design affecting Marion County roads and public right-of-ways. As such, they will be revised and updated periodically.

## II. DEFINITIONS

ADT - Average Daily Traffic. The total number of vehicles traveling in both directions in a 24-hour period.

Arterial - A roadway intended to carry large volumes of traffic (1000 ADT or more outside of an Urban Growth Boundary [UGB]) and connect major traffic generators, cities, recreational areas, and major segments of transportation networks. High capacity is achieved through allowing higher speed, limited access, wider roadway and movement preference at intersections with lesser standard roadways.

Collector - A roadway intended to carry intermediate volumes of traffic (500-1500 ADT outside of a UGB) and collect and distribute traffic from local streets to arterials, state highways or small population centers.

County Road - A public road under the jurisdiction of the county that has been designated as a county road through an order by the Board of Commissioners pursuant to ORS 368. This designation causes the roadway to be maintained by the county.

Ditch - A man-made excavation dug in the earth used to convey drainage or irrigation water.

Drainage Facilities - The physical element used to convey, absorb or store runoff such as pipes or channels, dry wells, and detention or retention ponds.

Easement - Right to use property owned by another for specific or general purposes.

Engineer - A registered professional civil engineer licensed by the state of Oregon.

Highway - A major roadway having the connotation of being owned and maintained by the state of Oregon.

Local Road or Street - A roadway serving short distance, intra-neighborhood and residential needs. They are characterized by minimal access limitations, lowest traffic movement preference at intersections with collectors and arterials, and minimum widths. These factors lead to minimum traffic carrying capacity, but provide maximum access to adjacent property.

Local Access Road (NCR) - A public road that is not a county road, as defined herein, and is also not a state or federal highway or road. The roadway is maintained by the abutting property owners rather than by a public agency.

Mini-Subdivision - A small or irregular shaped parcel within an urban growth boundary which cannot be developed in accordance with standard subdivision regulations, usually less than 5 acres in area and served by a cul-de-sac street.

Predevelopment - A site with natural vegetation on native soil.

Private Road - A road which is on private property and which is maintained with private funds.

Public Road - A road which is within a public right-of-way. It may be maintained by either private or public funds (state, city, or county).

Public Right-of-way (R/W) - A right-of-way on which legal right of passage has been given to the public and is under county, state or federal jurisdiction.

Right-of-way - A legal right of passage over a piece of land, generally established by either an easement or ownership.

Road - A roadway having the connotation of serving rural areas.

Roadway - The general term used to describe the strip of land, structures, surfacing, and shoulders over which motorized vehicles travel. Included under this term are roads, streets and highways.

Rural - Those county areas which do not meet the definition of urban areas below.

Storm Water Runoff System - A means to control storm water through natural or man-made elements by conveyance, absorption or storage.

Street – A roadway having the connotation of serving urban or city needs

Turnpike – The most common road in the county road system characterized by graveled shoulders, open roadside drainage ditches and lack of curbs. See Standard Drawing Number 3.

Urban - Those areas within an adopted urban growth boundary (UGB) or having urban characteristics, such as lot sizes smaller than one acre.

Utilities - Any water, gas, sanitary or storm sewer, electrical, telephone, drainageway, wire, or television communication service and all persons, companies, or governmental agencies supplying the same.

### **III. CONSTRUCTION PLANS**

#### **A. GENERAL**

Complete plans for all proposed improvements within or impacting public right-of-ways and county easements shall be submitted to the Department of Public Works for approval. Such plans shall be prepared under the supervision of and stamped by a Registered Civil Engineer. Construction of any improvements shall not begin prior to plan approval and issuance of a construction permit.

#### **B. PREPARATION**

Construction plans shall be prepared in accordance with the following requirements:

1. Plans shall have a vicinity map showing surrounding streets, including existing and proposed streets.
2. Plans shall have a north arrow, generally pointing to the top or right side of the plans.
3. Elevations shall be based on the current U.S.G.S. datum.
4. Stationing shall run from left to right of plan and profile.
5. Stationing shall commence (usually 0+00) at the south or west end of project and end at the north or east end of project.
6. Plan and profile generally shall be drawn at a scale of 1 inch equals 50 feet horizontal and 1 inch equals 5 feet vertical.
7. Profiles shall show existing ground along proposed centerline and right-of-way lines.
8. Where cut or fill slopes extend outside of the right-of-way, slope easements are required. Easements shall extend one foot outside of the toe of slope and be shown on plans. Street slope arrows shall be pointed down hill.
9. At all vertical curves, plans shall show curve length, stations and elevations or PIVC's, BVC's, and EVC's.
10. On all horizontal curves and curb returns, plan shall show length of curve, radius, deflection angle and stations of P.C.'s, and P.T.'s. Curb returns shall have elevations shown at P.C.'s and P.T.'s.

11. Wheelchair/bicycle ramps are required at each curb return at all intersections. Catch basins shall be located to avoid coinciding with ramps or shall use Type "B" grate.
12. Boundaries of the involved drainage basins, with topographic features and drainage facilities, shall be shown. See Section V, B, 1 for further details.
13. Roadside ditches shall be shown on plan view.
14. Pipe diameter, material and class of pipe shall be indicated on profile.
15. Plans shall show slopes (Ft./Ft.) and inverts on all pipes and channels.
16. Plans shall show typical section of all street sections and/or channel improvements.
17. Plans shall show all existing and proposed utility locations. New utilities in public right-of-ways must comply with the locations shown on Standard Drawings Numbers 2, 3, and 4.
18. Where feasible, general notes shall be consolidated on a single page. Repetition of general notes or inclusion of standard plans requires redundant review and affords unnecessary opportunities for oversight.
19. All traffic control and street signs shall be shown on plans. Cost of signs and installation shall be the responsibility of the developer, but signs may be installed through a work order by county forces on a time available basis.

C. SUBMITTAL

Construction plans and calculations for the proposed improvements shall be submitted as follows:

1. In accordance with Marion County Ordinance No. 671, the first submittal shall be accompanied by a completed Plan Check form and the required fees.
2. The first submittal shall consist of two sets of prints of sewer, water, road and drainage plans, profiles, and detail sheets and one set of drainage area plans and drainage calculations. The Department of Public Works will review the first submittal and indicate the required revisions.
3. The engineer shall revise the plans as required and make a final submittal which shall consist of three sets of prints of sewer, water, road and drainage plans, profiles, and detail sheets. Upon the approval by the

Director of Public Works, written notice will be given to the engineer with a copy to the developer.

4. Revisions: Any design changes made after final approval shall be approved by the Department of Public Works prior to construction.
5. In accordance with Marion County Ordinance No. 671, prior to beginning construction, a Construction Permit shall be obtained from the Department of Public Works and the required fees shall be paid.

D. PRECONSTRUCTION CONFERENCE

At the discretion of the Director of Public Works, a preconstruction conference may be required. The conference shall include representatives of the following groups:

1. Developer
2. Contractor
3. Marion County Department of Public Works
4. Utilities
5. Other groups involved in the project

E. AS-BUILT SUBMITTAL

As a condition of facility acceptance, the county requires the developer's engineer to inspect construction of the project and furnish a complete set of mylar drawings upon completion. Such drawings shall be marked "As-Built" and describe any and all revisions or additions to the approved plans. On the first page of these drawings, the developer's engineer shall make the following statement and affix his stamp adjacent thereto:

"I hereby affix my seal to certify that these improvements have been inspected and constructed in conformance with these plans as approved by the Public Works Director and the general specifications adopted by the Marion County Department of Public Works."

# IV. ROADWAY DESIGN STANDARDS

The roads which are to be constructed within public right-of-ways shall be designed to conform to the following standards. Such standards for a particular road will be in accordance with the most current road classification plan as adopted by the county.

## A. GENERAL

All roads which lie within an adopted UGB of an incorporated city shall comply with Table 1, "Urban Geometric Design Standards" and Table 3, "Cul-de-sac Standards."

All roads which are outside any UGB shall comply with Table 2, "Rural Geometric Design Standards" and Table 3, "Cul-de-sac Standards," except adjacent to a UGB where the traffic volumes and use indicate the need for extending the urban type roads. Such extension will be in accordance with the county's adopted road classification plan.

## B. MINIMUM STREET GRADES

To provide adequate drainage, minimum slopes along streets and roads shall be as following:

Tangent sections and horizontal curves	
Type A monolithic curb and gutter	0.2%
Type C curb and roadside ditches	0.4%
Around cul-de-sacs and corners at intersections (Including both curbs and ditches)	0.6%

## C. CURB AND PAVEMENT RADII AT 90-DEGREE INTERSECTIONS

To allow sufficient pavement for turning at intersections, the following radii shall be provided:

<u>Type of Intersection</u>	<u>Radius</u>
Curbed local to local and local to collector	20'
Curbed collector to collector	30'
Curbed collector to arterial	35'*
Curbed arterial to arterial	50'*
Turnpike local to local, and local to collector	30'
Turnpike collector to collector	40'
Turnpike collector to arterial	

**TABLE 1**  
**URBAN GEOMETRIC DESIGN STANDARDS**

Road Classification	Traffic Volume (ADT)	Minimum Right-Of-Way Width	Minimum Pavement Width	Concrete Sidewalk <sup>4</sup>	Bike Lanes	Parking	Design Speed (mph)	Minimum Horizontal Radius <sup>1</sup>	Maximum Superelevation (ft/ft)	Maximum Grade (%) <sup>6</sup>
Basic Arterial <sup>9</sup>	10000-18000	84'	60'	Both Sides	Yes	Prohibited	35	420'	.04	5
Phased Development Arterial <sup>9</sup>	5000-10000	84'	34'	Both Sides	Yes	Prohibited	35	420'	.04	5
Minor Arterial <sup>9</sup>	6000-10000	68'	34'	Both Sides	Yes	Prohibited	35	420'	.04	6
Limited Arterial	3000-6000	68'	38' <sup>8</sup>	Both Sides	No <sup>8</sup>	Yes	30	300'	.04	6
High Volume Arterial <sup>9</sup>	15000-30000	Up to 108'	4 to 5 lanes up to 80' including median	Both Sides	Yes	Prohibited	45	730'	.04	6
Beltline <sup>9</sup>	30000-48000	Up to 132'	4 to 6 lanes up to 104' including median	Both Sides	Yes	Prohibited	55	1035'	.06	6
Basic Collector	3000-6000	68'	34'	Both Sides	Yes <sup>7</sup>	Prohibited <sup>7</sup>	35	420'	.04	6
Limited Collector	2000-3000	64'	38'	Both Sides	No	Yes	35	420'	.04	6
Industrial/ Commercial	0-4000	60'	34'	Both Sides	No	Prohibited	25	320' <sup>3</sup>	Normal Crown	6
Residential	0-2000	60'	34'	Both Sides	No	Yes	25	320' <sup>3</sup>	Normal Crown	12 <sup>2.5</sup>
Cul-de-sac = 500 (residential)		50'	34'	Both Sides	No	Yes	25	320' <sup>3</sup>	Normal Crown	12 <sup>2.5</sup>
Residential Mini-Subdivision, Cul-de-sac		30'	22'	4' One Side	No	Prohibited	25	320' <sup>3</sup>	Normal Crown	12 <sup>2.5</sup>

1. For minimum radius shown, maximum superelevation must be used. In all cases, radius is centerline radius. For greater than shown, see Section IV, E.
2. Grades of up to 15% may be approved. They should be less than 500 feet in length and located a distance of 200 feet or more from an intersection with a major street or an intersection requiring a stop.
3. Smaller radii will be allowed for 90-degree turns for looped streets and cul-de-sacs when legs are shorter than 400'.
4. 5' wide except where otherwise indicated. Along all residential streets, except cul-de-sacs, sidewalks shall be adjacent to the property lines.
5. Maximum slope from center of cul-de-sac to back of sac shall not exceed 8%.
6. At intersections, the maximum longitudinal slope of all non-through streets shall be 8% for at least 50' from the edge of the intersecting pavement.
7. In some cases, bike lanes may be eliminated and parking allowed on one side.
8. In some cases, the pavement may be wider and bike lanes provided.
9. Salem-Keizer urban area only.

Per Std. dwgs. #12 & 13  
Turnpike arterial to arterial  
Per Std. dwgs. #12 & 13

\* Subject to revisions based on truck volumes, turning volumes and geometry of intersection.

D. SIDE SLOPES ON ROADWAY SECTION

Slopes along and adjacent to the roadway shall be as specified on the standard drawings. In general, they are to be no steeper than:

Cut Slopes	1-1/2 to 1
Fill Slopes	2 to 1

Flatter slopes are preferred and may be required by the Department of Public Works if soils are unstable.

Side slopes exceeding 5 feet in height shall be stabilized by grass sod, seeding, and/or riprap.

E. HORIZONTAL CURVES

In accordance with the minimum design speeds and maximum super-elevations as shown in Tables 1 and 2, the minimum horizontal curve radii are determined by the following formula:

$$R = \frac{V^2}{15(e+f)}$$

Where:

R = minimum horizontal centerline radius (ft)

V = design speed (mph)

e = super-elevation, negative on the outside of normal crown and reverse crown (ft/ft)

f = side friction factor

For V = 20 to 30 mph, f = 0.16; for V > 30 mph, f shall be reduced 0.005 for each 5 mph increase in V.

Where a radius greater than the minimum is selected, the super-elevation shall be reduced in accordance with the method in A Policy on Geometric Design of Highway and Streets, 1984, AASHTO.

F. SIGHT DISTANCE

In the design of roads and access onto them, the designer shall provide for

**TABLE 2**

**RURAL GEOMETRIC DESIGN STANDARDS**

Road Classification	Traffic Volume (ADT)	Minimum Right-Of-Way Width	Minimum Pavement Width	Gravel Shoulders <sup>5</sup>	Parking	Terrain Cross Slope	Design Speed (mph)	Minimum Horizontal Radius <sup>1</sup>	Maximum Superelevation (ft/ft)	Maximum Grade (%) <sup>6</sup>
Arterial	1000-10000	66'	28'	2' both sides	None Provided	S < 5 5 = S = 15 S = 15	55 45 35	1035' 660' 380'	.06 .06 .06	6 8 10
Collector	500-1500	60'	22'	5' both sides	None Provided	S < 5 5 = S = 15 S = 15	55 45 35	1035' 660' 380'	.06 .06 .06	6 8 10
Local (Through Road)	0-500	60'	22' <sup>6</sup>	5' both sides	On Shoulder	S < 5 5 = S = 15 S = 15	50 40 30	925' 560' 300'	.04 .04 .04	7 9 12
Local (Subdivision of Cul-de-sac = 1320')	0-500	60'	22' <sup>6</sup>	5' both sides	On Shoulder	S < 5 5 = S = 15 S = 15	30 25 20	460' 320' 205'	Normal Crown Normal Crown Normal Crown	8 <sup>3</sup> 10 <sup>3</sup> 12 <sup>2,3</sup>
Cul-de-sac = 1320'	0-500	60' (50' if = 500' long)	22' <sup>6</sup> (20' if = 500' long)	5' both sides	On Shoulder	S < 5 5 = S = 15 S = 15	25 20 20	320' 205' 205'	Normal Crown Normal Crown Normal Crown	8 <sup>3</sup> 10 <sup>3</sup> 12 <sup>2,3</sup>

- For minimum radius shown, maximum superelevation must be used. In all cases, radius is centerline radius. For greater than shown, see Section IV, E.
- Grades of up to 15% may be approved. They shall be located a distance of 200 feet or more from an intersection with a major street or an intersection requiring a stop.
- Maximum slope from center of cul-de-sac to back of sac shall not exceed 8%.

- At intersections, the maximum longitudinal slope of all non-through streets shall be 8% for at least 50' from the edge of the intersecting pavement.
- Roads that are designed as bike routes shall have paved shoulders.
- For paving of existing gravel roads, the minimum pavement width may be 20'.

adequate sight distance to ensure public safety.

1. Vertical Curves

To provide adequate stopping sight distance, the minimum lengths of vertical curves shall be as computed from the following formula but in no case shall the lengths be less than 50 feet:

$$L = KA$$

Where:

L = length of vertical curve (ft)

K = constant for design, see Table 4

A = algebraic difference in grade (%)

When the algebraic difference in grade is less than 1 percent, a vertical curve will not be required.

2. Horizontal Curves

Horizontal curves shall have long enough curve radii to provide the minimum stopping sight distances, when measured across the inside of the curves, as specified in Table 4. Where there are sign obstructions such as cut slopes, retaining walls, structures, etc. radii longer than the minimums specified in Tables 1 and 2 may be required.

3. Intersections

Intersections shall be located so as to provide the sight distances specified in Table 4. Where conditions do not allow using the Preferred Intersection Sight Distances, the absolute minimum criteria for locating road access is the Minimum Stopping Sight Distance. Access will not be allowed where there is less than the minimum stopping sight distance available for the prevailing speed on the through roadway.

At intersections, the sight distance along the roadway shall be measured from a driver's eye, 3.50 feet above the pavement, to the top of a vehicle, 3.5 feet above the pavement. The driver's eye is at a point on the intersecting roadway which is located as follows:

<u>Type of Road</u>	<u>Location of Driver's Eye*</u>
Curbed	18' preferred and 15' minimum behind face of curb
Turnpike	18' preferred and 15' minimum behind near edge of pavement

## TABLE 3

### CUL-DE-SAC STANDARDS

Road Classification	Right-of-way Radius		Curb/Pavement Radius		Sidewalk/ Shoulder	Parking
	Turnaround	Entering Turnaround	Turnaround	Entering Turnaround		
Urban	45'	30'	38' <sup>1</sup>	35' <sup>1</sup>	5' sidewalk all around	Yes
Rural	45'	30'	32' <sup>2</sup>	30' <sup>2</sup>	3' gravel shoulder	None Provided
Mini-Subdivision (Prohibited in rural areas)	35'	20'	30' <sup>1</sup>	20' <sup>1</sup>	4' sidewalk one side	Prohibited
Industrial/Commercial	52'	30'	45' <sup>3</sup>	35' <sup>3</sup>	5' sidewalk all around	Prohibited

1. Curb required
2. Turnpike
3. Curb required in urban areas

Note: Maximum slope from center of cul-de-sac to back of sac shall not exceed 8%.

- \* In a situation where the specified location of the driver's eye is unsafe or is not adequate to provide the required stopping sight distance, the location shall be determined by the Director of Public Works.

#### 4. Effect of Grade

The minimum stopping sight distances specified in Table 4 are for level ground. Where the grade is not level, the minimum stopping sight distance shall be determined by the following formula:

$$SSD = 3.68 V + \frac{V^2}{30 (f+g)}$$

Where:

SSD = minimum stopping sight distance (ft)

V = design or driving speed (mph)

g = grade + for upgrade and - for downgrade

f = coefficient of friction for wet pavement from Table 4.

### G. STRUCTURAL STANDARDS

1. All construction work and materials shall be in accordance with the current Oregon State Highway Division (OSHD) "Standard Specifications For Highway Construction," except where otherwise specified.
2. Pavement and Aggregate Base thicknesses shall be in accordance with Table 5. At the option of the design engineer or where the Marion County Director of Public Works determines that unusual soil conditions or high volumes of truck traffic exist, pavement and aggregate thicknesses shall be determined in accordance with the current OSHD "Flexible Pavement Design Procedure."
3. Full-depth asphalt and portland cement concrete pavements are allowable. Designs must be approved by the Marion County Director of Public Works.

### H. DRIVEWAY ACCESS

Driveway access onto county roads shall be located in a safe manner and conform to following requirements:

#### 1. Permits

Prior to establishing a new driveway, reconstructing or widening an existing driveway or changing its use, a permit shall be obtained from the

## TABLE 4

### SIGHT DISTANCE AND VERTICAL CURVE STANDARDS

Design Speed	Preferred Intersection Sight Distance	Minimum Stopping Sight Distance	K Values		F Values
			Crest Curve	Sag	Friction Coefficient
20	200	125	10	20	.39
25	250	150	20	30	.37
30	300	200	30	40	.35
35	350	250	50	50	.33
40	400	325	80	70	.32
45	450	400	120	90	.31
50	500	475	160	110	.30
55	550	550	220	130	.29

1. On level grades. Where grades are not level, stopping sight distances shall be computed per Section IV, F., 4., Effect of Grade.
2. For Wet Pavement

**TABLE 5**

**PAVEMENT AND AGGREGATE STRUCTURAL THICKNESS**

Street/Road Classification	Crushed Base Equivalent	Asphalt Concrete	Aggregate Leveling Course (¾"-0) <sup>3</sup>	Aggregate Base Course (1-½"-0) <sup>3</sup>	Curb Exposure
<u>Rural</u>					
Local (Through Road and Cul-de-sac)	14"	2-½"	1-½"	7-½"	None
Collector	17-½"	2-½"	1-½"	11"	None
Arterial	23-½"	4"	1-½"	14"	None
<u>Urban</u>					
Residential Cul-de-sac less than 500'	11"	2-½"	1-½"	4-½"	6"
Residential Local	14"	2-½"	1-½"	7-½"	6"
Collector -					
Basic	18-½"	2-½"	1-½"	12"	7"
Limited	16-½"	2-½"	1-½"	10"	7"
Arterial	21-½"	2-½"	1-½"	15"	7"

1. As Defined in OSHD, "Flexible Pavement Design Procedure."
2. In Accordance with OSHD, "Standard Specifications For Highway Construction," except that asphalt content shall not be less than 6%. Mix design must be approved by Marion County Director of Public Works.
3. 1"-0 aggregate may be substituted. Thickness shall equal total thickness for Base.

Director of Public Works.

2. Surfacing

- a. All commercial and industrial driveways shall be paved to standards set by the Director of Public Works on a site specific basis so as to support the anticipated traffic.
- b. Residential driveways shall have a minimum surface of 6 inches of 1"-0 crushed rock. Where they are to be paved, the minimum surface shall be 2 inches of asphalt concrete over 6 inches of 1'-0 crushed rock.

3. Location and Number

It is the county's policy to provide access onto county roads in a manner and location that will protect the public safety. In general, the number of access points onto a roadway shall be held to the minimum necessary to provide adequate access to a particular parcel of property.

The location and number of driveways shall be as follows:

- a. No access shall be allowed where there is less than the Minimum Stopping Sight Distance as specified in Table 4. The sight distance shall be measured in the same manner as for intersections except that the driver's eye shall be located a preferred 15 feet and a minimum of 10 feet behind the face of the curb or the near edge of pavement.
- b. Driveway access shall intersect a county road at or as near a 90-degree angle as is practical. In no case shall it be less than 45 degrees.
- c. Where there are several adjacent parcels with narrow frontage or where sight distance is inadequate, a frontage road or combined driveway may be required.
- d. Within a UGB, a maximum of one double driveway or a looped driveway with a 90-degree intersection to the roadway shall be allowed per single family dwelling on a collector or arterial.
- e. Within a UGB, no more than 40 percent of the roadway frontage of a lot shall be devoted to driveways.
- f. Where property is located at the intersection of an arterial or collector and a local street, the preferred access shall be on the local street.

- g. On a corner lot, no portion of any driveway shall be allowed within the curb return or pavement flare of the intersection. On collector or arterial streets it shall be a minimum of 30 feet from the end of the curb return or, if there is no curb, from the end of the pavement flare.
- h. Along curbed streets, no portion of any driveway, including taper, flare, transition, apron, etc., shall be allowed within 3 feet of an intersecting property line unless it is an approved joint use driveway.

4. Widths

Within the limits listed in Table 6, the specific driveway widths and flares shall be determined according to anticipated traffic volumes, types of vehicles and widths of the connecting roadways.

5. Slopes

Slopes of driveways within the public right-of-way shall be no greater than 12 percent. On turnpike roads, driveways shall slope down from the edge of the county road pavement at a grade of at least 3 percent. This slope shall be continued the full distance to the ditch line or a distance of 10 feet from the edge of pavement, whichever is greater.

6. Drainage Requirements

Within public right-of-ways, where there are no curbs, there shall be culverts placed under driveways to provide for drainage as needed. The location, type and size of the culvert shall be specified by the Director of Public Works. See Section V, A, 3, a for types of pipe that may be allowed.

I. PRIVATELY MAINTAINED ROADS WITHIN PUBLIC RIGHT-OF-WAY

The maintenance of roads within public right-of-ways will remain the responsibility of the adjacent property owners until such time as the road has been paved to county standards and accepted as a county road by the Board of Commissioners.

1. Opening of an Unopened Public Right-Of-Way

An existing public right-of-way may be opened and a road constructed thereon with the written approval of the Director of Public Works. The roadway shall be constructed in accordance with the Roadway Improvement Standards listed below and Standard Drawing Number 5.

**TABLE 6**

**DRIVEWAY DIMENSIONS**

	Urban		Rural		
	Width <sup>1</sup>	Transition Width	Flare Width	Width <sup>1</sup>	Flare Radius
Residential	12'-24'	3'	None	20'-24'	10'-20'
Commercial One way, One lane	14'-16'	3'	3'	20'	10'-20'
Two way, Two lanes	28'-32'	3'	3'	20'-30'	20'-35'
Two way, Three lanes	36'-40'	3'	3'	36'-40'	20'-35'

1. Driveway width (not including transition flare): 1) Measured at right-of-way line on curbed streets; 2) Measured at ditch line, or if no ditch, at a distance of 10' from edge of pavement on turnpike roads.
2. The allowable dimensions will be determined by the Director of Public Works on a site-specific basis. Only in unusual situations will one-way driveways be allowed.
3. Curb returns will be allowed for driveways that carry at least 1000 vehicles per day or 50 trucks per day.

Private parties wishing to open a public right-of-way shall apply for a permit and submit plans for review and approval by the Department of Public Works prior to doing any work. The private parties shall bear all costs for the improvements.

2. Roadway Improvement Standards

Improvement to an existing or proposed privately maintained public roadway shall have, as a minimum, a gravel surface with adequate drainage and may be paved if desired or required by county ordinance. The minimum roadway improvements shall be as follows:

<u>Number of Dwellings Served</u>	<u>Gravel Surface Width</u>	<u>Minimum 1"-0 Crushed Rock Depth</u>
One	10'	6"
Two or More	16'	8"

3. Right-of-Way Requirements

Before a private improvement of a public right-of-way will be permitted, the right-of-way must be wide enough to contain the proposed road surface, the cut and fill slopes and the necessary drainage facilities. Dedication of additional right-of-way may be required prior to the issuance of a permit. The minimum right-of-way widths shall be as follows:

<u>Street Classification</u>	<u>Minimum Right-of-way Width</u>
New Local	60'
New Cul-de-sac =< 500'	50'
Existing unopened	20'*

\* Adequate only for a 10-foot wide road surface. For a 16-foot wide road surface to serve 2 or more dwellings, a 30-foot right-of-way is required.

J. STOP SIGN WARRANTS

The purpose of stop signs is to enhance safety, improve traffic flow, and control the right-of-way assignment at intersections.

1. Stop signs may be used on the minor leg of intersections which meet any one of the following warrants:

- a. On an approach to an arterial or collector.
- b. Above average chance of conflict as determined by the following point system. Total of (1) through (4) shall equal 18 or greater to warrant a stop sign.

(1) Volume

- (a) Major Street: One point for every 50\* vehicles per day (VPD) (maximum 10 points). \*75 for area within UGB.

Minor Street: One point for every 30 VPD over 100 VPD (maximum 5 points).

OR

- (b) Major Street: One point for every 10 vehicles per hour (VPH) (maximum 10 points).

Minor Street: One point for every 10 VPH during same peak hour (maximum 5 points).

(2) Accidents

Five points are assigned for each accident susceptible to correction by stop signs during a one-year interval.

(3) Visibility

Where the critical approach speed to the intersection is less than 20 mph, one point shall be assigned for each mph under 20 mph (maximum 10 points).

(4) Unusual Conditions

Where unusual conditions exist, such as a school, fire station, playground, steep hill, etc., points are assigned on the basis of engineering judgment (maximum 3 points).

- 2. Multi-way stop signs may be used at the intersection of two through highways or at intersections which meet any one of the following warrants:

- a. Volume [both (1) and (2) must be met]:

- (1) Total vehicular volume entering the intersection from all

approaches must average at least 500 (350)\* VPH for any 8 hours of an average day.

- (2) The combined vehicular and pedestrian volumes entering from the minor street must average at least 200 (140)\* per hour for the same 8 hours.

\* Major street approach speed greater than 40 mph.

b. Accidents:

When 5 or more reported accidents of a type susceptible to correction by a multi-way stop installation occur during a 12-month interval in the previous 5 years.

- c. Where a traffic signal is warranted and is urgently needed, the multi-way stop is an interim measure while arrangements for a signal installation are being made.

d. Limited Sight Distance:

Where sight distance is limited due to physical improvements (other than landscaping, fencing, or roadside vegetation) a multi-way stop may be warranted as an interim measure until such time as the obstruction can be removed in an acceptable manner. A multi-way stop may be placed after an engineering investigation has determined:

- (1) the vision from a stopped minor leg, as measured according to the Marion County Engineering Standards, is less than the minimum stopping sight distance required for the posted or prevailing speed on the major leg, and
- (2) the ADT on the minor leg exceeds 50, and
- (3) the major leg is not an arterial in the adopted classification system of Marion County.

3. Other Factors to Consider When Investigating the Need for a Stop Sign:

- a. Vision Hazards - Do any vision hazards exist and can they feasibly be removed?
- b. Accident Patterns - Are there any unusual patterns and can they be remedied by other means?
- c. Accident Potential - Is there any identifiable accident potential and

is it peculiar to this intersection?

- d. Condition of Intersection - Angle of intersection, geometry of approaches, surrounding topography, pavement markings, signing, general visibility.
- e. Any miscellaneous factors of importance – Traffic flows, schools in vicinity, particular traffic components

#### K. STREET LIGHTS

The following criteria shall be followed by the Marion County Department of Public Works in its determination of where street lights supported by road funds will be installed.

- 1. Street lights shall be placed as follows on arterials having traffic volume exceeding 10,000 ADT:
  - a. At intersections with collector streets.
  - b. At major alignment changes.
  - c. At a maximum spacing of 1000 feet and at minimum spacings of 200 feet for lights in the 20,000-40,000 luminaire range and 400 feet for lights providing greater than 40,000 luminaire output.
- 2. Street lights shall be placed on arterials with traffic volumes of 10,000 ADT or less and on collectors at specific locations where an unusually high hazard to motorists is identified by the Director of Public Works.
- 3. Street lighting shall not be provided within any city corporate limit or within residential, commercial, or industrial developments.
- 4. Statutory restrictions on use of county road funds preclude expenditure for lighting when not directly required for motor vehicle safety.

#### L. GUIDE SIGNS

The Director of Public Works may issue permits to place guide signs within the right-of-way of any public road upon the written request of any person(s) or organization under the following conditions:

- 1. General Guide Signs:
  - a. Permitted signs will be guide signs from the following list:

Parks, game preserves, campgrounds, museums, public buildings or installations (city, county, state, or federal), public golf courses, athletic fields, stadiums, auditoriums, public swimming pools, exposition grounds, historical land marks, homes, or sites, churches, group care homes, schools public and private, domestic or waste water treatment plants, solid waste collection or processing sites, recycle collection centers, transportation facilities such as airports, bus terminals, railroad stations.

- b. Criteria for approving other uses:
  - (1) The facility serves the general public.
  - (2) Consideration shall be given to the difficulty in locating the facility from the arterial road network without the signs.
  - (3) Consideration shall be given to the degree the facility is a traffic attractor.
  - (4) Consideration shall be given to the usefulness of a permanent sign and how often the facility is in use.
- c. The sign text will be limited to:
  - (1) Name of facility or feature.
  - (2) Distance to the facility or feature.
  - (3) Arrow point indicating direction to facility or feature.
- d. All signs and sign placements will be done by Marion County. All costs related to the permit issuance, inspection, and installation, will be borne by the applicant on a "Private Work Order" basis.
- e. All physical characteristics of the sign, namely size, material, shape and color will be determined by the Director, guided by the "Manual on Uniform Traffic Control Devices" as published by the Federal Highway Administration and adopted by the Oregon Department of Transportation. All completed signs must have the approval of the Director prior to installation.
- f. The sign will be located within 1 mile of the facility or feature unless circumstances should dictate otherwise. In all cases, the Director will designate the sign location.
- g. The number of signs allowed for each facility or feature will be limited to two (2). Up to four (4) signs may be approved by the

Director under extraordinary circumstances.

- h. The sign may be removed at any time, by the Director, if justified by conditions such as traffic safety, road improvements, etc., warrant such action, or if permit requirements are not met or maintained.
- i. A maintenance and removal agreement clause will be a part of each permit issued. If the existing sign becomes unusable for any reason such as vandalism or traffic accident, the applicant will be required to bear the cost of replacing the sign if they choose to have the sign replaced.
- j. The decisions regarding sign placement, number, and wording are determined by the Board of Commissioners to be of a technical, administrative nature and for that reason the Board delegates that to the Director of Public Works. The decision of the Director of Public Works is a final decision subject to review under ORS 203.113.

2. Business Guide Signs:

a. Definitions

As used in these rules, the following definitions shall apply unless the context indicates otherwise:

- (1) "Business Guide Sign" means a sign panel with the name of a qualified tourist oriented business, service or activity, qualified historical feature or qualified cultural feature together with directional information erected in advance of or at intersections on the county road system.
- (2) "Direction information" means the name of the business, service or activity, qualified historical feature or qualified cultural feature and other necessary information to direct the motoring public.
- (3) "Qualified Tourist Oriented Business" means any legal cultural, historical, recreational, educational or entertaining activity or a unique or unusual commercial or non-profit activity the major portion of whose income or visitors are derived during its normal business season from motorists not residing in the immediate area of the activity.
- (4) "Qualified Cultural Feature" means a museum approved by the Engineer after consulting with the Oregon Historical

Society and the Oregon Museum Association.

- (5) “Qualified Historical Feature” means a district or a property currently listed in the National Register of Historical places or designated as nationally significant by the United States Department of the Interior.
- (6) “Main traveled way” means through traffic lanes of said systems exclusive of frontage roads, auxiliary lanes and ramps.
- (7) “Owner” means a holder of fee title, or lessee.
- (8) “Responsible operator” means a person or entity other than an owner who operates a qualified tourist oriented business and who has authority to enter into an agreement relative to matters covered by these regulations.
- (9) “Engineer” means the Marion County Engineer.
- (10) “Applicant” means a person applying for a permit for a business guide sign.

b. Location

- (1) Business guide signs are intended for use in rural areas outside of Urban Growth Boundaries.
- (2) Business guide signs should be located so as to take advantage of natural terrain, to have the least impact on the scenic environment, and to avoid visual conflict with other traffic control devices within the highway right-of-way.
- (3) Business guide signs shall not be installed until a thorough investigation by the Engineer determines that no conflict will exist with other official traffic control devices, or any unsafe condition created.

c. Criteria for Eligibility

- (1) Each qualified tourist oriented business identified on a business guide sign shall have given written assurance to the Marion County Department of Public Works of its conformity with all applicable laws concerning the provisions of public accommodations without regard to race, religion, color, sex, or national origin, and shall not be in breach of that assurance.

- (2) The business qualified as a tourist oriented business must be located within 9 miles of the intersection where the tourist oriented directional signs are proposed to be installed. The distance will be measured as vehicle distance from the center point of the intersection to the nearest point of the intersection of the driveway of the business and a public highway.
- (3) Except for undeveloped cultural and historical features, a qualified tourist oriented business shall have:
  - (a) Restroom facilities and drinking water available.
  - (b) Continuous operation at least 6 hours per day, 5 days a week, during its normal business season.
  - (c) Licensing where required.
  - (d) Adequate parking accommodations.
- (4) Qualified undeveloped cultural and historical features shall include:
  - (a) Adequate parking accommodations.
  - (b) An informational device to provide public knowledge of the feature.

d. Composition

- (1) Business guide signs shall have a blue reflectorized background with a white reflectorized border and message. The intersection sign shall not exceed 18 inches in height and 36 inches in length and shall have not more than two lines of legend including a separate direction arrow and the distance to the facility to the nearest one-quarter mile. The content of the legend shall be limited to the identification of the business and shall not include promotional advertising as determined by the Engineer. Advance business guide signs shall be the same as the intersection business guide sign except that in lieu of the directional arrow and mileage the sign shall include the directional work information "AHEAD" or "NEXT LEFT" or "NEXT RIGHT" as may be required. Messages, symbols and trademarks which resemble any official traffic control devices are prohibited.

- (2) All directional arrows, letters and numbers used in the name of the type of service and the directional legend shall be white and reflectorized.
- (3) The Engineer must approve the materials, design and workmanship before the signs are placed.
- (4) The Department of Public Works will place all signs in county right-of- way.

e. Special Requirements

(1) Location

- (a) Business guide signs are to be located at intersections. Advance business guide signs are optional but cannot be used unless the qualifying business also has a panel at the intersection. Wherever possible, advance business guide signs are to be located at least 300 feet in advance of the intersection from which the qualified tourist oriented business is available.
- (b) The spacing between sign panels and between signs and other traffic control devices shall be determined on the basis of an engineering study. Sign panels shall not be displayed for any business if it is visible and identifiable from the traveled way the last 300 feet from the intersection.

(2) Composition

- (a) A maximum of three tourist oriented business signs may be displayed at each location. A maximum of three locations may be utilized in an intersection.

f. General Provisions

Upon selection and approval of an intersection for an installation of a business guide sign and upon approval of proper application for a permit from one or more qualified tourist oriented businesses at or conveniently accessible from the intersection, a single business guide sign for each qualified tourist oriented business shall be erected at the intersection in each direction of travel.

g. Application and Eligibility

- (1) If applications are received for any one intersection for more than the allowable number of signs, the order of priority shall be based on the date of receipt of a properly completed application.
- (2) The owner or responsible operator of a business must file an application for installation of its tourist oriented directional sign on a form specified by Marion County and agree to pay the work order costs involved.
- (3) Any grant of a new or renewed application shall entitle the applicant to the continuance of its business guide sign for as long as requirements of these regulations are met.
- (4) The signs may be removed for any of the following reasons:
  - (a) If the qualified tourist oriented business fails on a sufficient number of occasions or over a sufficient period of time to provide all of the services, so as to justify a finding by Marion County Public Works that the business is not in substantial compliance with these regulations.
  - (b) If the qualified tourist oriented business fails during its normal business season to open for business for more than 7 consecutive days or for more than 10 days cumulatively, during any 1 month period, unless Marion County Public Works finds that closure for such period was beyond the control of the owner or responsible operator, or that the closure was justified by extenuating circumstances.
  - (c) If it fails to comply with Section IV, L, 2, c, (1) except in isolated instances without the knowledge of the owner, responsible operator or manager of the business, or on any occasion unless steps are promptly taken to insure to the fullest extent reasonably possible that such instances will not recur.
  - (d) If Marion County Public Works Department elects to discontinue the program, in which case sign fees paid within the previous year will be refunded.
- (5) If due to fire, accident or similar cause, a qualified tourist oriented business becomes inoperable for an extended period of time, exceeding 7 days but not more than 90

days, its business guide sign shall be temporarily removed, but the business shall not lose its priority, nor be required to reapply prior to the normal time for a renewal application. Further extension may be granted on good cause shown. However, failure of the owner or responsible operator to proceed with necessary repairs as rapidly as possible shall cause loss of the right to continued placement of the business guide sign and require a new application.

- (6) Notwithstanding the fact that a tourist oriented business meets all of the other eligibility requirements of these regulations, an application may be denied if it is determined after investigation by the Engineer that adequate direction to the business cannot be given by a reasonable number of allowable business guide signs.

h. Fees and Maintenance

The fee for placement, administration, and if desired, fabrication, will be billed on a work order basis. Maintenance costs such as a replacement of a vandalized or missing sign shall also be borne by the applicant on a work order basis.

i. Temporary Removal and Reinstallation Fees

After the initial installation of any business guide sign, a fee on a work order basis shall be charged for:

- (1) Temporary removal because of temporary or seasonal closure of the qualified tourist oriented business.
- (2) Reinstallation of any tourist oriented directional sign pursuant to Section IV, L, 2, g, (4) of this rule.

M. ROADWAY DELINEATION

1. Engineering Study

Before any new delineation is installed, an engineering study shall be performed. The engineering study shall include a review of accident rates, day and night lighting conditions, pavement and shoulder widths, roadside vegetation, horizontal and vertical roadway alignment, existing and recommended vehicle speeds, traffic volumes, adjacent land use, weather, and other pertinent items. This engineering study should always include on-site evaluation.

2. Consistency of Installation of Delineation

- a. Delineation shall be installed in a consistent manner both along a given section of road and, to the extent economically practicable, throughout the entire road system. For example, if a curve of a particular radius is marked with delineators on a road, similar curves should be similarly marked on that road. It should, however, be recognized that curves that appear similar on a map or construction drawing may have entirely different appearances in their individual surroundings.
- b. Both for the purpose of consistency and to avoid diminishing effectiveness due to overuse, delineation shall be installed in accordance with the following hierarchy:
  - (1) Painted yellow centerline
  - (2) Painted white “fog” lines
  - (3) Turn and curve warning signs, with or without advisory speed plates
  - (4) Raised reflective pavement markers
  - (5) Delineators (reflectors mounted on posts)
  - (6) Large arrow signs
  - (7) Chevron alignment signs

Items (1), (2), (4), and (5) may be used on both tangents and horizontal curves whereas Items (3), (6), and (7) may be used only on horizontal curves.

Items (1), (2), and (4) cannot be installed on gravel roads.

- 3. The selection of delineation to be installed at a particular location shall be based on the hierarchy listed above, the results of an engineering study and the following warrants:
  - a. Painted yellow centerlines and painted white “fog” lines constitute the standard delineation for paved roads and other types of delineation shall supplement rather than replace these painted lines.
  - b. Turn and Curve Warning Signs and Advisory Speed Plates
    - (1) The turn sign is intended for use where an engineering

study shows that the recommended speed on a turn is 30 mph or less and is equal to or less than the legal speed limit

- (2) The curve sign is intended for use where an engineering study shows that the recommended speed on a turn is greater than 30 mph and is equal to or less than the legal speed limit.
- (3) The advisory speed plate is intended to supplement the turn and curve signs to give additional warning. It shall not be used alone. It shall show the maximum speed recommended by an engineering study.

c. Raised Reflective Pavement Markers

- (1) Raised reflective pavement markers shall be installed on all roads classified as arterials or collectors. On local roads, pavement markers shall be installed only in special situations where justified by an engineering study.
- (2) Pavement markers shall be spaced as follows:
  - (a) Rural areas: 80 feet apart on tangents and 40 feet apart on curves
  - (b) Urban areas: 40 feet apart on tangents and curves
- (3) Where pavement markers are to be installed only on a curve, markers shall also be installed on the approach tangents for a distance of 400 feet in each direction from the curve. On these tangents, the marker spacing shall be the standard 80 feet.
- (4) Pavement markers shall not be installed in areas where snow removal operations are expected to be necessary as frequently as once every other year. In the absence of site-specific records, markers shall not be installed at elevations greater than 800 feet above mean sea level.

d. Delineators (Reflectors Mounted on Posts)

- (1) Delineators shall be installed in accordance with Table 7:
  - (a) Delineators should be installed only on curves with a central angle of 20 degrees or greater.

# TABLE 7

## DELINEATOR WARRANTS

Traffic Volume (ADT)	Road Classification	Install Delineators
0-500	Local	Only in special cases where justified by an engineering study
500-1000	Collector	On curves sharper than 12 degrees
1000 or more	Arterial	On curves sharper than 6 degrees

- (b) Delineators may be installed on curves when raised reflective pavement markers alone have been found to be inadequate. Such situations may occur where a crest vertical curve blocks the driver's view of the pavement markers within the safe stopping sight distance or where the need for additional advance warning is demonstrated by the occurrence of accidents.
    - (c) Delineators shall not be installed within any urban growth boundary.
  - (2) Delineators on horizontal curves shall be spaced in accordance with Table 8:
    - (a) For curves falling between the values listed, use the spacing given for the next sharper curve.
    - (b) To clear driveways, crossroads, etc., or for required adjustments at ramps and at intersections, either vary placement of that delineator up to 1/8 of spacing shown, or if that will not work, eliminate that delineator.
    - (c) On curves with central angles greater than 40 degrees, installation of delineators should be terminated at the location where deflection reaches 40 degrees.
  - (3) Judgment should be exercised in the installation of delineators on substandard roadway sections, particularly where ditches are narrow and where delineators would hamper
  - (4) Delineators should not be located in an actively farmed area unless they can be placed far enough off the pavement to avoid being hit by farm machinery and in areas that avoid conflict with agricultural operations.
  - (5) Delineators should be installed on both sides of horizontal curves with white reflective sheeting or reflectors installed on the side of the delineator visible to the driver's right.
  - (6) The use of large arrow signs or chevron signs should be considered on all curves sharper than 30 degrees.
- e. Large Arrow Sign

## TABLE 8

### DELINEATOR SPACING ON HORIZONTAL CURVES

Degree of Curve	Spacing on Curve (ft.)	Spacing in Advance of Curve (ft.)	
		First Space	Second Space
6	120	200	350
7-8	100	180	300
9-10	90	160	270
11-12	80	140	240
13-18	70	130	210
19-25	60	110	180
26-up	50	100	150

A large arrow sign is intended to be used to give notice of a sharp change in roadway alignment. It should be used to mark curves that have a high accident experience where raised reflective pavement markers or delineators do not provide adequate warning to motorists. The large arrow sign shall be erected on the outside of the curve in line with and at right angles to approaching traffic. It should be visible for at least 500 feet.

f. Chevron Alignment Sign

The chevron alignment sign may be used as an alternate or supplement to delineators and the large arrow sign. The chevron alignment sign is intended to be used to give notice of a sharp change in roadway alignment and to provide additional emphasis and guidance for vehicle operators. Chevron alignment signs are normally installed in groups of three or more with spacing such that drivers always have two in view as they proceed around the curve. Chevron alignment signs are installed on the outside of a curve at right angles to approaching traffic and the first two should be visible for at least 500 feet.

N. BRIDGES

All vehicular bridges shall be designed to carry at least HS 25 vehicle loading, plus impact.

Structural and geometric design of bridges, including width, shall be in accordance with the current standards in use by ODOT. These include, but are not limited to, Standard Specifications for Highway Bridges (AASHTO). Minimum bridge width shall normally be equal to the total width of the travel lanes plus the shoulders but in no case shall be less than 28 feet.

## V. DRAINAGE STANDARDS

These standards shall apply to all drainage facilities which impact a public right-of-way or easement dedicated to Marion County and within all off-street parking and loading areas as required by the Marion County Zoning Ordinance.

All storm water runoff shall be conveyed to a public storm sewer, or natural drainage channel, having adequate capacity to carry the flow without overflowing or otherwise causing damage to public and private property. In the case of private development, the developer shall pay all costs associated with designing and constructing the facilities necessary to meet this requirement.

### A. DESIGN

#### 1. Calculations

Design calculations shall be submitted for all drainage facilities, and shall be completed on Marion County standard forms or an approved facsimile.

Peak design discharges shall be computed using the rational formula,  $Q=CiA$ , only for basins under 1,000 acres. For larger basins, gauged flows or Soil Conservation Service or other approved methods shall be used.

##### a. Design Storm

The intensity-duration frequency is based on the type area through which the facility (pipe or ditch) passes and the size of the drainage facility. The adopted criteria are listed in Table 9.

##### b. Rainfall Intensity-Duration Curve

The rainfall intensity-duration curve for Marion County is shown on Standard Drawing No. 27.

##### c. Runoff Coefficients

The recommended coefficients of runoff (C) are listed in Table 10.

##### d. Time of Concentration

For land in a pre-development condition, the minimum time of concentration from the most remote point in the basin to the first defined channel (e.g. gutter, ditch or pipe) shall be 10 minutes. (Pre-development is defined in Section II.) Longer times using the

## **TABLE 9**

### **DESIGN STORM FREQUENCY**

<u>Area</u>	<u>Frequency</u>
Residential Area	5-year storm
Commercial and high value districts	10-year storm
Trunk lines ( 24" pipe and larger )	25-year storm
Minor creeks and drainage ways (not shown as a flood plain on the Flood Insurance Rate Map (Firm))	50-year storm
Major Creek (shown as a flood plain on the FIRM)	100-year storm

## **TABLE 10**

### **RUNOFF COEFFICIENTS**

<u>Soil Cover</u>	<u>Flat Terrain s&lt;2%</u>	<u>Rolling Terrain 2%&lt;s&lt;10%</u>	<u>Steep Terrain s&gt;10%</u>
Relatively high permeability ( lawns, pasture, woods )	0.20	0.25	0.30
Moderate impermeability			
1) Single-family residential in urban areas, except corner lots with duplex potential	0.40	0.45	0.50
2) Gravel parking lots	0.50	0.55	0.60
3) Mobile home parks	0.60	0.65	0.70
4) Multi-family residential, zero-lot-line single- family residential and potential duplex lots in Single-family residential	0.70	0.75	0.80
High impermeability (roofs and paved areas )	0.90	0.90	0.90

Soil Conservation Service (SCS) method or other approved methods shall be used where appropriate.

For developed residential and commercial/industrial property, the maximum time of concentration from the most remote point in the development to the closest inlet shall be 10 minutes, unless calculations by an acceptable method show the time to be longer.

## 2. Detention Facilities

### a. Where Required

Peak storm water runoff shall be controlled by detention facilities for all subdivisions, all commercial and industrial developments and all parking lots with a total developed acreage of 0.5 acres or more and all other developments where the county engineer determines control is needed to prevent flooding or damage downstream. This requirement may be waived if the applicant can show that it is not effective for the basin as a whole.

### b. Allowable Runoff Rate ( Outflow )

Peak runoff rate shall be limited to that which would occur in a 5-year frequency storm with predevelopment conditions ( $C=0.2$ ). Pre-development is defined in Section II.

### c. Required Storage Capacity

Detention facilities shall have storage capacities to detain the difference between a 5-year frequency storm with pre-development conditions and a 10-year frequency storm with development conditions.

### d. Design

- (1) The design shall be done in accordance with the Oregon Department of Transportation Publication 78-4, "Procedure Manual, Application of Detention Storage for Limiting Runoff", or other methods approved by the Director of Public Works.
- (2) The orifice size and the hydraulic head shall be adjusted to produce the allowable outflow.
- (3) To prevent excessive plugging, the minimum orifice diameter shall be 1-1/2 inches.
- (4) Detention facilities shall be designed to protect public and private

property.

(a) Freeboard

At maximum storage, the water surface elevation shall be a minimum of 0.5 feet below the top of the structure (curb, bank, berm, etc. ) designed to contain the water.

(b) Overflow System

The detention facility shall have an overflow system with the capacity to pass a 50-year frequency storm. The overflow shall discharge into a public storm drain facility or the natural drainage course for the drainage basin where the development is located.

(5) Simplified design for sites between 0.5 acres and 5 acres.

For developments in this size range, the detention facility may be designed in accordance with Standard Drawing No. 30. This method is based on the following conditions:

(a) The sites are small enough so that there is an insignificant difference between the times of concentration for the different site sizes. For calculating the allowable runoff rate, a uniform time of concentration of 10 minutes is applicable and, as a result, the allowable runoff rate is 0.2 cfs per acre.

(b) The sites, when developed, will have surfaces that are almost entirely impermeable (buildings, pavement, etc.). For a site not conforming to this condition, the required storage capacity can be reduced by doing a detailed analysis instead of following the standard drawing.

3. Pipes

- a. Concrete pipe shall be used, except for temporary or unusual conditions, with a minimum diameter of 10 inches and a minimum cover of 12 inches. Based on the cover and anticipated loading, the required type ASTM C-76 ( reinforced ) or ASTM C-14( non-reinforced ) and class of pipe shall be specified. Within county right-of-ways, under all public roadway areas, the pipe shall have rubber gasket joints. When the pipe has less than 12 inches of cover, Ductile Iron, Class 52 shall be installed. High-density polyethylene pipe with a corrugated exterior and a smooth interior ( Advanced Design Systems, Inc., N-12 or equivalent ), ASTM F-405 and F-667 or AASHTO M-252 and M-294, may be used for driveway culverts, provided a minimum cover of 18 inches can be placed and still

keep the surface of the driveway (at the ditch line ) lower than the surface of the county road, in accordance with Standard Drawing No. 11J.

- b. Pipes shall be designed for free flow (i.e., not under head).
  - c. Allowance for energy loss due to turns, structures, pipe size change, etc., shall be considered in the design of the storm drainage facilities.
  - d. Mannings “n” value shall be 0.013 for concrete pipe.
  - e. Minimum velocity shall be 3.0 fps at peak design flow. Minimum velocity of 2.5 fps will be allowed if the developer provides a construction bond, or similar assurance, for the cost of relaying the pipe if it is laid flatter than 80% of the design grade between structures or pipe ends.
  - f. Pipe slopes greater than 20% shall have concrete encasement or anchor walls at 21-foot spacing, and shall be reviewed by the Director of Public Works for impact or excessive velocity and the need for energy dissipators.
  - g. Storm sewer and other utility lines should not meander across the road right-of-way, creating conflicts with existing and future utilities and preempting orderly future installation. With a few exceptions, underground utilities should parallel the roadway centerline and be placed per Standard Drawings Nos. 2, 3, and 4.
  - h. When fill or trench depths exceed 10 feet, design calculations for pipe loading and strength shall be submitted.
  - i. Pipe bedding and trench backfill shall conform to Standard Drawing No. 25.
  - j. Storm sewers crossing private property shall have minimum easement widths of 10 feet. Deep storm sewers, large pipe or unstable soil situations will require wider easements.
4. Storm Drain Manholes, Junction Boxes and Cleanouts
- a. Manholes shall be required at:
    - (1) All changes in horizontal or vertical alignment. Minor horizontal curvature in pipe less than 15 degrees may be allowed, (without manholes or cleanouts), depending on pipe size, street alignment, degree of curvature and reason. Maximum joint deflection shall be per manufacturer’s recommendation.
    - (2) All connections.

- (3) All changes in pipe size.
- (4) At a spacing no greater than 500 feet.
- b. Standard catch basins, junction boxes, or cleanouts may be used in place of manholes for pipe no larger than 18 inches and with a depth less than 4.0 feet.
- c. In place of manholes, on new main line and lateral construction, catch basing laterals of 30 feet or less in length and 10 inches in diameter may connect to the main line with a shop fabricated 90 degree "T", provided the connection is located not more than 100 feet from a manhole or cleanout on the main line and the main line is 15 inches or larger in diameter.
- d. In place of manholes or cleanouts, laterals draining private property may be connected directly to the main line, provided the lateral diameter is 8 inches or less and is no more than one half the diameter of the main line. The hole in the main line shall be made with a drill designed for cutting concrete. The connection shall be properly grouted to provide a strong, leak-proof point. The lateral shall not project inside the main line.

5. Inlets and Catch Basins

Inlets and catch basins shall be required at:

- a. All low spots, whether on public or private property, and shall be connected to a storm drainage facility.
- b. A maximum gutter flow length of 500 feet.

6. Drywells and French Drains

Drywells and French drains shall not be allowed as the exclusive method for draining public right-of-ways but may be used for developments on private property for paved driveways, parking and loading areas, subject to the following conditions:

- a. There are no public storm drain facilities, available within a reasonable distance of the development.
- b. A soils test shall be provided to show that there is adequate permeability.
- c. The system shall be engineered to insure that adequate capacity is available.
- d. Provisions shall be made for grease and fines removal.

- e. The site shall be graded so that it does not drain onto a public right-of-way in the event that the drywell or French drain fails.
- f. The design shall be approved by the Department of Public Works.

7. Open Channels

- a. All existing streams and ditches and other open channels requiring a pipe diameter greater than 36 inches shall remain open channel except at road crossing.
- b. Where possible, ditches shall be located along or adjacent to lot lines. Within the UGB, creation of new open channels will not be allowed, unless it is to relocate an existing open channel.
- c. For reasons of maintenance and safety, bank slopes generally shall be 4:1 or flatter but may be a maximum of 2:1 with Department of Public Works approval.
- d. The maximum allowable design velocity shall be 7 fps.
- e. The minimum allowable design velocity shall be 2 fps. The installation of a concrete lined low-flow channel may be required to achieve minimum velocity.
- f. The normal maximum depth for an open ditch shall be 4 feet outside of road rights-of-way and 2 feet adjacent to the roadways.
- g. Channels crossing private property shall have a minimum easement width equal to the channel width at the top plus 10 feet along one side of the channel.

B. PLANS

- 1. All plans shall include a map outlining the drainage basin boundaries for which a storm water runoff system is being designed and those adjacent basins which may be affected. This drainage basin map shall show the existing and proposed drainage swale, stream or body of water. The scale of this map may vary from 1" equals 200' to 1" equals 2,000' depending on the size of the drainage basins.
- 2. All crossings and potential conflicts between storm sewers and other underground utilities shall be shown on the profile.
- 3. Means of preventing erosion along new channels, ditches and at pipe outfalls, are required and shall be shown on the plans.

4. Pipe sizes, types, classes and bedding shall be specified on the plan.
5. Pipe bedding and trench backfill shall be specified on plans and shall be per Standard Drawing No. 25.

## **VI. USE OF COUNTY RIGHT-OF-WAY BY OTHERS**

Written permission to work in or modify a county right-of-way or easement, including the construction of driveway accesses, must be obtained from the Director of Public Works or his representative prior to actual commencement of said work. Such work must restore the road structure to its present physical characteristics, including any additional work or materials necessary to compensate for weaknesses caused by disturbing the structural integrity of the roadway. Standard Drawing No. 25 shows backfill requirements for excavation work undertaken in the right-of-way.

The location of utilities or other facilities in the right-of-way shall be as shown on Standard Drawing Nos. 2, 3, and 4, or as authorized by the Director of Public Works.

Underground utility crossing shall in general be installed by boring, jacking, or tunneling, rather than excavating or ditching. Unless there are special circumstances approved by the Director of Public Works, (e.g., rock subgrade), open cuts for utilities in paved roads shall not be permitted for:

1. Conduits 4 inches and smaller in diameter.
2. Roads classified as arterials.
3. Roads overlaid within the last 3 years.

Where the Director of Public Works has approved an open cut, the pavement shall be saw cut and the crossing shall be perpendicular to the centerline of the road.

## **VII CHECK LIST FOR SUBDIVISION REVIEW**

On the following pages appear check lists to be used in the various stages of subdivision review listed below:

- A. Preliminary Plat
- B. Engineering Plans
- C. Final Plat ( hard copy )

CHECK LIST FOR PRELIMINARY SUBDIVISION PLAT REVIEW

Name of Subdivision \_\_\_\_\_ Review By \_\_\_\_\_  
Date \_\_\_\_\_

- \_\_\_\_\_ 1. Is it inside or outside an urban growth boundary ( U.G.B. ) ?
- \_\_\_\_\_ 2. If inside a U.G.B., is it in sewer and water districts?
- \_\_\_\_\_ 3. Are permits or approvals from other government agencies required?
- \_\_\_\_\_ 4. Streets and Roads:
  - \_\_\_\_\_ a. Existing county roads or other public right-of-way ( R/W ) ?
    - \_\_\_\_\_ 1) Classification ( arterial, collector or local ) ?
    - \_\_\_\_\_ 2) Is additional R/W required?
    - \_\_\_\_\_ 3) Is it a gravel road that must be paved?
      - \_\_\_\_\_ a) Along frontage of subdivision?
      - \_\_\_\_\_ b) Off-site to connect to a paved county road?
    - \_\_\_\_\_ 4) Is widening of existing pavement required?
    - \_\_\_\_\_ 5) Are curb and sidewalk required?
    - \_\_\_\_\_ 6) Access:
      - \_\_\_\_\_ a) New streets and roads:
        - \_\_\_\_\_ (1) Does spacing meet minimum standards?
        - \_\_\_\_\_ (2) Is sight distance adequate?
      - \_\_\_\_\_ b) Driveways for individual lots:
        - \_\_\_\_\_ (1) Are locations available that have adequate sight distance?
        - \_\_\_\_\_ (2) Are combined or joint-use driveways required?
        - \_\_\_\_\_ (3) Is a limited access street involved? ( e.g., Cordon Road )
  - \_\_\_\_\_ b. New Streets and Roads:
    - \_\_\_\_\_ 1) Will they be public or private?
      - \_\_\_\_\_ a) Public or private R/W?
      - \_\_\_\_\_ b) Type of maintenance?
        - \_\_\_\_\_ (4) County? ( Must be public R/W and built to county standards. )
        - \_\_\_\_\_ (5) Private? Homeowners Association required?
    - \_\_\_\_\_ 2) Classification?
    - \_\_\_\_\_ 3) Required R/W width?
    - \_\_\_\_\_ 4) Required pavement width?
    - \_\_\_\_\_ 5) Are curb and sidewalk required?
    - \_\_\_\_\_ 6) Curve radii - do they meet standards?
      - \_\_\_\_\_ a) Horizontal curves.
      - \_\_\_\_\_ b) Curb returns or pavement flares.
      - \_\_\_\_\_ c) Property corners at intersections.
    - \_\_\_\_\_ 7) Grades - does it appear that standards can be met?
    - \_\_\_\_\_ 8) Will future street extensions be needed to serve adjoining property?
    - \_\_\_\_\_ 9) Are one-foot reserve strips needed?
    - \_\_\_\_\_ 10) Are there existing easements that must be cleared before county can accept R/W dedication?

- \_\_\_\_\_ 5. Drainage:
  - \_\_\_\_\_ a. Where does runoff currently go?
  - \_\_\_\_\_ b. Is there an existing public facility or natural drainage course nearby that can serve the property?
  - \_\_\_\_\_ c. What and where is the ultimate receiving swale, stream or body of water?
  - \_\_\_\_\_ d. Do existing facilities need improvement, enlargement or rerouting?
  - \_\_\_\_\_ e. Is a detention system required?
  - \_\_\_\_\_ f. Are there special or unusual problems?
    - \_\_\_\_\_ 1) Is subdivision in a flood plain?
    - \_\_\_\_\_ 2) Are existing storm drains too shallow?
    - \_\_\_\_\_ 3) Does the ground slope so as to make it ver difficult or impossible to get water into existing facilities or natural streams?
    - \_\_\_\_\_ 4) Will solution to drainage problem require significant revision of street alignment or lot lines?
    - \_\_\_\_\_ 5) Does a drainage plan need to be prepared and approved by DPW prior to the granting of detailed approval by Planning Commission?
  - \_\_\_\_\_ g. Are special or unusual easements required?
- \_\_\_\_\_ 6. Is subdivision in a landslide hazard area?
  - \_\_\_\_\_ a. Is a geologic study required?

## CHECK LIST FOR ENGINEERING PLAN REVIEW

Name of subdivision or other Development \_\_\_\_\_

Review by \_\_\_\_\_ Date \_\_\_\_\_

- \_\_\_\_\_ 1. Vicinity Map on Cover Sheet?
- \_\_\_\_\_ 2. Title Block?
- \_\_\_\_\_ 3. Engineers Stamp and Signature?
- \_\_\_\_\_ 4. Streets and Roads?
  - \_\_\_\_\_ a. Typical Sections?
    - \_\_\_\_\_ 1) Pavement?
      - \_\_\_\_\_ a) AC Class?
      - \_\_\_\_\_ b) Thickness?
      - \_\_\_\_\_ c) Width?
      - \_\_\_\_\_ d) Cross-slope?
    - \_\_\_\_\_ 2) Aggregate Base?
      - \_\_\_\_\_ a) Grading (1" - 0, etc. ) ?
      - \_\_\_\_\_ b) Thickness?
    - \_\_\_\_\_ 3) Turnpike?
      - \_\_\_\_\_ a) Shoulder?
        - \_\_\_\_\_ (1) Width. Narrower around cul-de-sac?
        - \_\_\_\_\_ (2) Cross-slope?
      - \_\_\_\_\_ b) Ditch?
        - \_\_\_\_\_ (1) Width to C.L.?
        - \_\_\_\_\_ (2) Entering slope?
        - \_\_\_\_\_ (3) Backslope?
    - \_\_\_\_\_ 4) Curbs?
      - \_\_\_\_\_ a) Type?
      - \_\_\_\_\_ b) Height of Exposure?
      - \_\_\_\_\_ c) Aggregate base underneath?
      - \_\_\_\_\_ d) Weep holes?
    - \_\_\_\_\_ 5) Sidewalks?
      - \_\_\_\_\_ a) Location (Curb line or property line)?
      - \_\_\_\_\_ b) Width?
      - \_\_\_\_\_ c) Concrete?
  - \_\_\_\_\_ b. Profiles?
    - \_\_\_\_\_ 1) Stationing and scales ( vertical and horizontal ) ?
    - \_\_\_\_\_ 2) Existing ground at centerline and right-of-way lines?
    - \_\_\_\_\_ 3) Vertical Alignment?
      - \_\_\_\_\_ a) Grades: centerline for turnpike, top of curb for curbed section?
        - \_\_\_\_\_ (1) Maximum?
        - \_\_\_\_\_ (2) Minimum ( Including cul-de-sac and curb returns ) ?
      - \_\_\_\_\_ b) Vertical curves?
        - \_\_\_\_\_ (1) Minimum length?
        - \_\_\_\_\_ (2) Curve data ( stations and elevations of PIVC, BVC, EVC ) ?

- \_\_\_\_\_ c. Plans?
  - \_\_\_\_\_ 1) North arrow, scale, street centerline, right-of-way lines, stationing, and street names?
  - \_\_\_\_\_ 2) Horizontal alignment?
    - \_\_\_\_\_ a) Curves?
      - \_\_\_\_\_ (1) Minimum radii?
      - \_\_\_\_\_ (2) Maximum superelevation?
      - \_\_\_\_\_ (3) Superelevation runoff?
        - \_\_\_\_\_ (a) Minimum length?
        - \_\_\_\_\_ (b) Method of obtaining?
        - \_\_\_\_\_ (c) Shown on profile?
      - \_\_\_\_\_ (4) Curve data ( radius, length, deflection angle, stations of P.C. and P.T.. ) ?
    - \_\_\_\_\_ b) Cul-de-sac minimum radii?
      - \_\_\_\_\_ (1) Entering sac?
      - \_\_\_\_\_ (2) Around sac?
    - \_\_\_\_\_ c) Intersections?
      - \_\_\_\_\_ (1) Sight distances?
      - \_\_\_\_\_ (2) Angles?
      - \_\_\_\_\_ (3) Turnpike flare radii?
      - \_\_\_\_\_ (4) Curb returns?
        - \_\_\_\_\_ (a) Radii?
        - \_\_\_\_\_ (b) Wheelchair/bicycle ramps?
  - \_\_\_\_\_ 3) Slope easements required?
  - \_\_\_\_\_ 4) Traffic signs and barricades?
    - \_\_\_\_\_ a) Shown on plans?
    - \_\_\_\_\_ b) Note specifying that they are to be furnished and installed by Subdivider/developer/contractor?
  - \_\_\_\_\_ 5) Note specifying that all utilities and utility laterals that will lie under the street must be placed prior to paving of street.
- \_\_\_\_\_ 5. Drainage?
  - \_\_\_\_\_ a. Drainage basins and receiving facility, swale, stream or body of water shown?
  - \_\_\_\_\_ b. Hydraulic calculations?
    - \_\_\_\_\_ 1) Method applicable. Maximum area for rational formula?
    - \_\_\_\_\_ 2) Parameters and assumptions?
  - \_\_\_\_\_ c. Detention system required?
    - \_\_\_\_\_ 1) Hydraulic calculations ( methods, parameters, assumptions ) ?
    - \_\_\_\_\_ 2) Storage basin capacity?
    - \_\_\_\_\_ 3) Method of flow restriction?
  - \_\_\_\_\_ d. Existing stream or ditch to be piped? Maximum size?
  - \_\_\_\_\_ e. Provisions for draining adjacent property?

## CHECK LIST FOR ENGINEERING PLAN REVIEW

- \_\_\_\_\_ f. Pipe?
  - \_\_\_\_\_ 1) Diameter?
  - \_\_\_\_\_ 2) Type ( concrete ) ?
  - \_\_\_\_\_ 3) ASTM type and class?
  - \_\_\_\_\_ 4) Rubber casket joints in roadway?
  - \_\_\_\_\_ 5) Crushed rock trench backfill in roadway?
- \_\_\_\_\_ g. Open channel?
  - \_\_\_\_\_ 1) New open channels not allowed in UGB?
  - \_\_\_\_\_ 2) Typical section?
    - \_\_\_\_\_ a) Width?
    - \_\_\_\_\_ b) Depth ( also see profile ) ?
    - \_\_\_\_\_ c) Side slopes?
- \_\_\_\_\_ h. Profile?
  - \_\_\_\_\_ 1) Existing ground surface?
  - \_\_\_\_\_ 2) Finished grade of street, ground, etc.?
  - \_\_\_\_\_ 3) Invert with elevations and slopes?
  - \_\_\_\_\_ 4) Inlets, cleanouts and manholes?
    - \_\_\_\_\_ a) Location by station?
    - \_\_\_\_\_ b) Elevation of inverts and rims?
  - \_\_\_\_\_ 5) Minimum or maximum cover over pipe?
  - \_\_\_\_\_ 6) Maximum depth in open channel?
- \_\_\_\_\_ i. Plan?
  - \_\_\_\_\_ 1) Alignment of pipe or ditch with ties to centerline, curb, right-of-way or property lines?
  - \_\_\_\_\_ 2) Location of inlets, cleanouts and manholes?
  - \_\_\_\_\_ 3) Curved pipelines?
    - \_\_\_\_\_ a) Radius
    - \_\_\_\_\_ b) Maximum joint pull?
- \_\_\_\_\_ j. Capacity? Free flow ( not under head ) in pipes?
- \_\_\_\_\_ k. Velocity?
  - \_\_\_\_\_ 1) Minimum for self cleaning?
  - \_\_\_\_\_ 2) Maximum?
    - \_\_\_\_\_ a) Thrust blocks on pipe?
    - \_\_\_\_\_ b) Rip Rap or lining in ditches?
- \_\_\_\_\_ l. Inlets?
  - \_\_\_\_\_ 1) Type?
  - \_\_\_\_\_ 2) Type of grate?
  - \_\_\_\_\_ 3) Maximum spacing?
  - \_\_\_\_\_ 4) Maximum pipe size?
  - \_\_\_\_\_ 5) At all low points ( including curb returns ) ?
  - \_\_\_\_\_ 6) Maximum depth of catch basins?
- \_\_\_\_\_ m. Cleanouts/junction boxes and/or manholes?
  - \_\_\_\_\_ 1) Required at:
    - \_\_\_\_\_ a) Changes in alignment or grade?
    - \_\_\_\_\_ b) Lateral connections of lateral pipe  $\geq \frac{1}{2}$  diameter of main line?
    - \_\_\_\_\_ c) Changes in pipe size?
    - \_\_\_\_\_ d) Maximum cleaning intervals?

CHECK LIST FOR ENGINEERING PLAN REVIEW

- \_\_\_\_\_ 2) Manholes required because of pipe size and/or depth?
- \_\_\_\_\_ n. Outfalls: Rip or rap or structure to prevent erosion?
- \_\_\_\_\_ o. Conflicts with sewers or other utilities?
- \_\_\_\_\_ p. Easements over private property?
  - \_\_\_\_\_ 1) Minimum width?
  - \_\_\_\_\_ 2) Extra width required by pipe size, depth or special conditions?
  - \_\_\_\_\_ 3) Access to easement?

CHECK LIST FOR FINAL ( HARD COPY ) SUBDIVISION PLAT REVIEW



Name of Subdivision \_\_\_\_\_

Reviewed By \_\_\_\_\_ Date \_\_\_\_\_

- \_\_\_\_\_ 1. Signatures: Are all the following signatures and spaces for subsequent signatures on plat?
  - \_\_\_\_\_ a. Owner(s) ? Notarized?
  - \_\_\_\_\_ b. Private licensed surveyor? Stamp or seal? Notarized?
  - \_\_\_\_\_ c. County
    - \_\_\_\_\_ 1) Planning Director?
    - \_\_\_\_\_ 2) Sanitarian? ( Required only outside UGB or where private septic systems will be used inside UGB )
    - \_\_\_\_\_ 3) County Surveyor?
    - \_\_\_\_\_ 4) Tax Collector? Statement that taxes have been paid to DATE?
    - \_\_\_\_\_ 5) Tax Assessor?
    - \_\_\_\_\_ 6) Space for three (3) Commissioners?
      - \_\_\_\_\_ a) Spelling of Commissioners names?
      - \_\_\_\_\_ b) Signatures spaces for Commissioners and Tax Collector located together under approval statement?
    - \_\_\_\_\_ 7) Space for County Clerk to attest commissioner's signatures?
    - \_\_\_\_\_ 8) Space for County Clerk to list recording data and sign?
    - \_\_\_\_\_ 9) Space for County Engineer?
- \_\_\_\_\_ 2. Dedication statement?
  - \_\_\_\_\_ a) Is it located above owner's signature?
  - \_\_\_\_\_ b) Does it include:
    - \_\_\_\_\_ 1) Streets?
    - \_\_\_\_\_ 2) Easements?
  - \_\_\_\_\_ c) Separate statement dedicating 1-foot reserve strips to county in fee simple? ( If omitted, may use separate warranty deed. )
- \_\_\_\_\_ 3. Improvement agreement submitted by subdivider?
  - \_\_\_\_\_ a) Date at top of first page left blank?
  - \_\_\_\_\_ b) Subdivider's name on first page?
  - \_\_\_\_\_ c) Completion dates listed for all items of work?
  - \_\_\_\_\_ d) Signed by subdivider?
- \_\_\_\_\_ 4. Bond or alternate financial guarantee ( if required ) provided by subdivider?
  - \_\_\_\_\_ a. Reviewed and approved by county legal counsel?
- \_\_\_\_\_ 5. Warranty deed for 1-foot reserve strips submitted by subdivider ( only if not included in dedication statement - see 2, c. above ) ?
- \_\_\_\_\_ 6. Engineering plans: Have they been approved?
  - \_\_\_\_\_ a. Road and storm drain plans approved by county engineer?

- \_\_\_\_\_ b. "Plan check" fee paid? "Plan check" form signed by subdivider and by Department of Public Works?
- \_\_\_\_\_ c. Sewer and water plans approved by City ( required only if inside UGB ) ? ( Copy of approval letter required. )
- \_\_\_\_\_ 7. Roads: Do they conform to approved engineering plans and subdivision ordinance?
  - \_\_\_\_\_ a. Right-of-way widths?
  - \_\_\_\_\_ b. Horizontal curve radii?
  - \_\_\_\_\_ c. Cul-de-sac right-of-way radii?
    - \_\_\_\_\_ 1) Radii entering a cul-de-sac?
    - \_\_\_\_\_ 2) Radii around cul-de-sac?
  - \_\_\_\_\_ d. Intersections: Property corner radii?
  - \_\_\_\_\_ e. Additional right-of-ways dedicated along existing public roads?
  - \_\_\_\_\_ f. Are all new right-of-ways clear of easements other than utility easements?
- \_\_\_\_\_ 8. Easements:
  - \_\_\_\_\_ a. Preexisting recorded easements?
  - \_\_\_\_\_ b. New 5-foot utility easements along all side and rear lot lines ( may use note in lieu of showing each one on plat ) ?
  - \_\_\_\_\_ c. Special purpose easements: Do widths and alignments conform to approved engineering plans?
    - \_\_\_\_\_ 1) Slope?
    - \_\_\_\_\_ 2) Storm drain?
    - \_\_\_\_\_ 3) Sewer?
    - \_\_\_\_\_ 4) Access ( including combined driveways and frontage roads ) ?
    - \_\_\_\_\_ 5) Do easements need to be made exclusive ( other utilities or uses excluded ) ?
- \_\_\_\_\_ 9. One-foot reserve strips shown on plat?
- \_\_\_\_\_ 10. Notes limiting access or requiring combined driveways?
- \_\_\_\_\_ 11. Unusual or special conditions—check:
  - \_\_\_\_\_ a. DPW memos and letters?
  - \_\_\_\_\_ b. Planning Commission decisions?
  - \_\_\_\_\_ c. Board of Commissioners' decision ( if ) any?
  - \_\_\_\_\_ d. Approved engineering plans?

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\TYPICAL CROSS SECTIONS FOR URBAN STREETS.DWG PLOTTED: 2023/01/24 12:53 PM

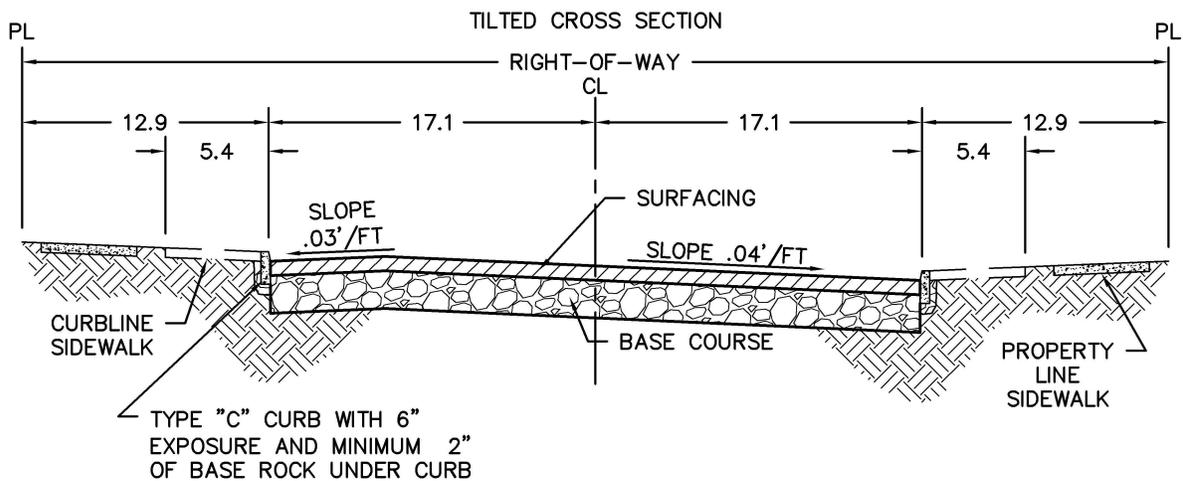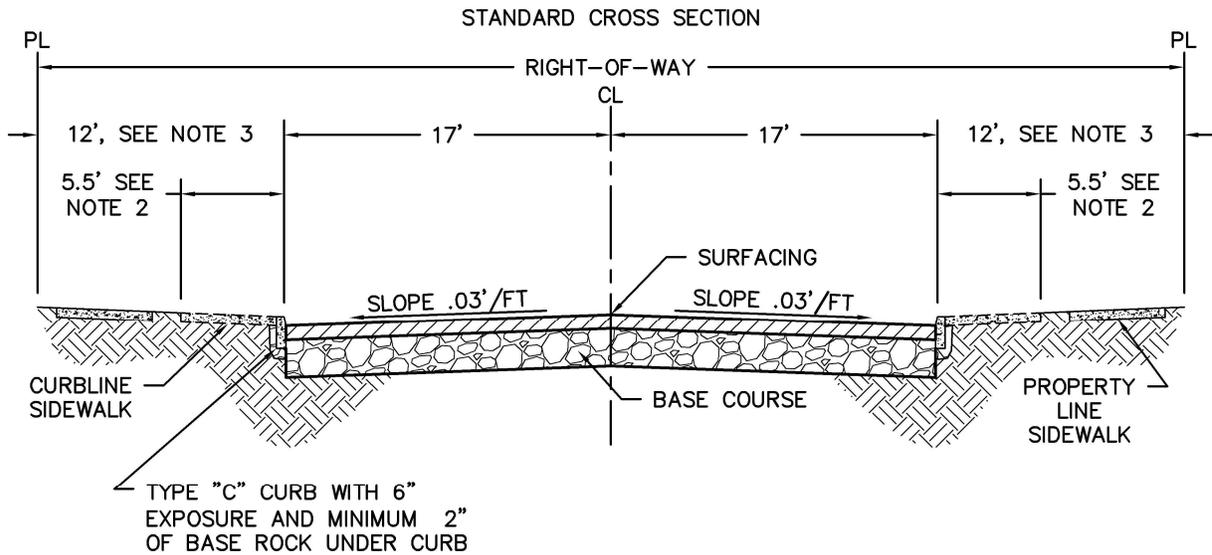

**NOTES**

1. SURFACING, BASE COURSE, AND SIDEWALK SHALL CONFORM TO MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARDS.
2. 50' RIGHT-OF-WAY, CURB-LINE SIDEWALK.
3. REQUIRES 60' RIGHT-OF-WAY.

Standard Drawing 1



MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**TYPICAL CROSS SECTION FOR URBAN STREETS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 09/16/1981	REVISION DATE: 01/24/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

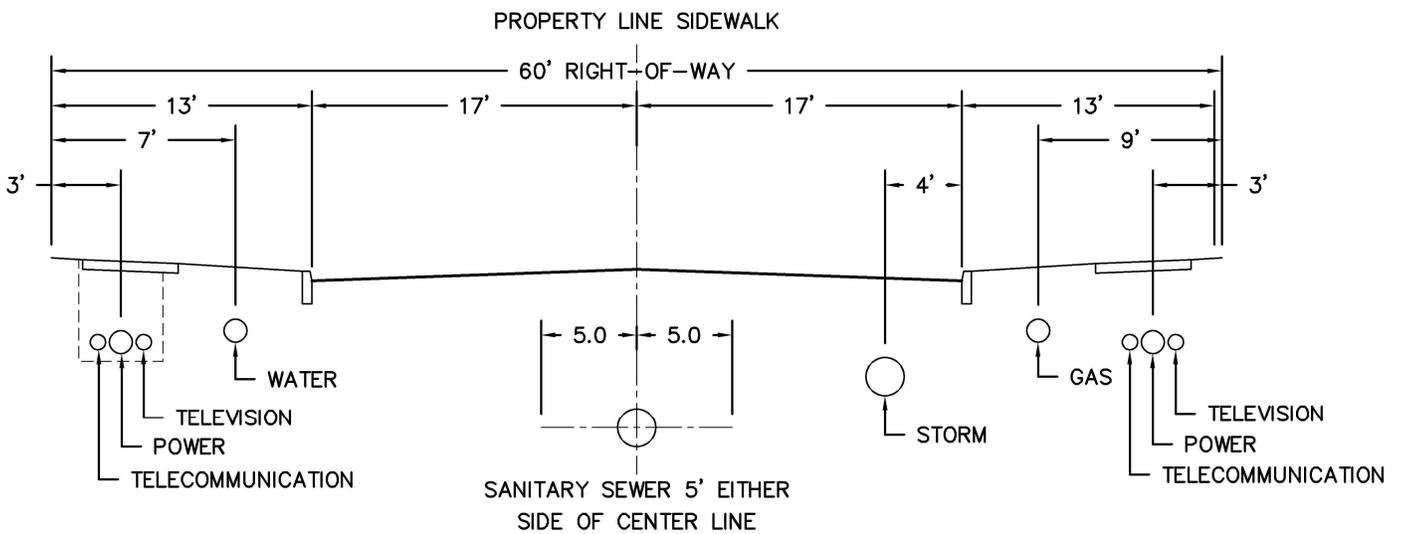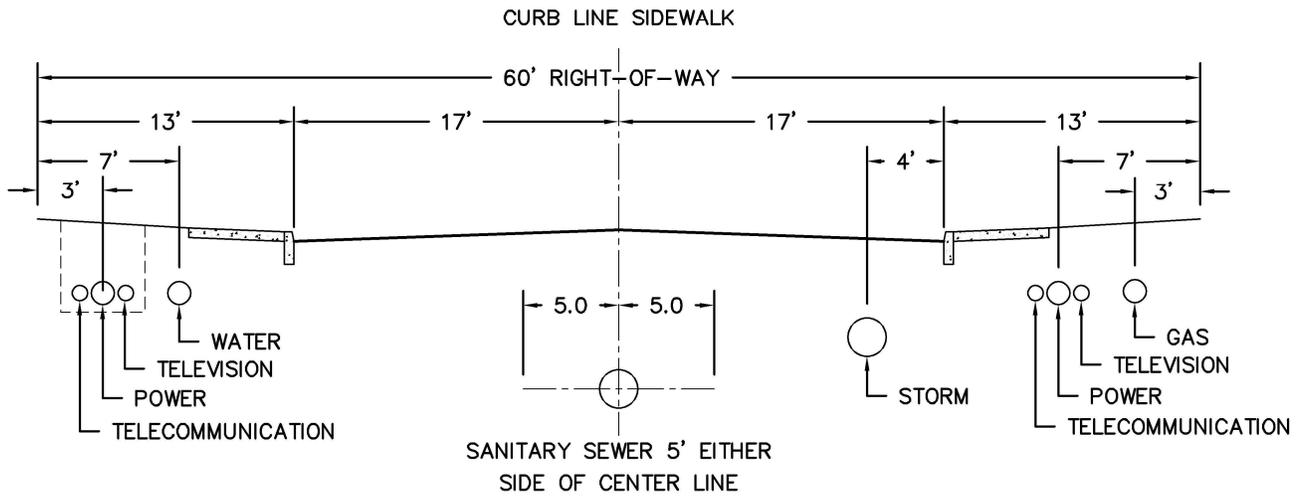

**NOTES:**

1. TELECOMMUNICATIONS AND POWER SHALL BE PLACED ON THE SOUTH OR WEST SIDE OF THE ROAD. GAS SHALL BE PLACED ON THE NORTH OR EAST SIDE OF THE ROAD.
2. UTILITY DEPTH SHALL BE AS SHOWN IN THE TABLE BELOW. DEPTH SHALL BE MEASURED FROM THE BOTTOM OF DITCH, IF PRESENT.

UTILITY UNDERGROUND DEPTH (SEE NOTE 2)	
TYPE	DEPTH
POWER	36"
GAS (SEE NOTE 7)	36"
TELECOMMUNICATION	30"
TELEVISION	30"
WATER	30"
STORM	30"
SANITARY SEWER	SEE NOTE 3

3. SEWER DEPTH SHALL COMPLY WITH LOCAL JURISDICTION REQUIREMENTS.
4. FOR NATURAL GAS RELINING, 30" DEPTH MAY BE ALLOWED IF SHOWN ON PROJECT PLANS.

Standard Drawing 2


MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**STANDARD UTILITY  
LOCATION FOR URBAN  
STREETS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 10/26/1993	REVISION DATE: 02/16/2023	SCALE: N.T.S	SHEET: 1 of 1
------------------------------	------------------------------	-----------------	------------------

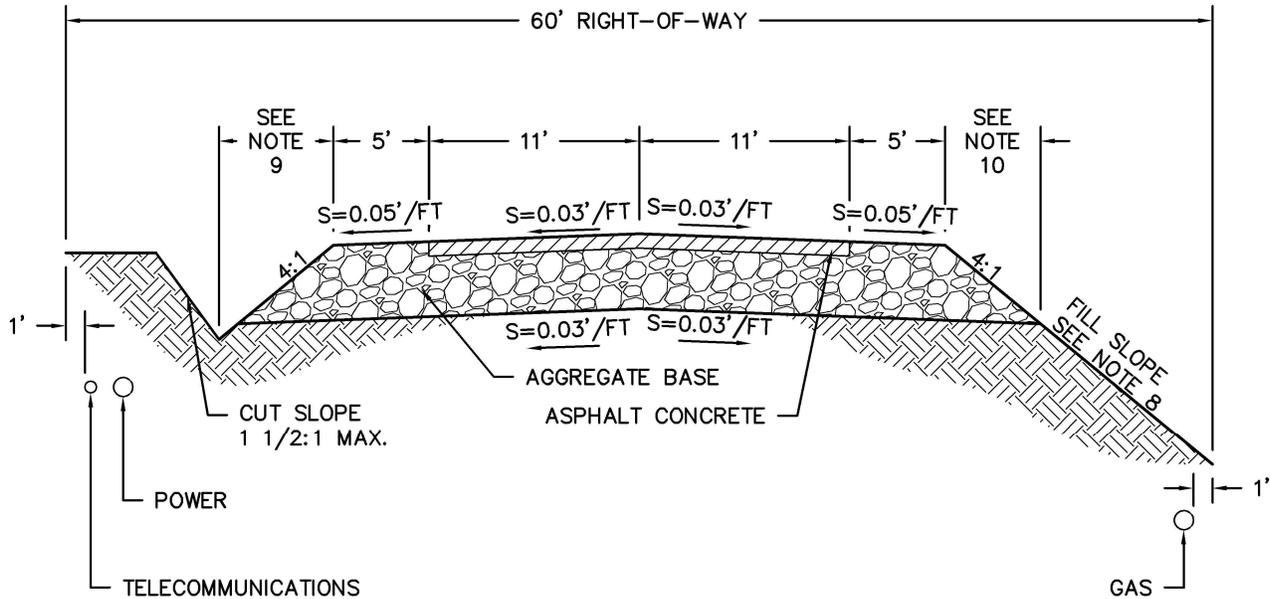

**NOTES:**

1. ASPHALT CONCRETE AND AGGREGATE BASE SHALL CONFORM TO MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARDS, UNLESS OTHERWISE REQUIRED BY COUNTY ENGINEER.
2. UTILITIES MAY BE PLACED IN SHOULDER AREA IF CUT OR FILL SLOPES EXTEND OUTSIDE OF RIGHT-OF-WAY.
3. IN NEW SUBDIVISIONS, TELECOMMUNICATIONS AND POWER SHALL BE PLACED ON THE SOUTH OR WEST SIDE OF THE ROAD. GAS SHALL BE PLACED ON THE NORTH OR EAST SIDE OF THE ROAD, UNLESS OTHERWISE APPROVED BY COUNTY ENGINEER.
4. MEASURING FROM THE TOP OF THE UTILITY, MINIMUM DEPTH SHALL BE AS SHOWN IN THE TABLE BELOW. DEPTH SHALL BE MEASURED FROM THE BOTTOM OF DITCH, IF PRESENT.

UTILITY TYPE	DEPTH
POWER	36"
GAS	36" (SEE NOTE 7)
TELECOMMUNICATION	30"
WATER	30"
STORM	30"
SANITARY SEWER	SEE NOTE 6

5. 50' RIGHT-OF-WAY WIDTH IS PERMITTED ON CUL-DE-SACS LESS THAN 500' LONG.
6. SANITARY SEWER DEPTH SHALL COMPLY WITH LOCAL JURISDICTION REQUIREMENTS.
7. FOR NATURAL GAS RELINING, 30" DEPTH MAY BE ALLOWED IF SHOWN AND APPROVED ON PROJECT PLANS.
8. FILL SLOPE SHALL BE 4:1 MAX. AND 2:1 MAX. WITH GUARDRAIL.
9. LOCAL ROADS SHALL HAVE A 6' FORE SLOPE AND COLLECTOR ROADS SHALL HAVE A 7' FORE SLOPE.
10. LOCAL ROADS SHALL HAVE A 4' FORE SLOPE AND COLLECTOR ROADS SHALL HAVE A 5' FORE SLOPE.

Standard Drawing 3

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**TYPICAL 22' WIDE TURNPIKE SECTION AND UTILITY LOCATION FOR RURAL, LOCAL AND COLLECTOR ROADS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 09/16/1981	REVISION DATE: 01/17/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\TYPICAL 28' WIDE TURNPIKE SECTION.DWG PLOTTED: 2023/01/17 8:56 AM

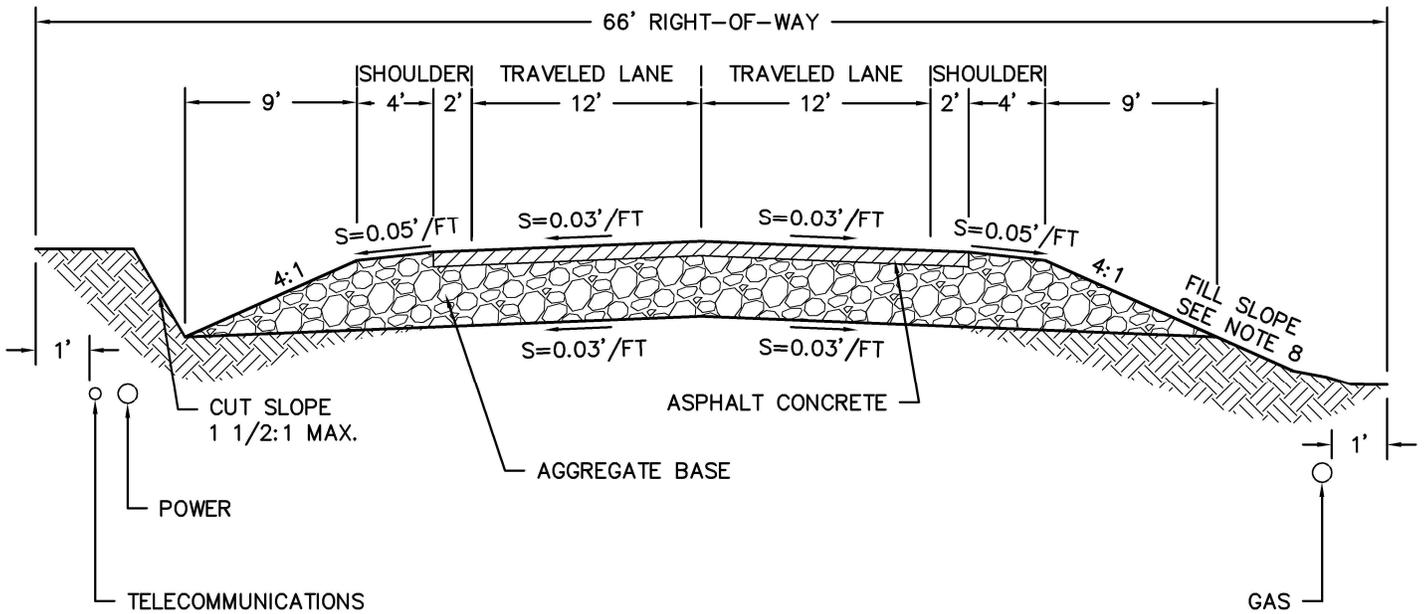

**NOTES:**

1. ASPHALT CONCRETE AND AGGREGATE BASE SHALL CONFORM TO MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARDS, UNLESS OTHERWISE REQUIRED BY COUNTY ENGINEER.
2. UTILITIES MAY BE PLACED IN SHOULDER AREA IF CUT OR FILL SLOPES EXTEND OUTSIDE OF RIGHT-OF-WAY
3. IN NEW SUBDIVISIONS, TELECOMMUNICATIONS AND POWER SHALL BE PLACED ON THE SOUTH OR WEST SIDE OF THE ROAD. GAS SHALL BE PLACED ON THE NORTH OR EAST SIDE OF THE ROAD, UNLESS OTHERWISE APPROVED BY COUNTY ENGINEER.
4. MINIMUM UTILITY DEPTH SHALL BE AS SHOWN IN THE TABLE BELOW. DEPTH SHALL BE MEASURED FROM THE BOTTOM OF DITCH, IF PRESENT.

UTILITY TYPE	DEPTH
POWER	36"
GAS	36" (SEE NOTE 7)
TELECOMMUNICATION	30"
WATER	30"
STORM	30"
SANITARY SEWER	SEE NOTE 6

5. SEWER DEPTH SHALL COMPLY WITH LOCAL JURISDICTION REQUIREMENTS.
6. FOR NATURAL GAS RELINING, 30" DEPTH MAY BE ALLOWED IF SHOWN AND APPROVED ON PROJECT PLANS.
7. FILL SLOPE SHALL BE 4:1 MAX. AND 2:1 MAX. WITH GUARDRAIL.

Standard Drawing 4

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**TYPICAL 28' WIDE TURNPIKE SECTION AND UTILITY LOCATION FOR RURAL ARTERIAL ROADS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 01/09/1985	REVISION DATE: 01/17/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\TYPICAL GRAVEL SECTION FOR PRIVATELY MAINTAINED RURAL ROADS.DWG PLOTTED: 2023/01/23 12:13 PM

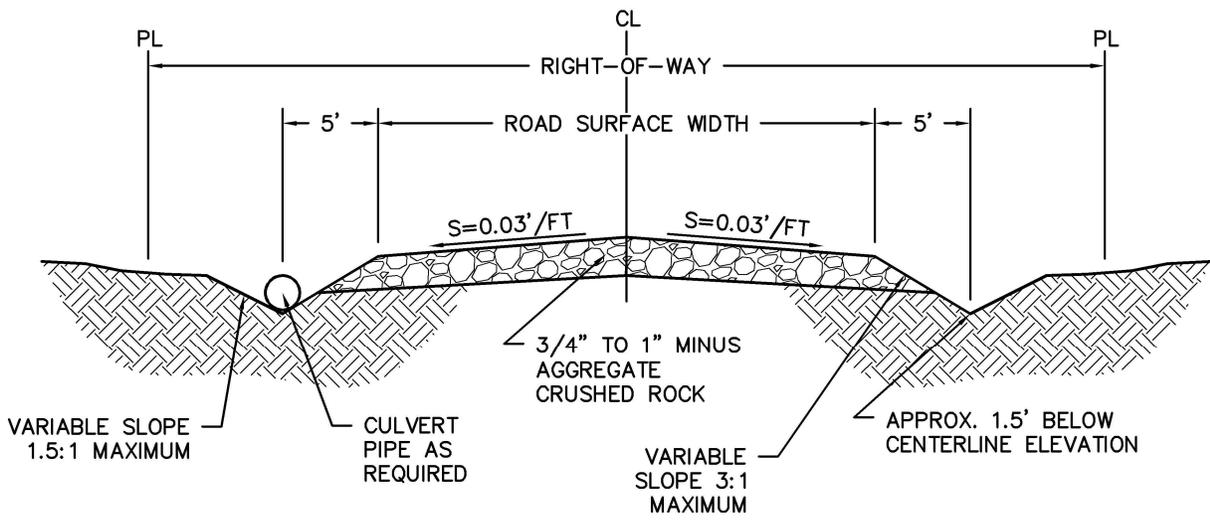

**NOTES:**

1. SURFACE WIDTH AND CRUSHED ROCK SHALL CONFORM TO THE FOLLOWING:

NUMBER OF DWELLINGS SERVED	SURFACE WIDTH (FEET)	3/4" TO 1" MINUS AGGREGATE CRUSHED ROCK THICKNESS (INCHES)
1	10'	6"
2 OR MORE	16'	8"

2. UTILITIES SHALL BE LOCATED AS SHOWN ON ENGINEERING STANDARD DETAIL 'TYPICAL 22' WIDE TURNPIKE SECTION AND UTILITY LOCATION FOR RURAL, LOCAL, AND COLLECTOR ROADS'.

Standard Drawing 5

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**TYPICAL GRAVEL SECTION FOR PRIVATELY MAINTAINED RURAL ROADS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 12/15/2009	REVISION DATE: 01/23/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\TYPICAL CROSS SECTION FOR PAVING GRAVEL ROADS.DWG PLOTTED: 2023/01/23 2:47 PM

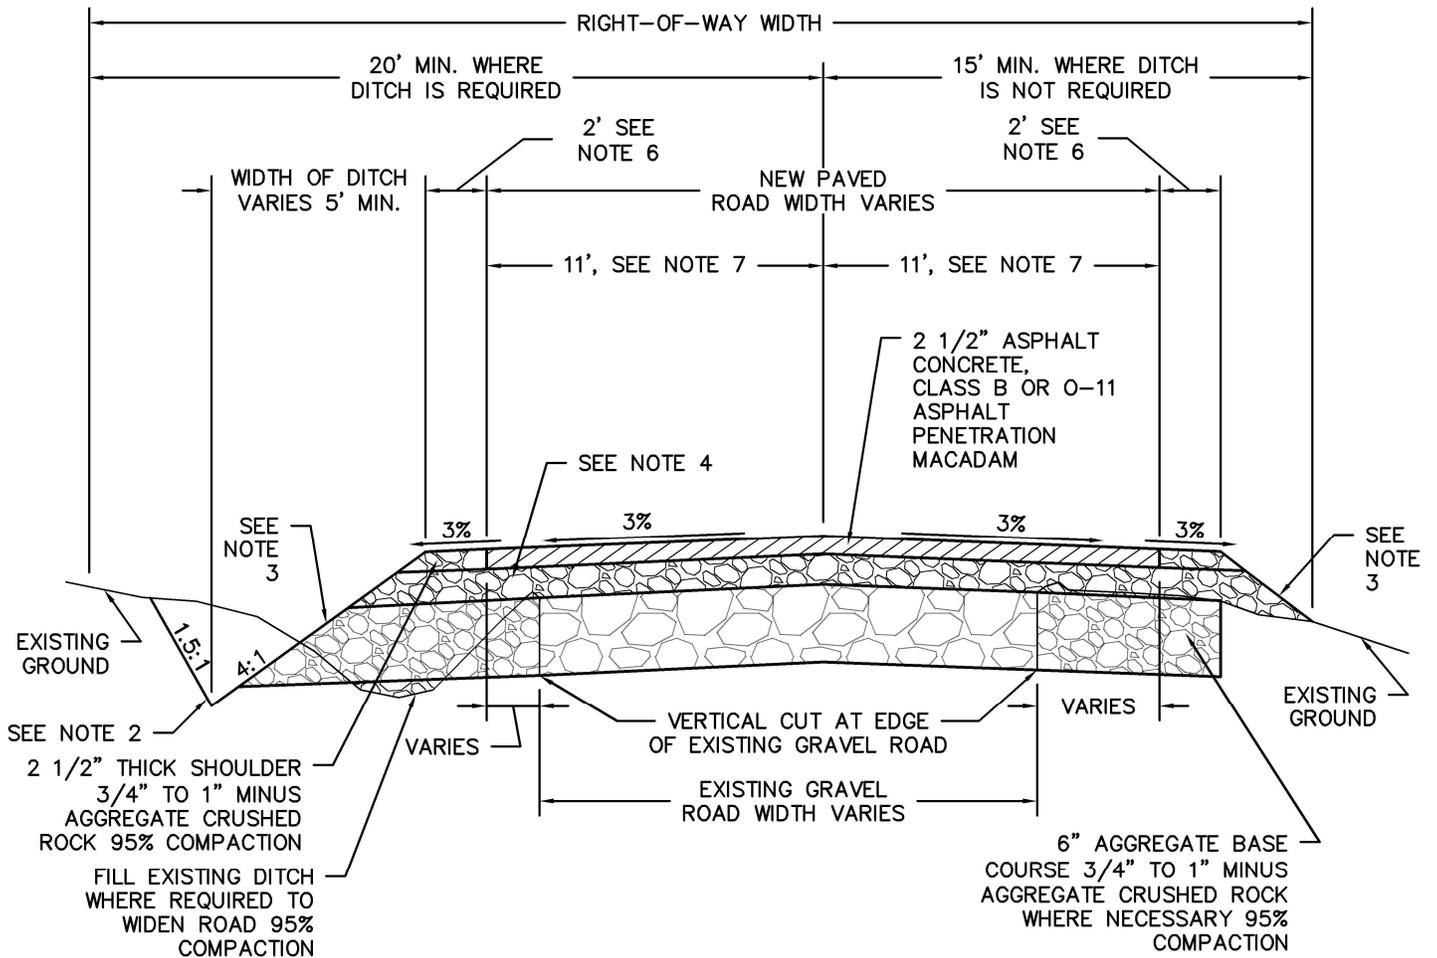

**NOTES:**

1. DISPOSE OF EXCAVATED MATERIAL OFF-SITE.
2. EXCAVATE DITCH WHERE REQUIRED TO PROVIDE DRAINAGE, SHALL BE SHOWN ON PROJECT PLANS.
3. TAPER SHOULDER TO MATCH EXISTING GROUND WHERE NO DITCH IS REQUIRED, SHALL BE SHOWN ON PROJECT PLANS.
4. 3" MINIMUM LEVELING COURSE 3/4" TO 1" MINUS AGGREGATE CRUSHED ROCK 95% COMPACTION. AGGREGATE LEVELING COURSE PLUS EXISTING GRAVEL SHALL EQUAL A THICKNESS OF 9".
5. 3:1 WHERE RIGHT-OF-WAY WIDTH IS LESS THAN 50'.
6. 1' WHERE RIGHT-OF-WAY WIDTH IS LESS THAN 40'.
7. 10' WHERE RIGHT-OF-WAY WIDTH IS LESS THAN 50'.

Standard Drawing 6A

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**TYPICAL CROSS SECTION FOR PAVING GRAVEL ROADS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 01/31/1989	REVISION DATE: 01/23/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\STANDARD DETAILS\TYPICAL ASPHALT PENETRATION MACADAM (0-11) SURFACING DETAILS.DWG PLOTTED: 2023/01/27 3:08 PM

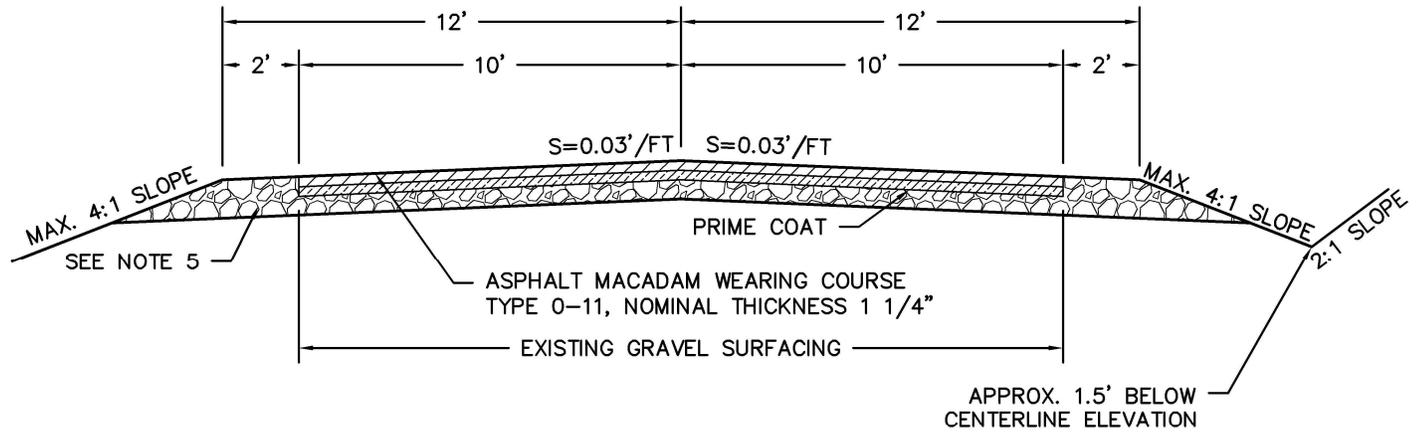

	ASPHALT		AGGREGATE	
	TYPE	GALLONS/SQUARE YARD	GRAVEL	CUBIC YARDS/SQUARE YARD*
PRIME COAT	MC-250	0.55	3/4" MINUS	0.019
1ST SPREAD	CRS-2	0.45	1 1/4"-3/4"	0.019
2ND SPREAD	CRS-2	0.55	3/4"-1/2"	0.019
3RD SPREAD	CRS-2	0.55	1/2"-1/4"	0.014
SEAL COAT	CRS-2	0.45	1/4"-#10 SCREENED	0.009

\*MEASURED IN TRUCK

NOTES:

1. THE MINIMUM THICKNESS OF THE AGGREGATE LEVELING COURSE MAY HAVE TO BE INCREASED, DEPENDING ON THE THICKNESS AND CONDITION OF THE EXISTING GRAVEL SURFACE.
2. CONSTRUCTION OF DRAINAGE CULVERTS, ROADSIDE DITCHES AND/OR ELEVATION OF ROADWAY MAY BE REQUIRED.
3. WHERE THE MACADAM PAVEMENT IS WIDER THAN THE EXISTING GRAVEL SURFACE, THE AGGREGATE LEVELING COURSE SHALL HAVE A MINIMUM THICKNESS OF 6".
4. THE CATIONIC EMULSION ASPHALT SHALL MEET THE SPECIFICATIONS OF AASHTO M208-72 OR ASTM D2397-73. AGGREGATES SHALL BE IN DESIGNATED SIZES AND SHALL CONFORM TO THE MOST RECENT OREGON DEPARTMENT OF TRANSPORTATION STANDARDS.
5. AGGREGATE LEVELING COURSE MIN. COMPACTION THICKNESS IS 1 1/2" UNDER ASPHALT MACADAM AND 2 3/4" MAX. ON SHOULDER.

Standard Drawing 6B

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




TYPICAL ASPHALT PENETRATION MACADAM (0-11) SURFACING DETAILS

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	


CREATION DATE: 02/11/1986	REVISION DATE: 01/06/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\PAVEMENT DETAILS\PAVEMENT PATCHING.DWG PLOTTED: 2023/01/25 4:38 PM

TYPICAL PATCH FOR FLEXIBLE PAVEMENT

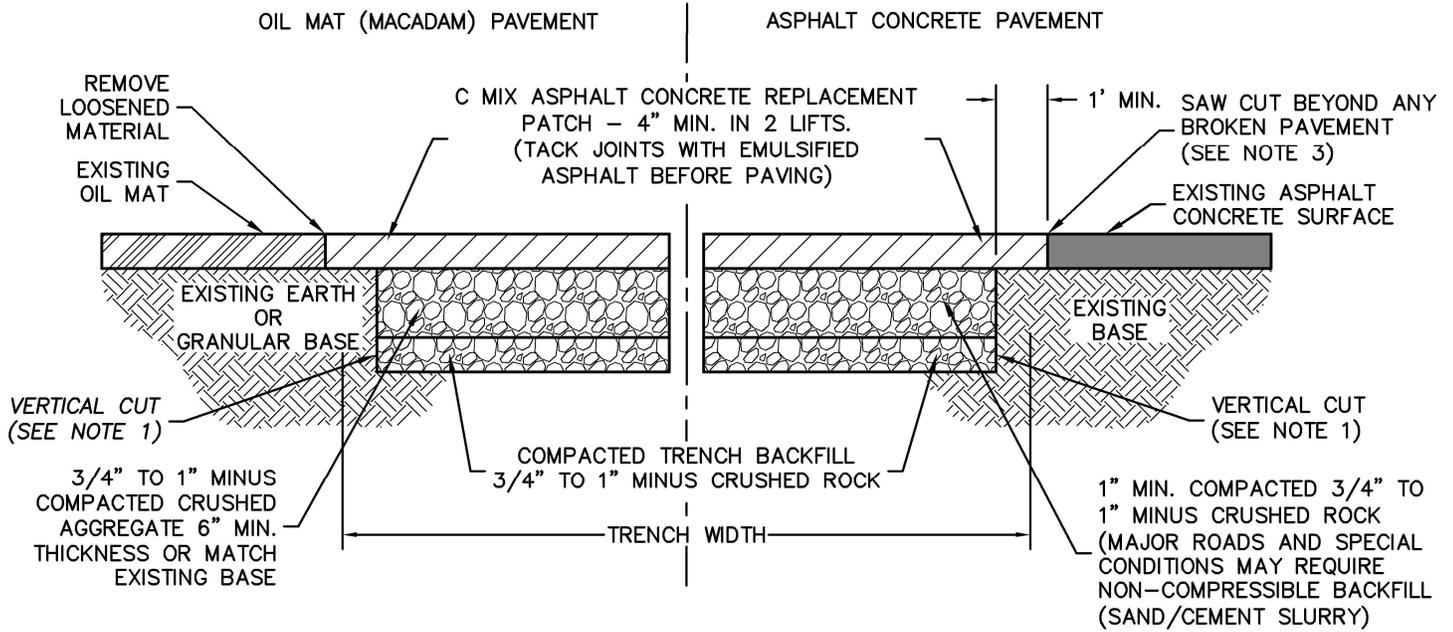

TYPICAL PATCH FOR RIGID PAVEMENT

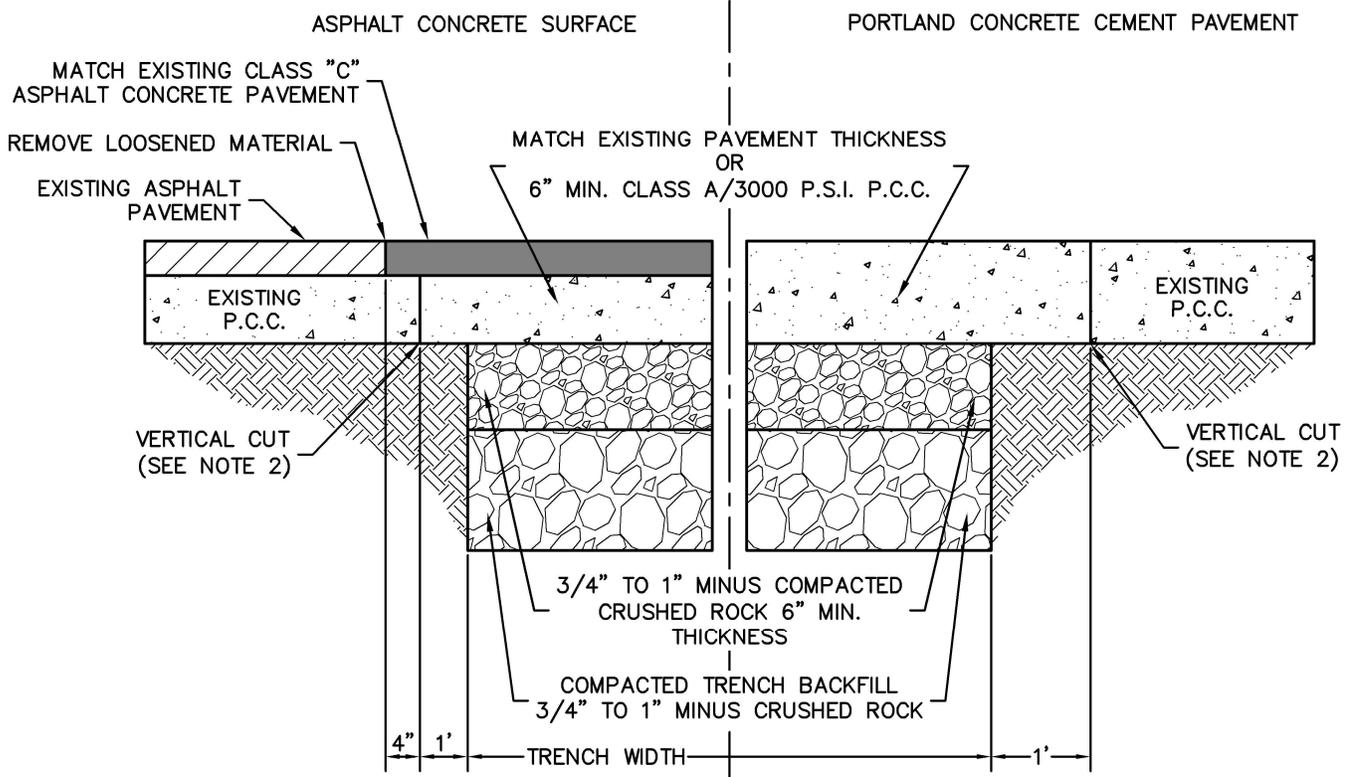

NOTES:

1. CUTS IN ASPHALT CONCRETE PAVEMENT SHALL BE MADE WITH HYDRAULICALLY-OPERATED SPADE-TIPPED PAVEMENT BREAKER, CUTTING WHEEL, CONCRETE SAW, OR OTHER APPROVED METHOD. INTERMITTENT PUNCHING WITH A POINTED JACK HAMMER BIT WILL NOT BE PERMITTED.
2. CUTS IN PORTLAND CONCRETE CEMENT PAVEMENT SHALL BE MADE WITH A CONCRETE SAW.
3. SAND AND SEAL 4" BAND OVER JOINT WITH AR4000 OR EQUIVALENT.

Standard Drawing 7


MARION COUNTY DEPARTMENT OF PUBLIC WORKS



PAVEMENT PATCHING

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 10/28/1993	REVISION DATE: 01/25/2023	SCALE: N.T.S.	SHEET: 1 OF 1
------------------------------	------------------------------	------------------	------------------

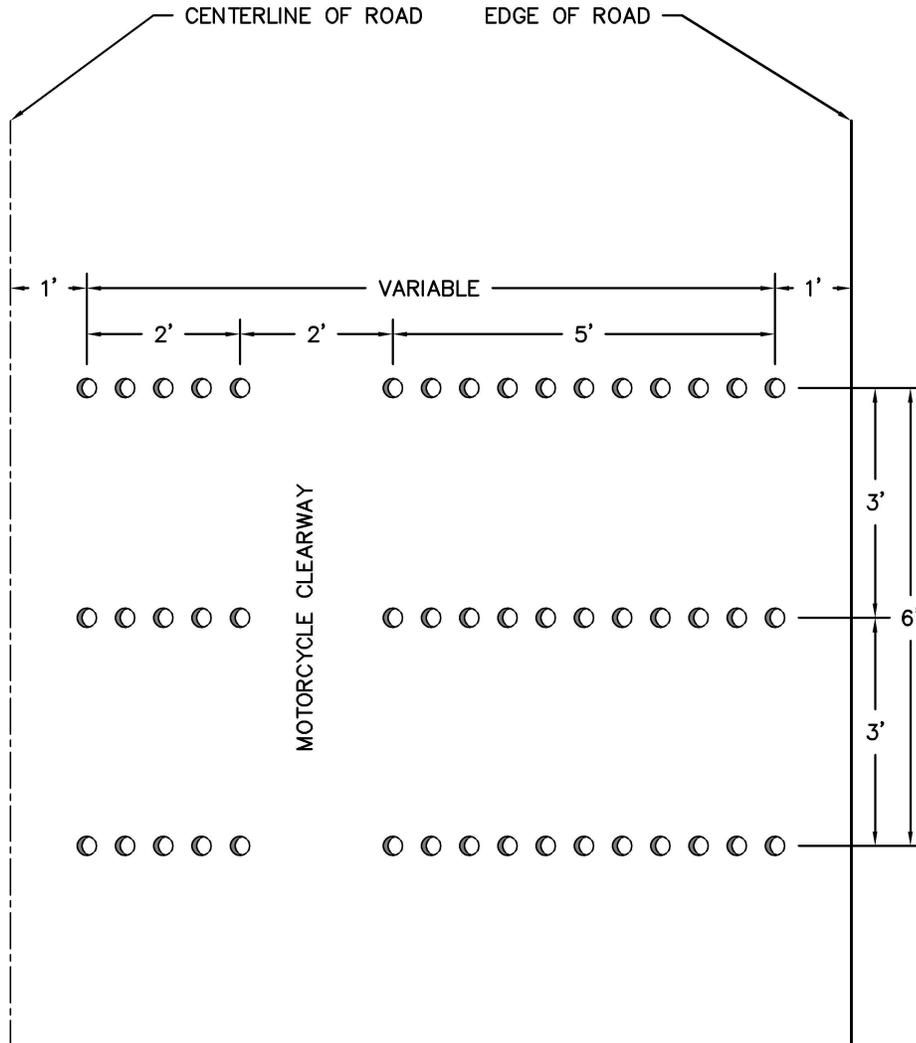

- NOTES:  
 1. DIMENSIONS SHOWN ARE TYPICAL. THEY SHALL BE VARIED AS NECESSARY TO CONFORM TO PAVEMENT WIDTH

Standard Drawing 8

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




RUMBLE STRIPS

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 10/28/1993	REVISION DATE: 01/27/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\PERMANENT BARRICADE UNIT.DWG PLOTTED: 2023/01/27 4:00 PM

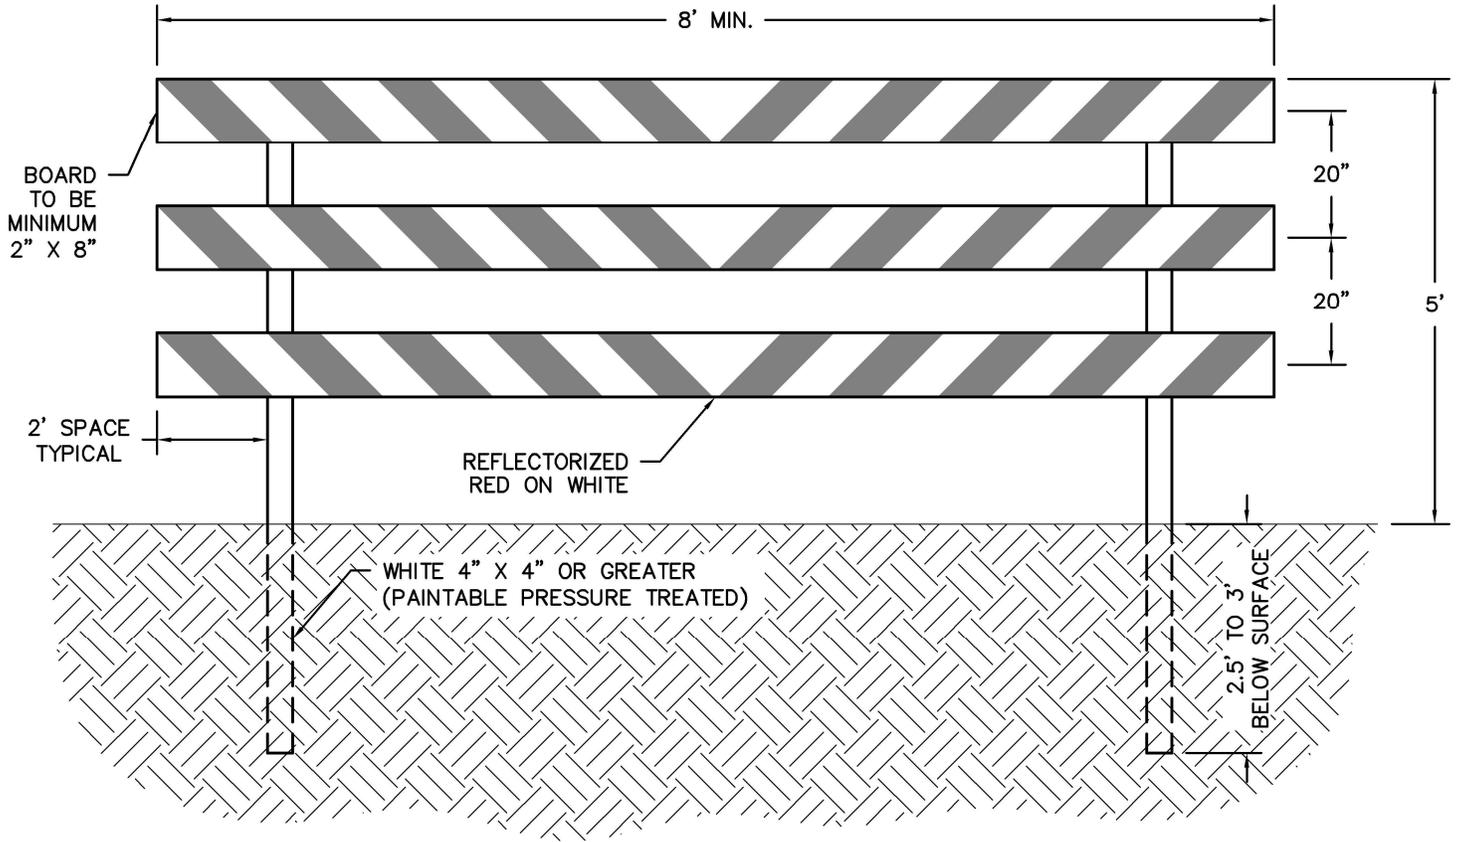

- NOTES:**
- REFLECTORIZED SHEETING SHALL BE ENGINEERING GRADE AND CONFORM TO THE FEDERAL HIGHWAY ADMINISTRATIONS 'MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES'.

Standard Drawing 9

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**PERMANENT  
BARRICADE UNIT**


REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 10/28/1993	REVISION DATE: 01/27/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------


2 LANE  
ONE-WAY OR TWO-WAY

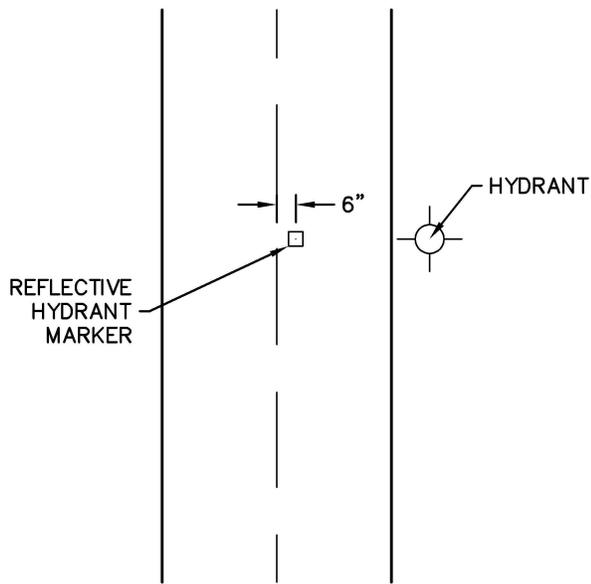


2 LANE TWO-WAY  
CONTINUOUS LEFT TURN LANE

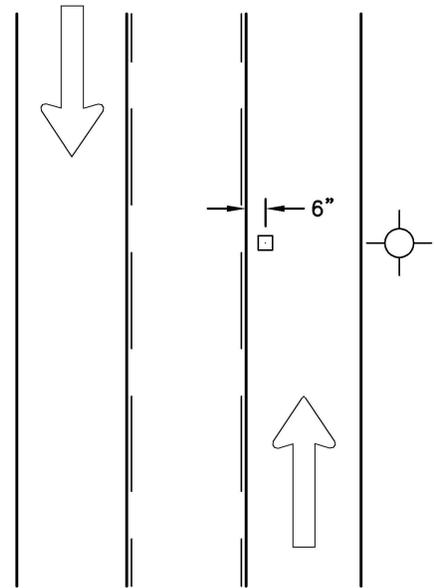

4 LANE TWO-WAY  
UNDIVIDED

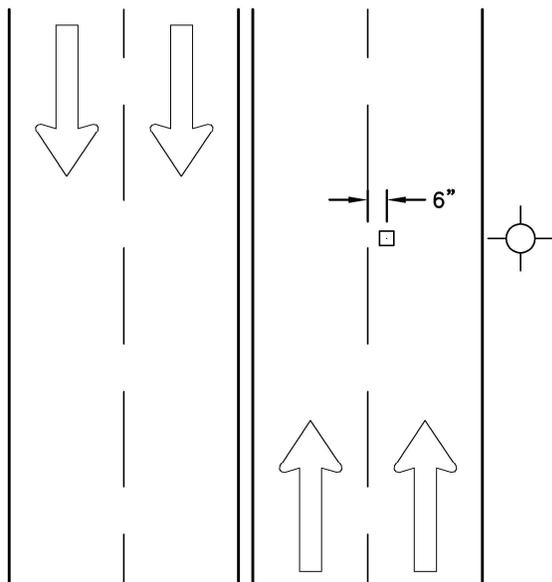

4 LANE TWO-WAY  
CONTINUOUS LEFT TURN LANE

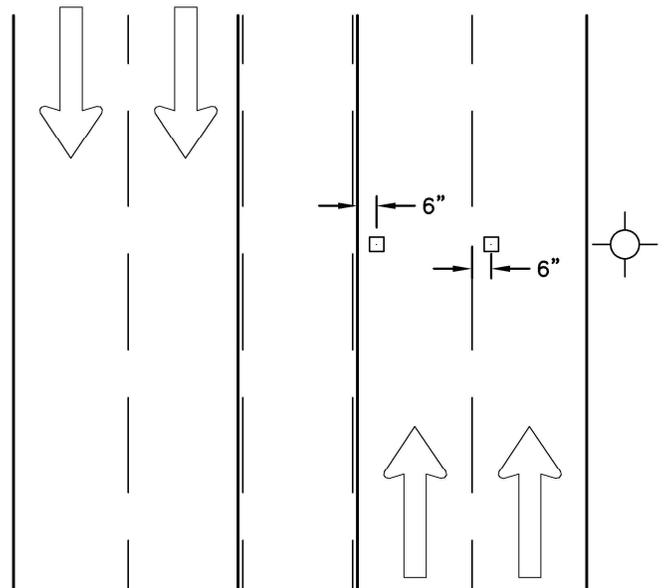

NOTES:

1. FIRE HYDRANT LOCATIONS SHALL BE INSTALLED IN ACCORDANCE WITH THE MOST RECENT VERSION OF MARION COUNTY FIRE CODE.

Standard Drawing 10

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



AUTHORIZED HYDRANT  
MARKER INSTALLATION  
LOCATIONS


REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
08/12/22	ADDED MC FIRE CODE NOTE	HS

CREATION DATE: 11/19/1993	REVISION DATE: 01/27/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------


DRIVEWAYS WITH CURB LINE SIDEWALK

← SLOPE 1.5% MAX.  
(MAX. 2.0% FINISHED)

← SLOPE 7.5% MAX.  
(MAX. 8.3% FINISHED)

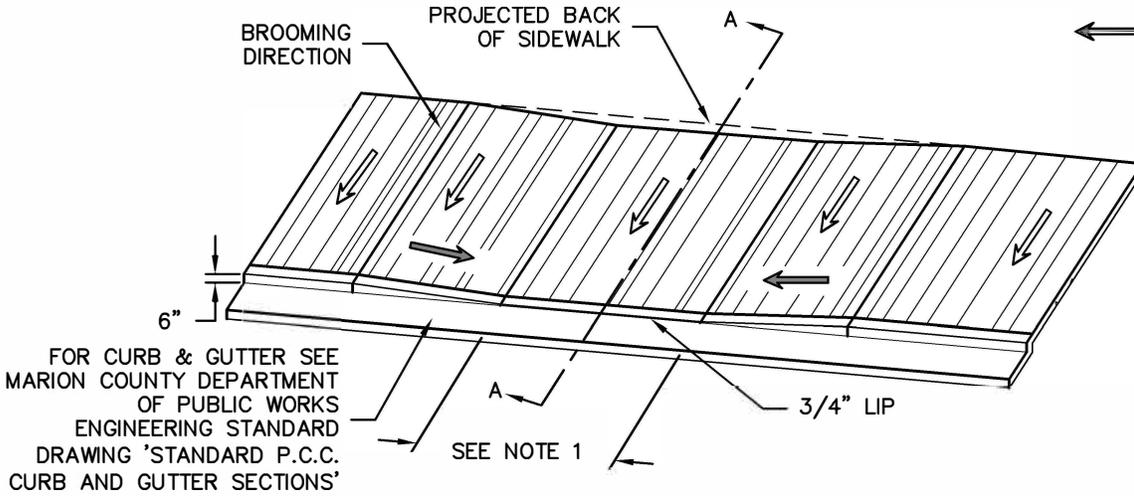

SECTION A-A

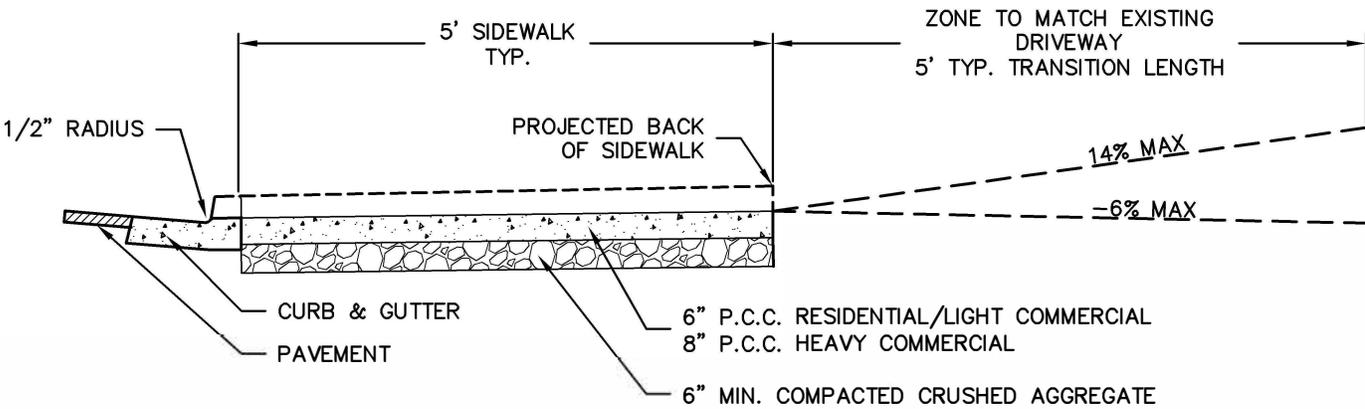

- NOTES:
1. DRIVEWAY WIDTH TYPICALLY SHOWN ON PROJECT PLANS. WHEN NOT SPECIFIED, WIDTH SHALL BE AS DIRECTED BY THE COUNTY ENGINEER. IN EITHER CASE, DRIVEWAY WIDTH SHALL NOT EXCEED THE LIMITS SET FORTH IN MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARDS TABLE 6.
  2. SIDEWALKS, INCLUDING PORTION CROSSING DRIVEWAY, SHALL HAVE TRANSVERSE CONTRACTION JOINTS AT 5' INTERVALS AND TOOL ROUNDED BEFORE BROOMING. ALL EDGES SHALL BE TOOL ROUNDED AFTER BROOMING.
  3. WHEN EXISTING DRIVEWAY CANNOT MATCH NEW DRIVEWAY WITHIN SLOPE LIMITATIONS SHOWN, ADJUST EXISTING DRIVEWAY, NOT CURB AND SIDEWALK GRADE.
  4. DRIVEWAY APPROACH DIMENSIONS SHALL NOT BE ADJUSTED WITHOUT SPECIFIC PRIOR (BEFORE FORMING) INSPECTOR APPROVAL.
  5. CONCRETE STRENGTH SHALL BE 3000 P.S.I. IN 28 DAYS. NO COLOR ADDITIVES SHALL BE USED.
  6. 2% MAX. SIDEWALK CROSS SLOPE IS MEASURED FROM BACK OF WALK TO FACE OF CURB. 8.33% MAX. SIDEWALK TRANSITION CROSS SLOPE IS RELATIVE TO RUNNING SLOPE OF SIDEWALK.
  7. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DRAWING 'STANDARD SIDEWALK DETAILS' FOR ADDITIONAL RESTRICTIONS AND SPECIFICATIONS NOT SHOWN.

Standard Drawing 11A

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



TYPE 1 DRIVEWAY  
APPROACH CURB  
LINE SIDEWALK

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	


CREATION DATE: 03/01/2016	REVISION DATE: 07/24/2023	SCALE: N.T.S	SHEET: 1 of 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\TYPE 2 DRIVEWAY APPROACH CURB LINE SIDEWALK.DWG PLCTED: 2023/01/26 10:56 AM

DRIVEWAYS WITH CURB LINE SIDEWALK


← SLOPE 1.5% MAX.  
(MAX. 2.0% FINISHED)

← SLOPE 7.5% MAX.  
(MAX. 8.3% FINISHED)

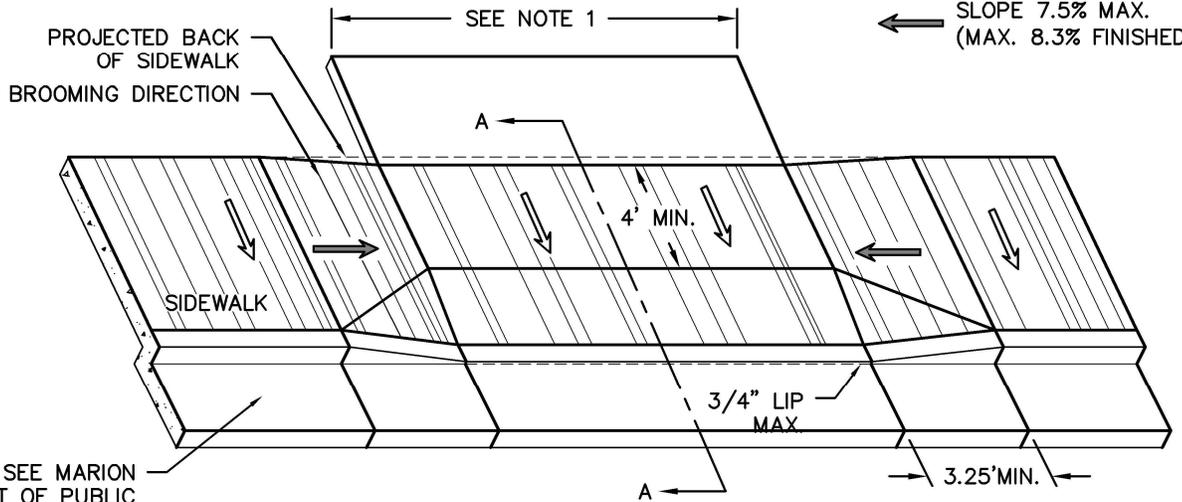

FOR CURB AND GUTTER SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DRAWING 'STANDARD P.C.C. CURB AND GUTTER SECTIONS'

SECTION A-A

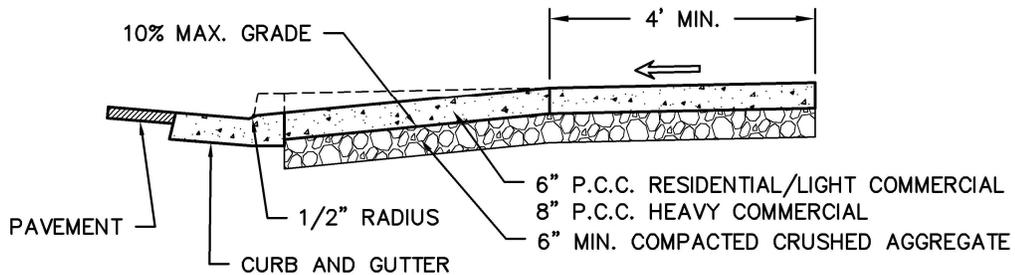

- NOTES:
1. DRIVEWAY WIDTH NORMALLY SHOWN ON PROJECT PLANS. WHEN NOT SHOWN, WIDTH SHALL BE AS DIRECTED BY THE COUNTY ENGINEER. IN EITHER CASE, DRIVEWAY WIDTH SHALL NOT EXCEED THE LIMITS SET FORTH IN MARION COUNTY ENGINEERING STANDARDS TABLE 6.
  2. SIDEWALKS, INCLUDING THE PORTION CROSSING A DRIVEWAY, SHALL HAVE TRANSVERSE CONTRACTION JOINTS AT 5' INTERVALS AND TOOL ROUNDED BEFORE BROOMING. ALL EDGES SHALL BE TOOL ROUNDED AFTER BROOMING.
  3. WHEN EXISTING DRIVEWAY CANNOT MATCH NEW DRIVEWAY WITHIN SLOPE LIMITATIONS SHOWN, ADJUST EXISTING DRIVEWAY, NOT CURB AND SIDEWALK GRADE.
  4. DRIVEWAY APPROACH DIMENSIONS SHALL NOT BE ADJUSTED WITHOUT SPECIFIC PRIOR (BEFORE FORMING) COUNTY INSPECTOR APPROVAL.
  5. CONCRETE STRENGTH SHALL BE 3000 P.S.I. IN 28 DAYS. NO COLOR ADDITIVES SHALL BE USED.
  6. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DRAWING 'STANDARD SIDEWALK DETAILS' FOR ADDITIONAL RESTRICTIONS AND SPECIFICATIONS NOT SHOWN.
  7. COMMERCIAL DRIVEWAYS ARE REQUIRED TO OBTAIN COUNTY ENGINEER APPROVAL FOR THIS TYPE OF APPROACH.

Standard Drawing 11B

MARION COUNTY DEPARTMENT OF PUBLIC WORKS





TYPE 2 DRIVEWAY  
APPROACH CURB  
LINE SIDEWALK

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
03/01/16	NOTE WAS LISTED AS 3300 PSI	DC
03/01/16	EXPANSION JOINTS REMOVED	RP
03/01/16	LIP CHANGED TO 3/4"	RP
01/26/23	CHANGE TO CLEAR WIDTH TO 4' AND DIMENSION CHANGES	HS

CREATION DATE: 03/01/2016	REVISION DATE: 01/26/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\DRIVEWAY APPROACH PROPERTY LINE SIDEWALK.DWG PLOTTED: 2023/01/25 4:24 PM

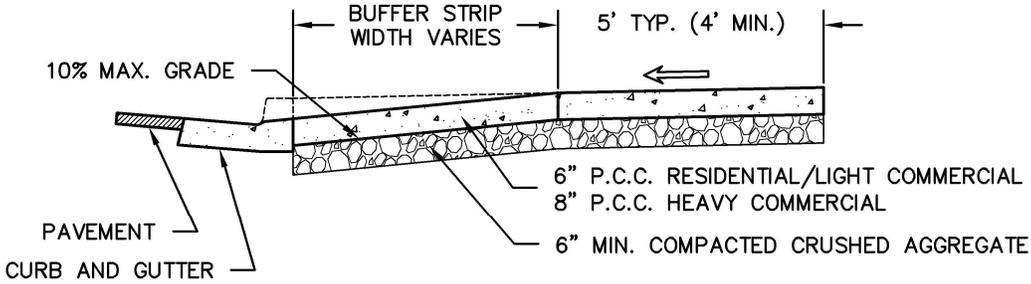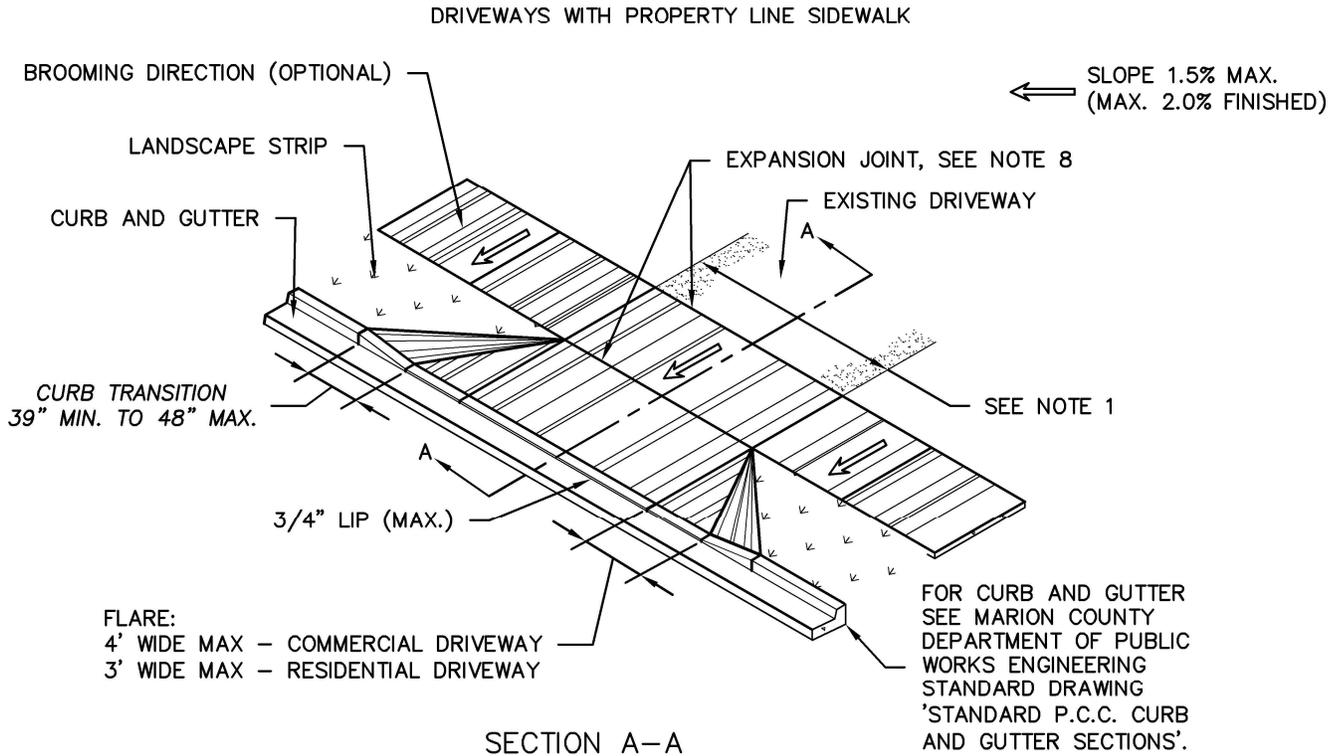

**NOTES:**

1. DRIVEWAY WIDTH TYPICALLY SHOWN ON PROJECT PLANS. WHEN NOT SPECIFIED, WIDTH SHALL BE AS DIRECTED BY THE COUNTY ENGINEER. IN EITHER CASE, DRIVEWAY WIDTH SHALL NOT EXCEED LIMITS SET FORTH IN MARION COUNTY, ENGINEERING STANDARDS TABLE 6.
2. SIDEWALKS, INCLUDING PORTION CROSSING DRIVEWAY, SHALL HAVE TRANSVERSE CONTRACTION JOINTS AT 5' INTERVALS AND TOOL ROUNDED BEFORE BROOMING. ALL EDGES SHALL BE TOOL ROUNDED AFTER BROOMING.
3. WHEN EXISTING DRIVEWAY CANNOT MATCH NEW DRIVEWAY WITHIN SLOPE LIMITATIONS SHOWN, ADJUST EXISTING DRIVEWAY, NOT CURB AND SIDEWALK GRADE.
4. DRIVEWAY APPROACH DIMENSIONS SHALL NOT BE ADJUSTED WITHOUT SPECIFIC PRIOR (BEFORE FORMING) INSPECTOR APPROVAL.
5. CONCRETE STRENGTH SHALL BE 3000 P.S.I. IN 28 DAYS. NO COLOR ADDITIVES SHALL BE USED.
6. 2% MAX. CROSS SLOPE OF SIDEWALK IS MEASURED FROM BACK OF WALK TO FACE OF CURB. 8.33% MAX. SLOPE OF SIDEWALK TRANSITION TO DRIVEWAY IS RELATIVE TO RUNNING SLOPE OF SIDEWALK.
7. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DRAWING 'STANDARD SIDEWALK DETAILS' FOR ADDITIONAL RESTRICTIONS AND SPECIFICATIONS NOT SHOWN.
8. EXPANSION JOINTS 1/2" x 3-1/2" PREMOLDED JOINT MATERIAL AT LOCATIONS SHOWN.

Standard Drawing 11C


MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**DRIVEWAY APPROACH  
PROPERTY LINE SIDEWALK**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 01/18/2013	REVISION DATE: 01/25/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

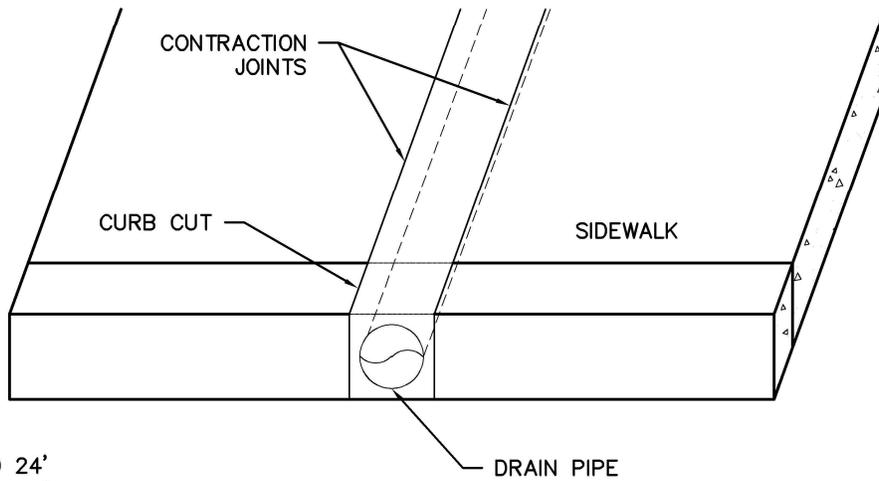

**NOTES:**

1. APPROACH WIDTH (W):
  - 1.1. RESIDENTIAL 12" TO 24'
  - 1.2. COMMERCIAL 28' TO 40'
    - 1.2.1. FOR COMMERCIAL DRIVEWAYS, WIDTH SHALL BE SET BY COUNTY ENGINEER ON A SITE SPECIFIC BASIS.
2. FLARE:
  - 2.1. 36" FOR COMMERCIAL AND INDUSTRIAL WHERE TRAVEL LANE IN STREET IS ADJACENT TO CURB. (I.E. PARKING PROHIBITED).
  - 2.2. NONE REQUIRED FOR RESIDENTIAL AND COMMERCIAL WHERE PARKING IS ALLOWED IN STREET ADJACENT TO CURB.
3. BROOMING DIRECTION:
  - 3.1. BACK OF WALK TO FACE OF CURB.
4. DEEP SCORING, SHINING & EXPANSION JOINTS:
  - 4.1. DEEP SCORED CONTRACTION JOINTS ARE TO BE MADE EVERY 5' OF SIDEWALK AND EVERY 15' OF CURB. WHEN CURB IS CUT TO ALLOW FOR A DRAIN LINE, A DEEP SCORE IS TO BE MADE AT BOTH CURB EDGES, NOT OVER PIPE. SEE NOTE 4.4.5. BELOW.
  - 4.2. DEEP SCORED CONTRACTION JOINTS ARE TO BE FORMED TO A DEPTH OF 1-1/4" x 1/4" IN WIDTH.
  - 4.3. EXPANSION JOINTS USING 1/2" X 3-1/2" PRE-MOLDED JOINT FILLER MATERIAL ARE REQUIRED AT:
    - 4.3.1. ALONG SIDEWALK AT DRIVEWAY - A PROPERTY LINE SIDEWALK WILL REQUIRE EXPANSION JOINTS ON BOTH SIDES OF SIDEWALK.
    - 4.3.2. ALONG SIDEWALK WHERE IT INTERSECTS ANOTHER SIDEWALK.
    - 4.3.3. AT EDGES OF UTILITY VAULTS OR OTHER STRUCTURES EXPOSED TO SIDEWALK.
    - 4.3.4. IN SIDEWALK TO ISOLATE A WHEELCHAIR RAMP.
    - 4.3.5. ON CURBSIDE SIDEWALKS PLACED AT 90° ACROSS THE SIDEWALK AT BEGINNING (TOP) OF CURB TRANSITION.
    - 4.3.6. NO RUNNING PIECE OF SIDEWALK SHALL BE MORE THAN 40' WITHOUT AN EXPANSION JOINT.
5. CONCRETE SPECIFICATIONS:
  - 5.1. A MINIMUM OF 3,000 PSI CONCRETE IN 28 DAYS SHALL BE USED FOR ALL CURBS, DRIVEWAY APPROACHES AND SIDEWALKS.
  - 5.2. CONCRETE SHALL BE AIR ENTRAINED; TOTAL AIR CONTENT (PERCENT BY VOLUME OF CONCRETE) SHALL BE BETWEEN 5% AND 7%.
6. CURB REMOVAL:
  - 6.1. WHEN FULL HEIGHT CURB SECTION IS REMOVED, THE FOLLOWING PROVISIONS SHALL APPLY:
    - 6.1.1. VERTICAL SAW CUTS SHALL BE MADE AT OUTSIDE EDGES OF CURB TRANSITIONS. THIS APPLIES TO BOTH TYPE A AND TYPE C CURBS. WHEN WEEP HOLES ARE TO BE INSTALLED, ADDITIONAL CURB WILL NEED TO BE REMOVED.
    - 6.1.2. FOR TYPE A CURB AND GUTTER, THE ENTIRE CURB AND GUTTER SHALL BE REMOVED AND RE-POURED. MATERIAL IN CURB AREA SHALL BE REMOVED TO SUBGRADE AND RE-POURED. PROVIDE 6" OF CONCRETE BELOW FLOW LINE IN CURB AREA.
    - 6.1.3. TYPE C CURB SHALL BE REMOVED TO FULL DEPTH AND RE-POURED. PROVIDE 10" OF CONCRETE BELOW ASPHALT IN CURB AREA.
7. DRAIN LINES:
  - 7.1. WEEP HOLES FOR DRAINS ARE TO EXIT IN A FULL HEIGHT CURB SECTION OUTSIDE CURB TRANSITION AREA OF DRIVEWAY. DRAIN LINES IN SIDEWALK ARE TO BE LOCATED UNDER OR ADJACENT TO A CONTRACTION JOINT. DRAIN LINES ARE TO CROSS SIDEWALKS AT 90° (PERPENDICULAR) TO CURB.
  - 7.2. WHERE CURB CUTS ARE MADE FOR CONSTRUCTION OF A DRIVEWAY APPROACH, ONE DRAIN LINE IS ALLOWABLE IN CURB TRANSITION AREA IF LINE IS PLACED DIRECTLY ADJACENT TO CURB CUT (HIGHEST POINT OF TRANSITION).
  - 7.3. DRAIN LINES ARE TO BE PLACED AT GUTTER FLOW LINE.
  - 7.4. DRAIN PIPE IS TO BE PLACED ADJACENT TO CURB CUT. A CONTRACTION JOINT IS TO BE SCORED ALONG BOTH CUTS.

Standard Drawing 11D

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**NOTES FOR  
URBAN STREETS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
01/18/13	NOTE 5 CHANGE TO 3000 PSI	DC
03/01/16	COMBINE SHEETS	RP

CREATION DATE: 01/18/2013	REVISION DATE: 01/27/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\STANDARD SIDEWALK DETAILS.DWG PLOTTED: 2023/01/24 1:50 PM

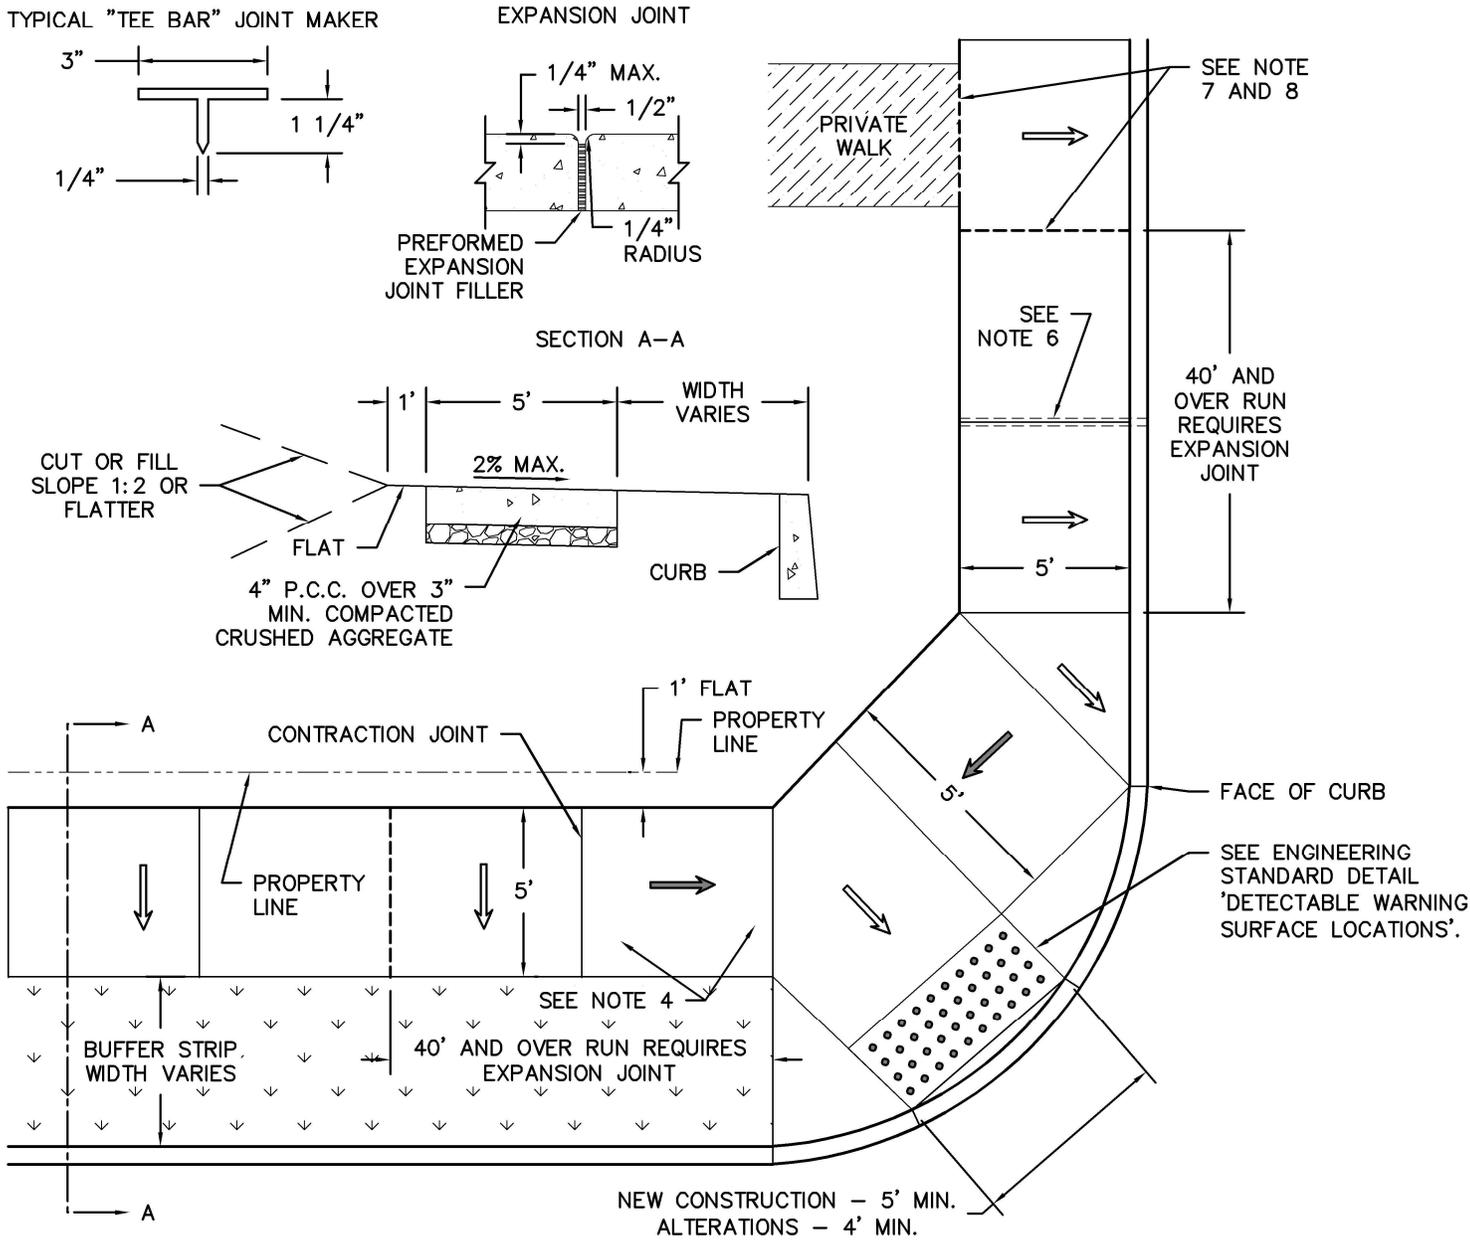

- NOTES:**
1. PREMOLDED JOINT FILLER MATERIAL SHALL BE PLACED ON ALL EDGES OF UTILITY VAULTS OR STRUCTURES EXPOSED TO SIDEWALK. MATERIAL SHALL BE RECESSED OR CUT TO WITHIN 1/2" OF FINISHED CONCRETE SURFACE.
  2. 3000 P.S.I. CONCRETE IN 28 DAYS TO BE USED ON SIDEWALKS. NO COLOR ADDITIVES ARE ALLOWED.
  3. PAVEMENT, TURF OR PLANTED AREAS DISTURBED BY SIDEWALK CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER.
  4. TRANSITION SLOPE TO SIDEWALK (8.33% MAX LONGITUDINAL SLOPE, BUT NOT EXCEEDING 12' TOTAL LENGTH).
  5. CONTRACTION JOINTS SHALL BE 1-1/4" x 1/4" WIDE, SPACED 5' ON CENTER.
  6. INSTALL 3" ROOF DRAINS UNDER SIDEWALK TO MEET EXISTING WEEP HOLES IN CURB. PROVIDE CONTRACTION JOINT OVER OR ADJACENT TO DRAIN PIPE. WHERE NO WEEP HOLES EXIST, INSTALL WEEP HOLES AND DRAINS AS DIRECTED BY COUNTY ENGINEER.
  7. EXPANSION JOINTS 1/2" x 3-1/2" PREMOLDED JOINT FILLER MATERIAL, SPACED 40' ON CENTER.
  8. PLACE EXPANSION JOINTS AT ADJACENT CONCRETE STRUCTURES, IN LONG RUNS OF WALK OVER 40', AND AT SIDEWALK RAMPS.

Standard Drawing 11E (previously 15)

- ← SLOPE 1.5% MAX. (MAX. 2.0% FINISHED)
- ← SLOPE 7.5% MAX. (MAX. 8.3% FINISHED)
- DETECTABLE WARNING SURFACE

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
04/06/17	SLOPE RANGE ADJUSTMENT	RP

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**STANDARD SIDEWALK DETAILS**

CREATION DATE: 02/02/1985	REVISION DATE: 01/24/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------



FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING - STANDARD DETAILS\PARALLEL CURB LINE SIDEWALK RAMP.DWG PLOTTED: 2023/01/27 3:36 PM

SEE 'DETECTABLE WARNING SURFACE LOCATIONS' DETAIL

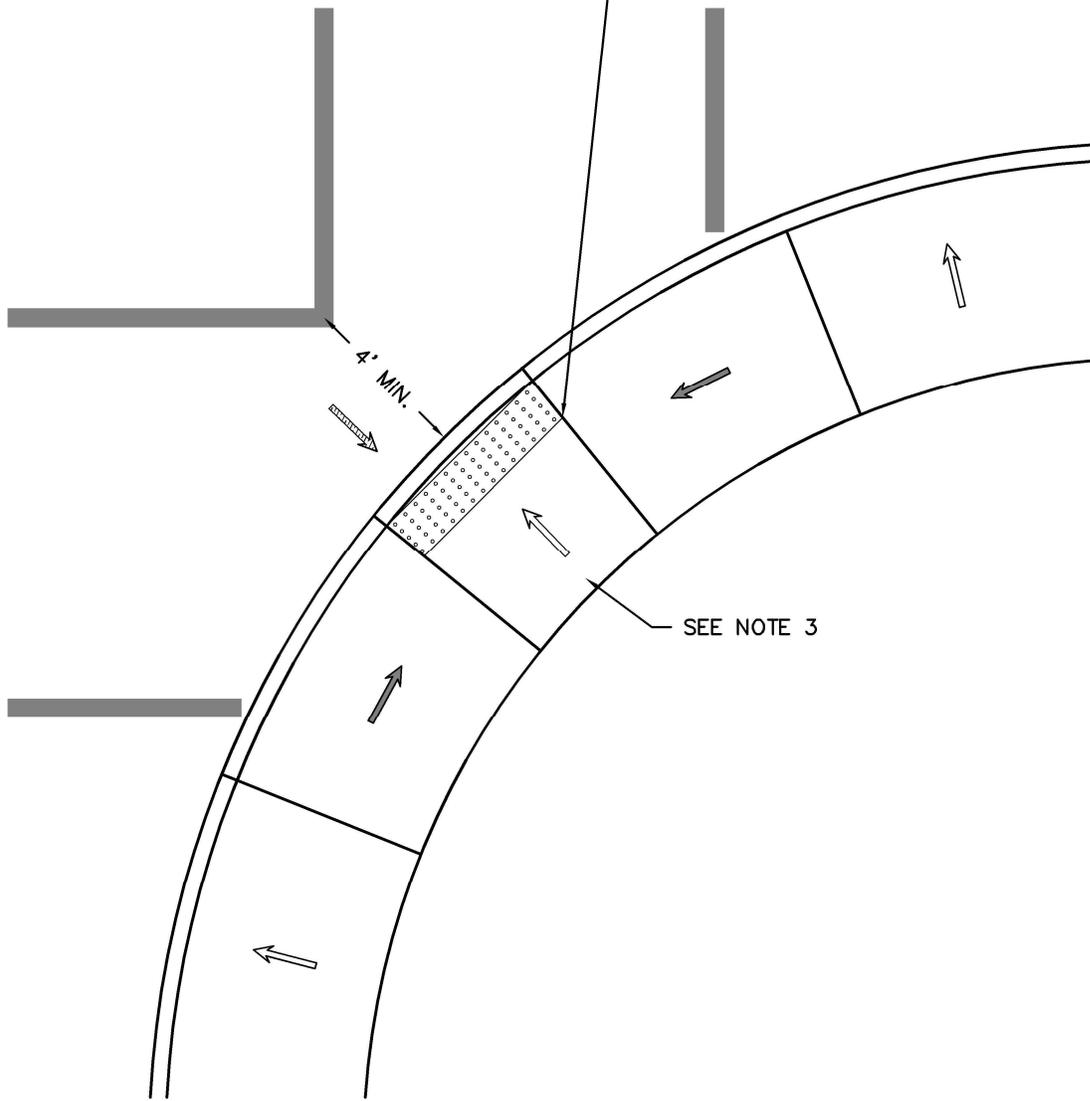

**NOTES:**

1. USE ALTERATIONS ONLY WHEN SITE OR DESIGN CONSTRAINTS PROHIBIT INSTALLING NEW RAMPS.
2. RAMPS SHALL HAVE 2% MAX. CROSS SLOPE.
3. TURNING SPACE NOTES:
  - 3.1. NEW CONSTRUCTION SHALL BE 4' x 4' MINIMUM
  - 3.2. ALTERATIONS TO EXISTING SHALL BE 3' x 3' MINIMUM.
  - 3.3. MAXIMUM SLOPE SHALL BE 2% IN ANY DIRECTION.

- Slope 1.5% max.  
(Max. 2.0% finished)
- Slope 7.5% max.  
(Max. 8.3% finished)
- Detectable Warning Surface
- Counter Slope (5.0% max.)

Standard Drawing 11G

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**PARALLEL CURB LINE  
SIDEWALK RAMP**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
04/06/17	SLOPE RANGE ADJUSTMENT	RP

CREATION DATE: 03/01/2016	REVISION DATE: 01/27/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\PERPENDICULAR CURB LINE SIDEWALK RAMP.DWG PLOTTED: 2023/01/09 12:07 PM

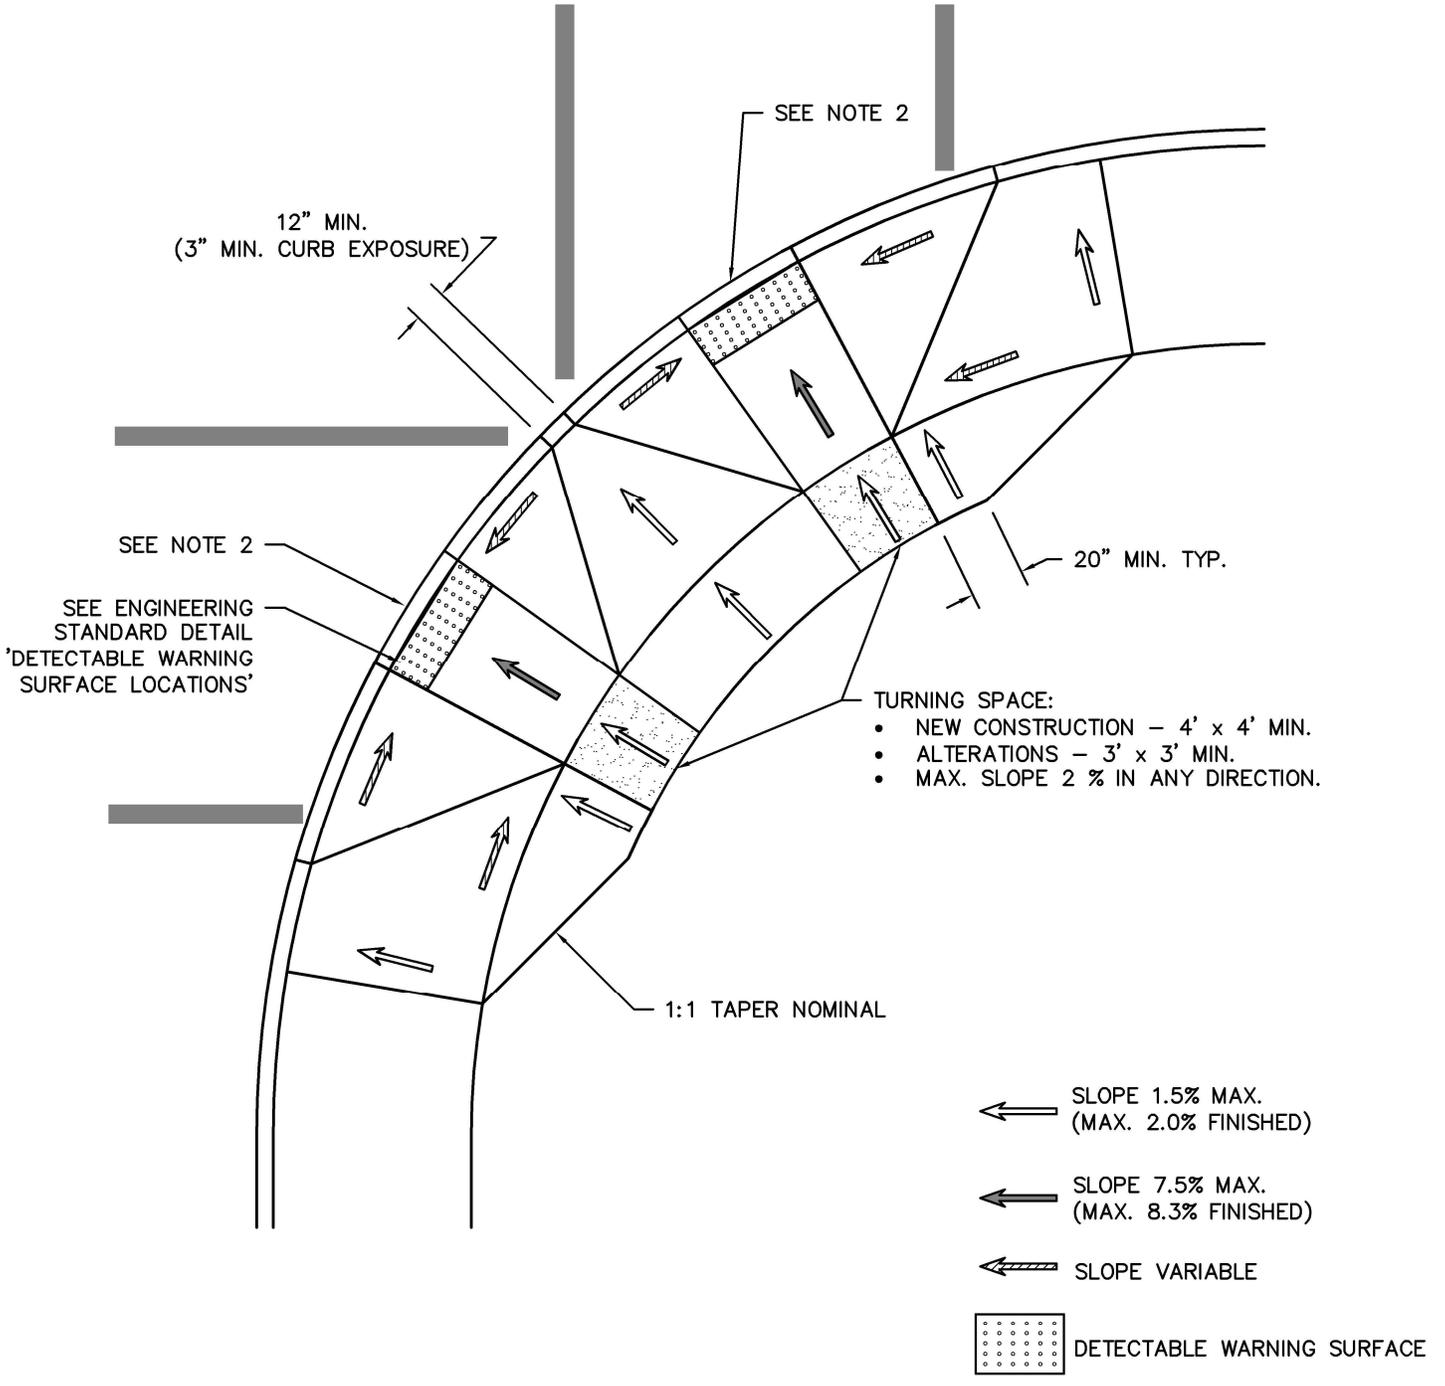

**NOTES:**

1. USE ALTERATIONS ONLY WHEN SITE OR DESIGN CONSTRAINTS PROHIBIT INSTALLING A 4' x 4' AREA.
2. COUNTER SLOPE SHALL BE 5% MAX. CROSS SLOPE SHALL BE 2% MAX.

Standard Drawing 11H


MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**PERPENDICULAR CURB  
LINE SIDEWALK RAMP**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
04/06/17	SLOPE RANGE ADJUSTMENT	HS

CREATION DATE: 03/01/2016	REVISION DATE: 01/09/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

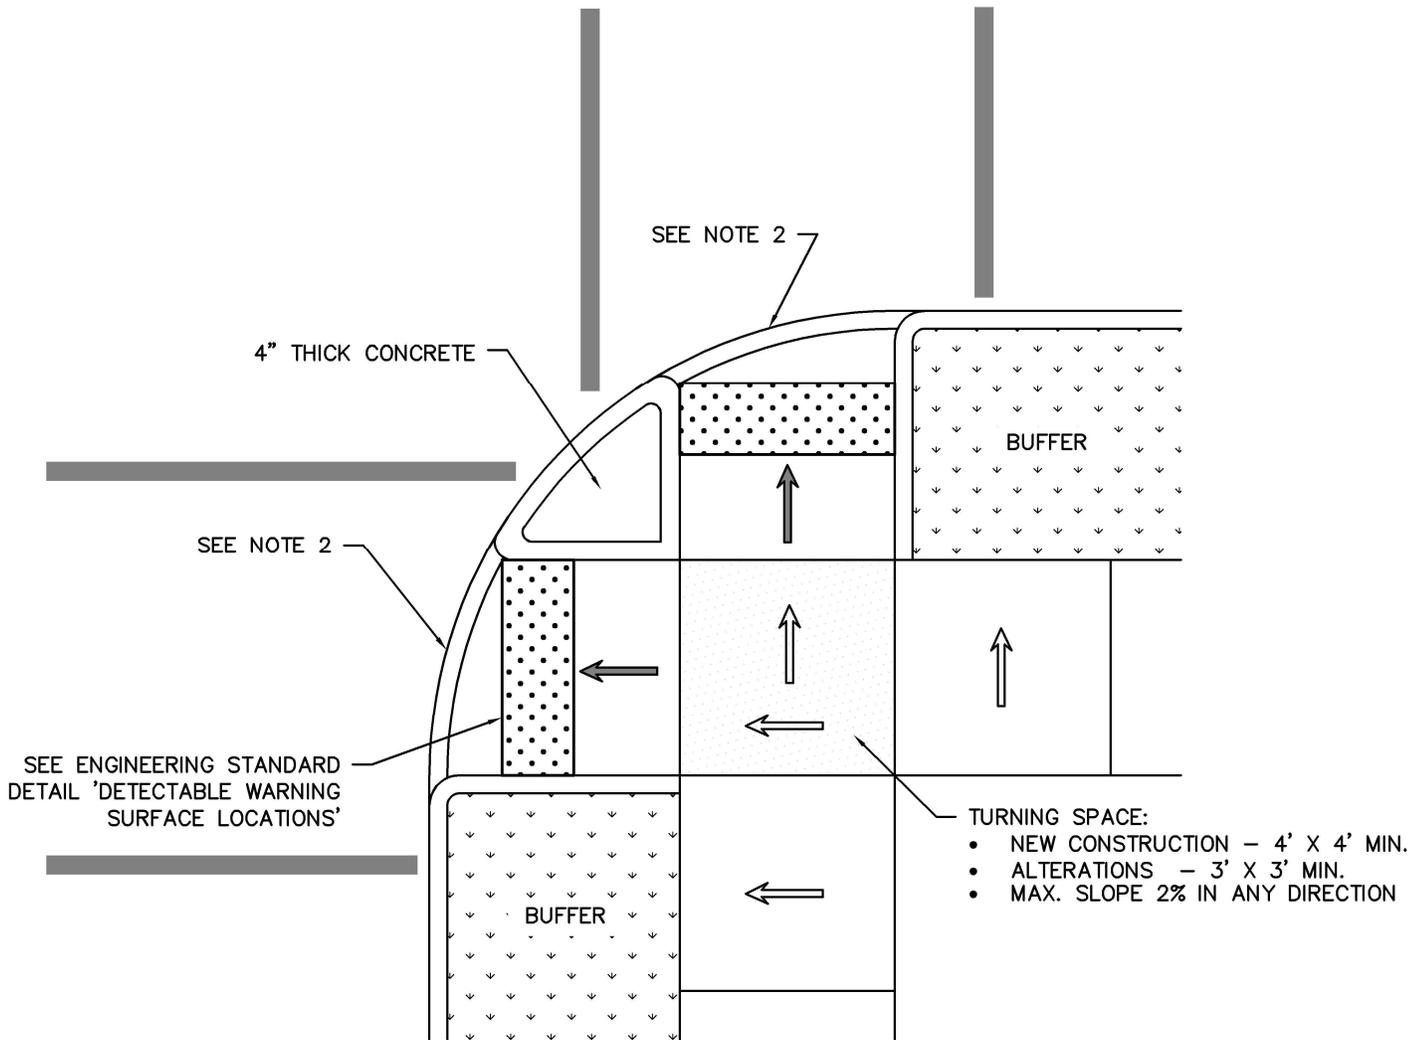

**NOTES:**

1. USE ALTERATIONS TURNING SPACE ONLY WHEN SITE OR DESIGN CONSTRAINTS PROHIBIT A LARGER AREA.
2. COUNTER SLOPE SHALL BE 5% MAX, CROSS SLOPE SHALL BE 2% MAX.

← SLOPE 1.5% MAX.  
(MAX. 2.0% FINISHED)

← SLOPE 7.5% MAX.  
(MAX. 8.3% FINISHED)

▤ DETECTABLE WARNING SURFACE

Standard Drawing 111

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**PERPENDICULAR  
PROPERTY LINE RAMPS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
04/06/17	SLOPE RANGE ADJUSTMENT	RP

CREATION DATE: 03/01/2016	REVISION DATE: 01/09/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\PARALLEL PROPERTY LINE RAMPS.DWG PLOTTED: 2023/01/06 4:09 PM

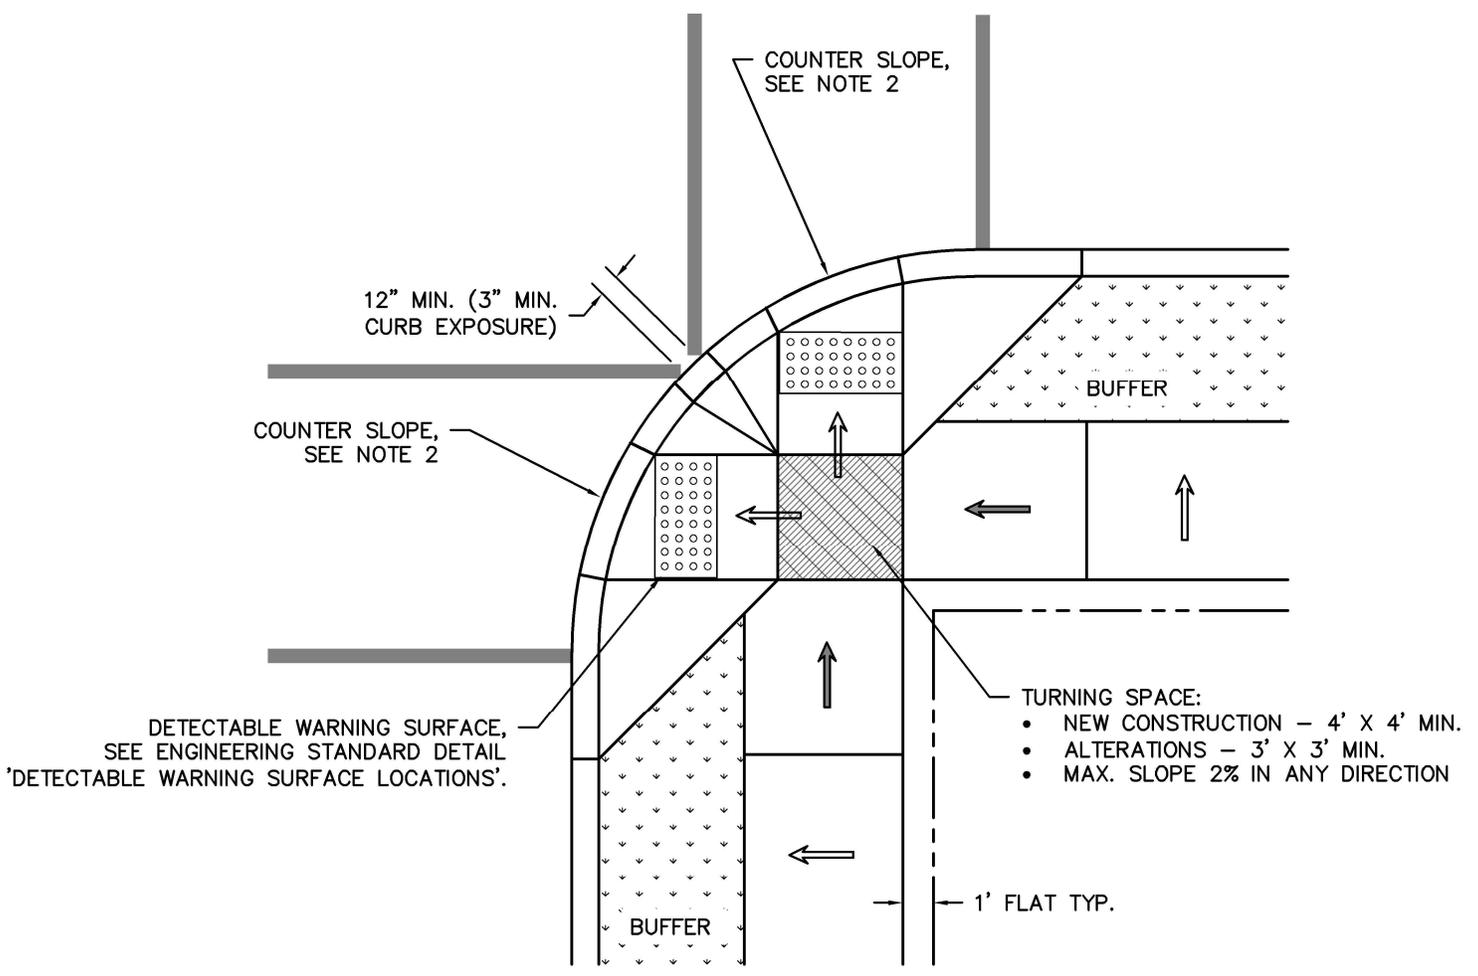

- NOTES:**
1. USE ALTERATIONS TURNING SPACE ONLY WHEN SITE OR DESIGN CONSTRAINTS PROHIBIT A LARGER AREA.
  2. COUNTER SLOPE IS 5% MAX, CROSS SLOPE IS 2% MAX.

← SLOPE 1.5% MAX.  
(MAX. 2.0% FINISHED)

← SLOPE 7.5% MAX.  
(MAX. 8.3% FINISHED)

▣ DETECTABLE WARNING SURFACE

Standard Drawing 11J

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**PARALLEL PROPERTY  
LINE RAMPS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 03/01/2016	REVISION DATE: 01/06/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ARTEIAL INTERSECTIONS AND COMMERCIAL DRIVEWAYS.DWG PLOTTED: 2023/02/16 5:02 PM

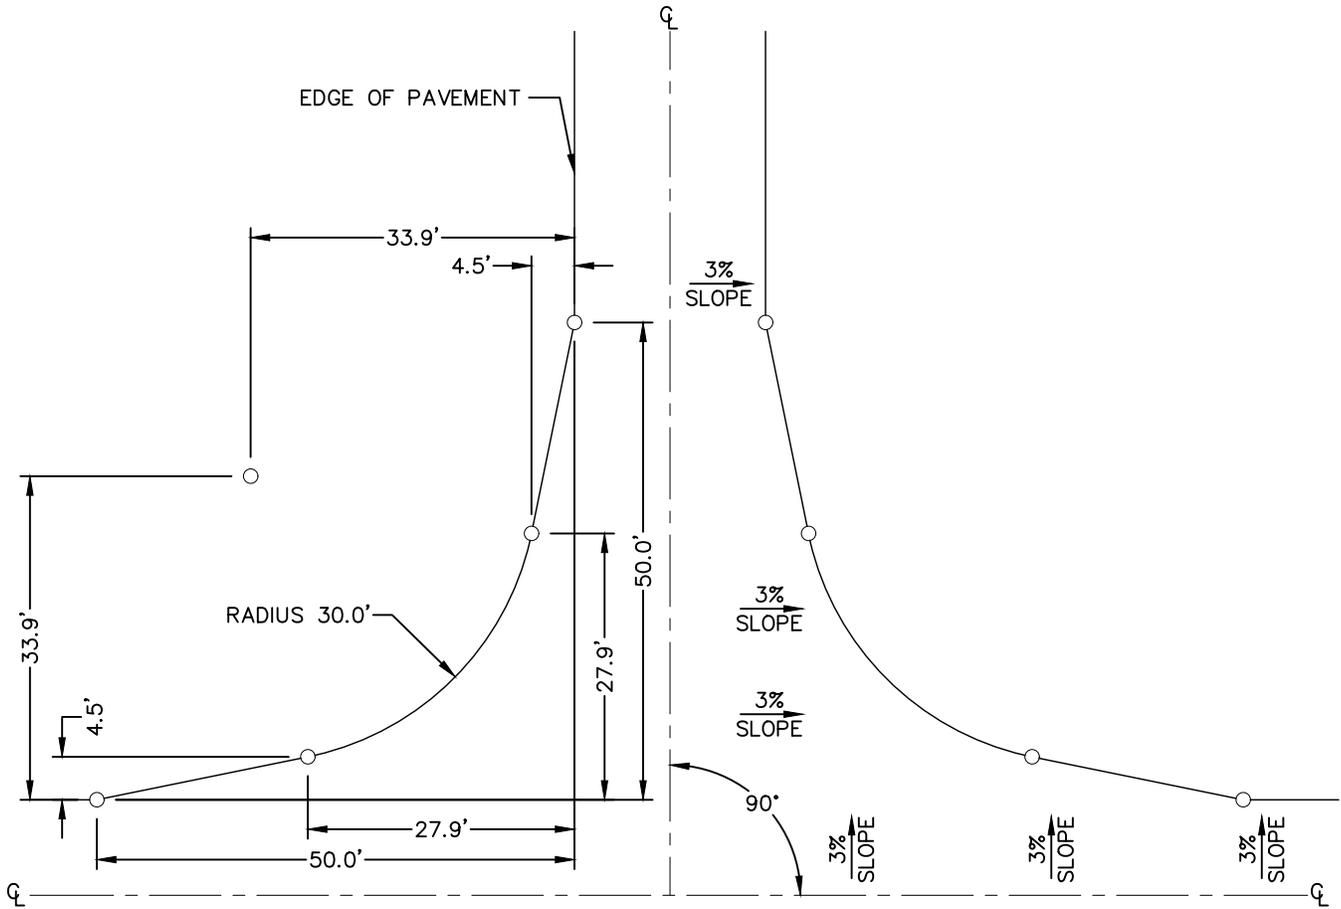

**NOTES:**

1. DIMENSIONS GIVEN ARE FOR A 90° ANGLE OF INTERSECTION. FOR ANGLES DEVIATING BY MORE THAN 5°; SEE STANDARD DRAWING 'ARTEIAL INTERSECTIONS AND MAJOR COMMERCIAL-INDUSTRIAL DRIVEWAYS-VARIOUS ANGLES'.
2. SURFACING AND BASE COURSE OF THE INTERSECTION, INCLUDING THE FLARE AREA, SHALL CONFORM TO SECTION IV: ROADWAY DESIGN STANDARDS OF THE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARDS.

Standard Drawing 12


MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**90° ARTEIAL INTERSECTIONS  
AND MAJOR  
COMMERCIAL-INDUSTRIAL  
DRIVEWAYS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
03/11/22	TITLE BLOCK & CLEAN UP	HS

CREATION DATE: 11/22/1993	REVISION DATE: 02/16/2023	SCALE: N.T.S	SHEET: 1 OF 2
------------------------------	------------------------------	-----------------	------------------

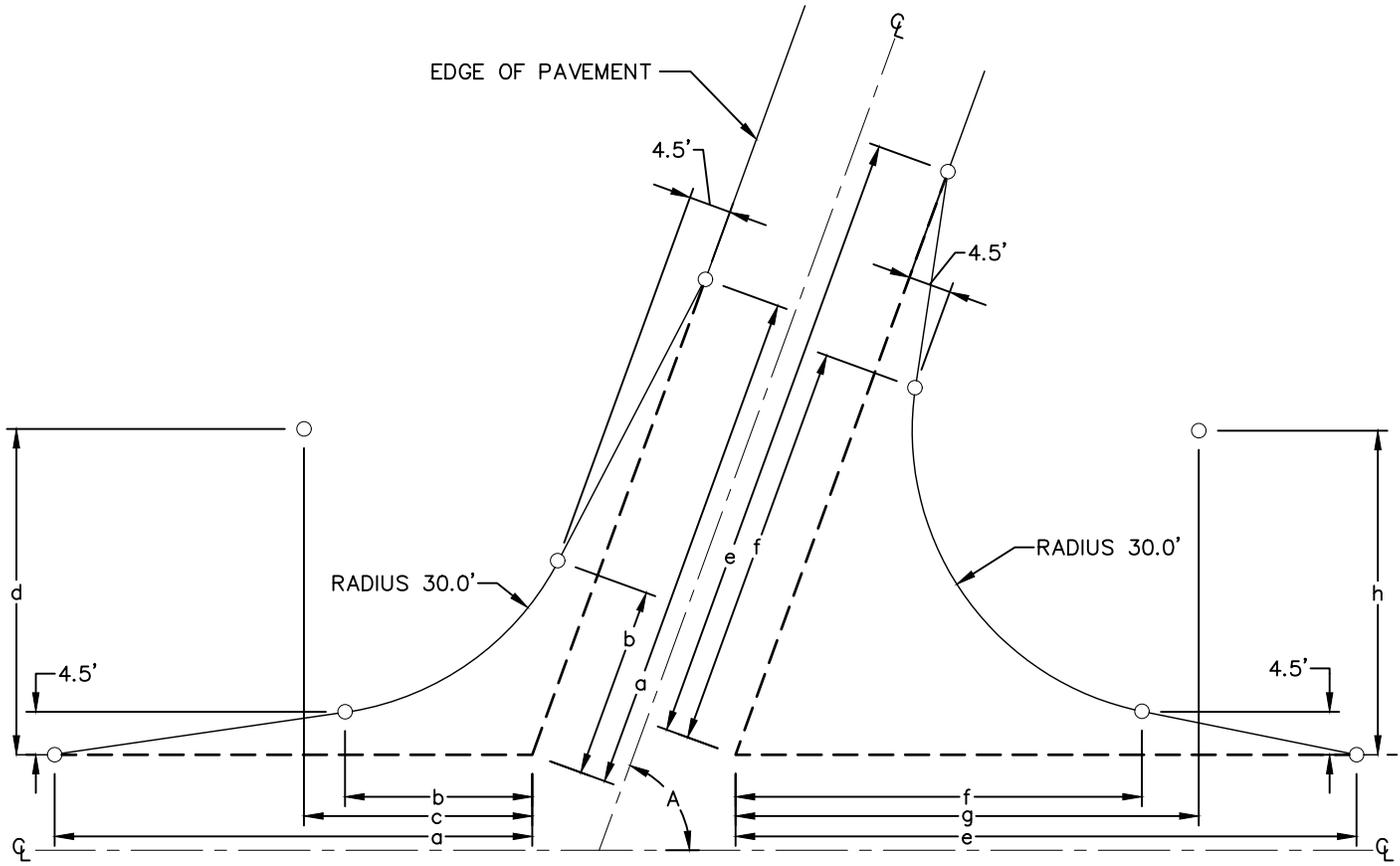

**NOTES:**

1. SURFACING AND BASE COURSE OF THE INTERSECTION, INCLUDING THE FLARE AREA, SHALL CONFORM TO SECTION IV: ROADWAY DESIGN STANDARDS OF MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARDS.
2. ALL DIMENSIONS IN THE TABLE BELOW ARE MEASURED IN FEET.

ANGLE A	a	b	c	d	e	f	g	h
60°	50.0	15.9	19.8	34.2	74.0	52.5	58.7	33.9
70°	50.0	19.5	23.9	34.2	65.0	42.8	48.50	34.00
80°	50.00	23.60	28.6	34.1	57.0	34.5	40.40	33.9
90°	50.0	27.9	33.9	33.9	a	b	c	d
100°	57.0	34.5	40.4	33.9	50.0	23.6	28.6	34.1
110°	65.0	42.8	48.5	34.0	50.0	19.6	23.9	34.2
120°	74.0	58.7	58.7	33.9	50.0	15.9	19.8	34.2

Standard Drawing 13

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**ARTERIAL INTERSECTIONS  
AND MAJOR  
COMMERCIAL-INDUSTRIAL  
DRIVEWAYS - VARIOUS ANGLES**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
03/11/22	TITLE BLOCK & CLEAN UP	HS


CREATION DATE: 11/22/1993	REVISION DATE: 02/16/2023	SCALE: N.T.S	SHEET: 2 of 2
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\STANDARD P.C.C. CURB AND GUTTER.DWG PLOTTED: 2023/01/06 11:16 AM


TYPE A OR B CURB

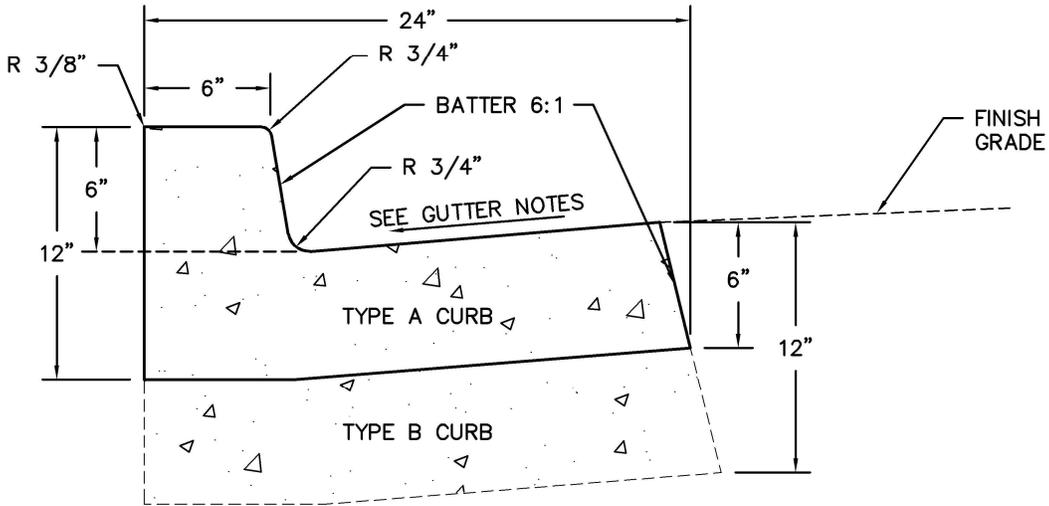

TYPE C CURB

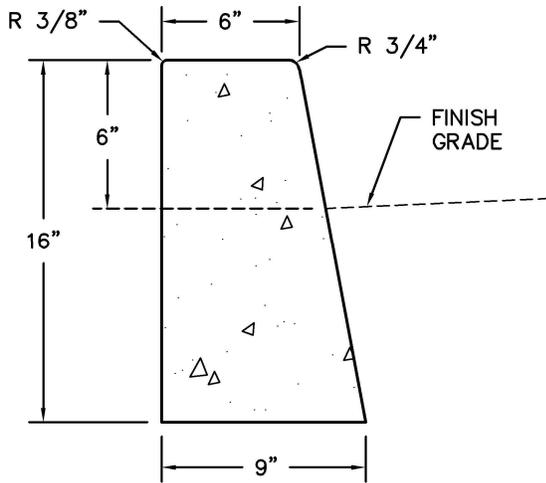

TYPE D CURB

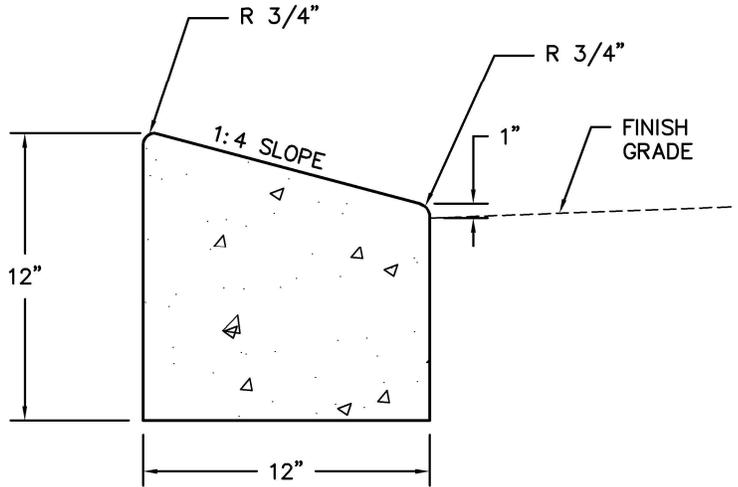

GUTTER NOTES:

1. SLOPE 5% NORMAL.
2. SLOPE -5% MAX ON HIGH SIDE CURB ON STREETS HAVING SHED SECTION.

GENERAL NOTES:

3. CURB TYPE SHALL BE SHOWN ON PLANS.
4. CONSTRUCT EXPANSION JOINTS AT 200 FOOT MAXIMUM SPACING.
5. CONSTRUCT CONTRACTION JOINTS AT 10 FOOT SPACING.
6. 3000 PSI CONCRETE TO BE USED FOR ALL CURBS, UNLESS NOTED OTHERWISE ON PROJECT PLANS.
7. CURBS AND GUTTERS SHOWN MAY BE USED WITH EITHER ASPHALTIC CONCRETE OR PORTLAND CEMENT CONCRETE PAVEMENTS.
8. TRANSITIONS FROM ONE TYPE OF CURB TO ANOTHER SHALL BE SHOWN ON PROJECT PLANS.

Standard Drawing 14

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




STANDARD P.C.C.  
CURB AND GUTTER

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	


CREATION DATE: 04/01/1986	REVISION DATE: 01/06/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMIT\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\CATCH BASIN DETAILS.DWG PLOTTED: 2023/02/21 10:41 AM

PLAN

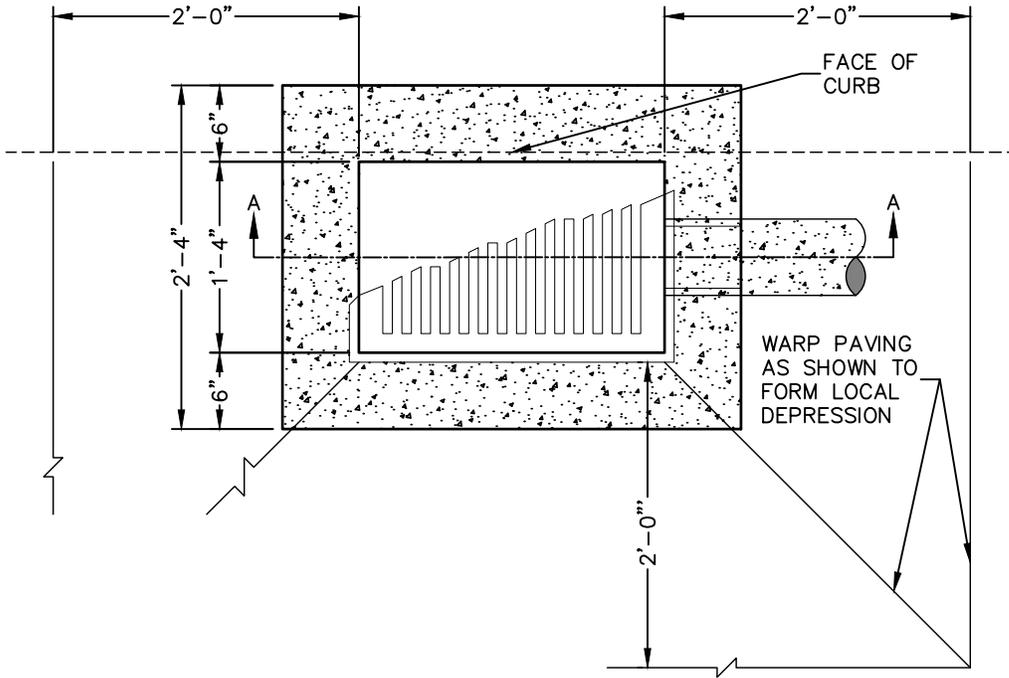

SECTION A-A

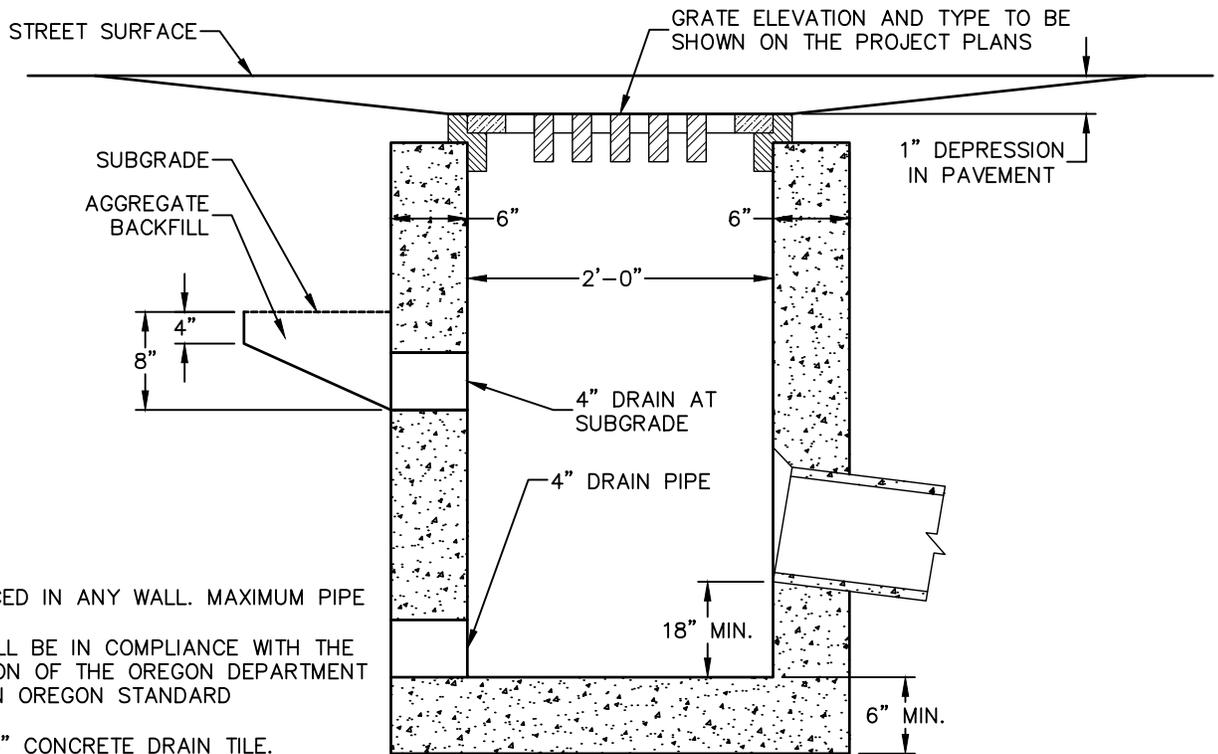

NOTES:

1. PIPES CAN BE PLACED IN ANY WALL. MAXIMUM PIPE SIZE IS 18".
2. ALL CONCRETE SHALL BE IN COMPLIANCE WITH THE MOST RECENT EDITION OF THE OREGON DEPARTMENT OF TRANSPORTATION OREGON STANDARD SPECIFICATIONS.
3. DRAINS SHALL BE 4" CONCRETE DRAIN TILE.
4. TO CONSTRUCT CLEANOUTS, REPLACE GRATE WITH 1'-3 1/2" X 1'-11 1/2" STEEL PLATE 3/4" THICK. DRILL ONE 1" DIAMETER LIFT HOLE NEAR ONE END PLATE.
5. LOCATION, PIPE SIZE, AND ELEVATION, SHALL BE SHOWN ON PROJECT PLANS. STATION SHOWN ON PROJECT PLANS IS TO CENTERLINE OF CATCH BASIN.
6. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DETAIL 'CATCH BASIN GRATES AND FRAMES TYPES A AND B' FOR GRATE AND FRAME DETAILS.

Standard Drawing 17

MARION COUNTY DEPARTMENT OF PUBLIC WORKS






TYPE 1 CATCH BASIN AND CLEANOUT

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:

CREATION DATE: 02/08/1985	REVISION DATE: 02/16/2023	SCALE: N.T.S	SHEET: 1 OF 7
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\STANDARD CATCH BASIN DETAILS.DWG PLOTTED: 2023/01/03 12:08 PM

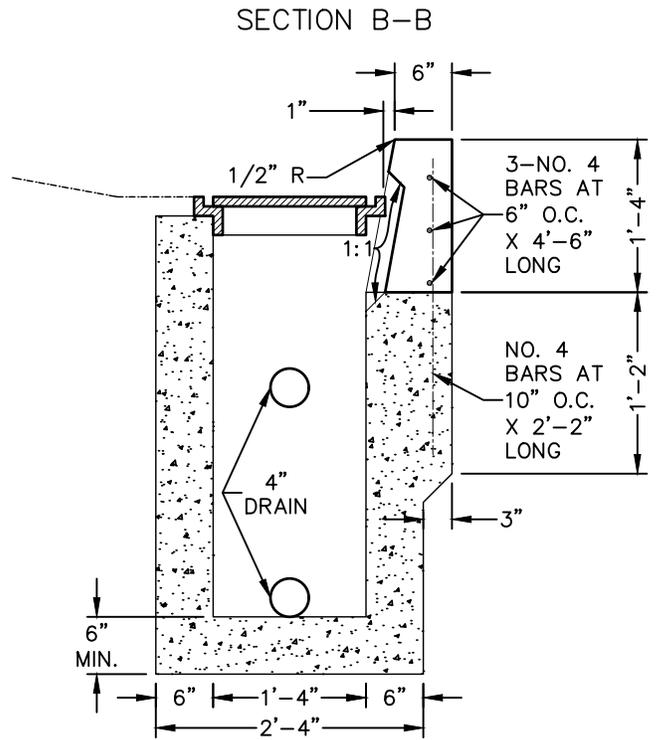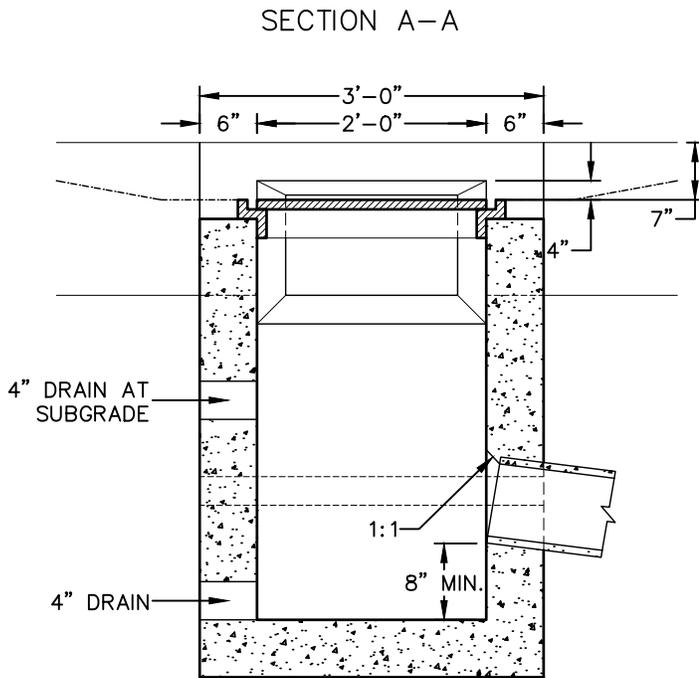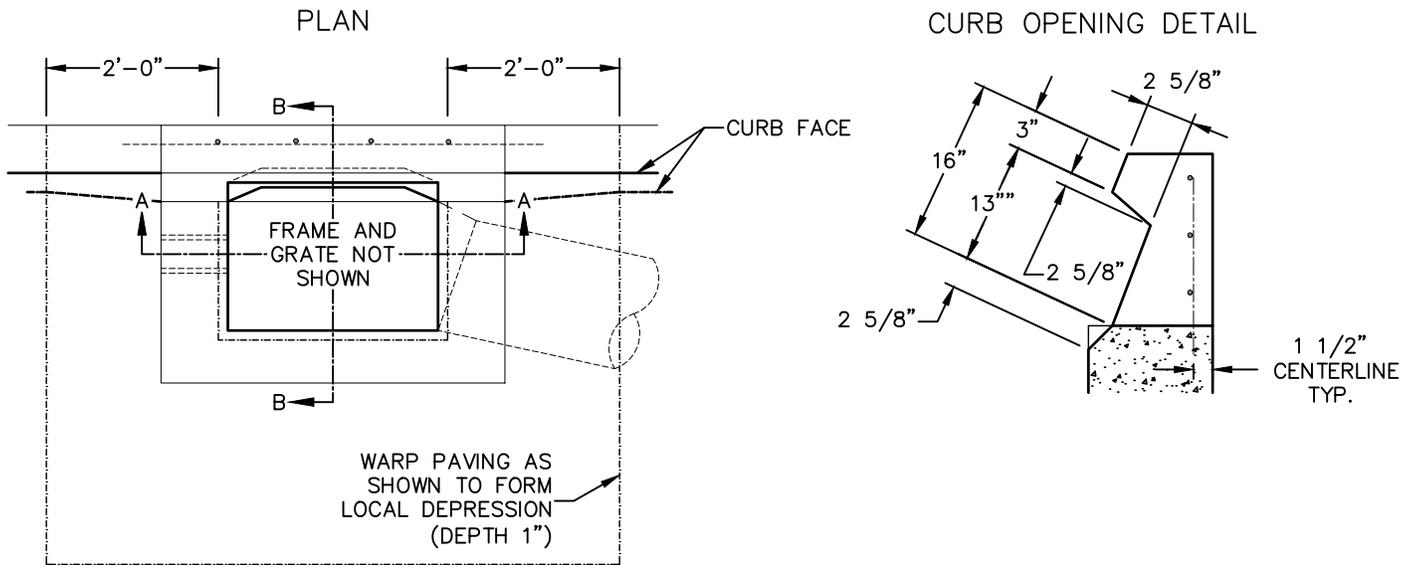

**NOTES:**

1. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DETAIL 'CATCH BASIN GRATES AND FRAMES TYPE A AND B' FOR MORE DETAILS.
2. DRAINS SHALL BE 4" CONCRETE DRAIN TILE.
3. LOCATION, PIPE SIZE, AND ELEVATION SHALL BE SHOWN ON PROJECT PLANS.
4. PIPES CAN BE PLACED IN ANY WALL.
5. MAXIMUM PIPE SIZE 18".
6. STATION SHOWN ON PROJECT PLAN SHALL BE TO CENTERLINE OF CATCH BASIN.

Standard Drawing 18

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**TYPE 2 (SIDE INLET)  
CATCH BASIN**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:


CREATION DATE: 02/08/1985	REVISION DATE: 12/28/2022	SCALE: N.T.S	SHEET: 2 OF 7
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\STANDARD CATCH BASIN DETAILS.DWG PLOTTED: 2023/01/03 12:08 PM


PLAN

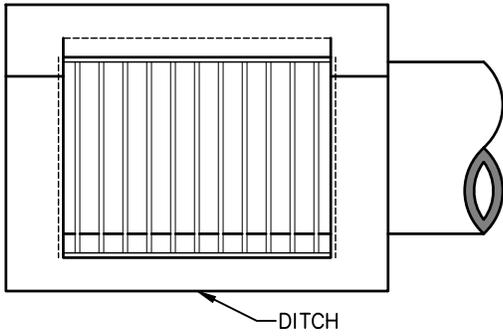


FRAME

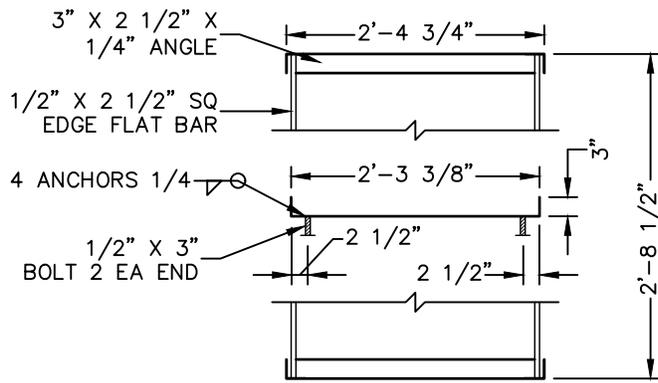


GRATE

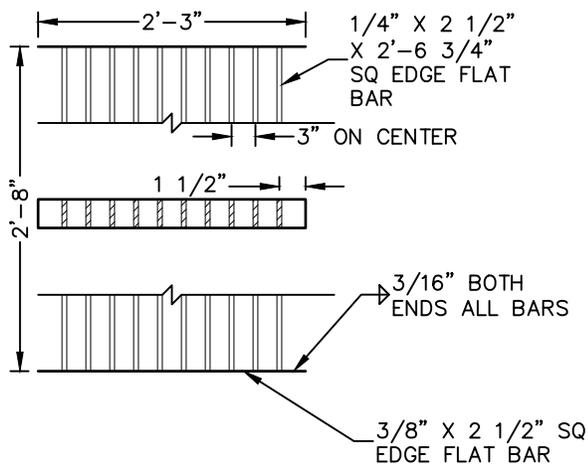

ELEVATION

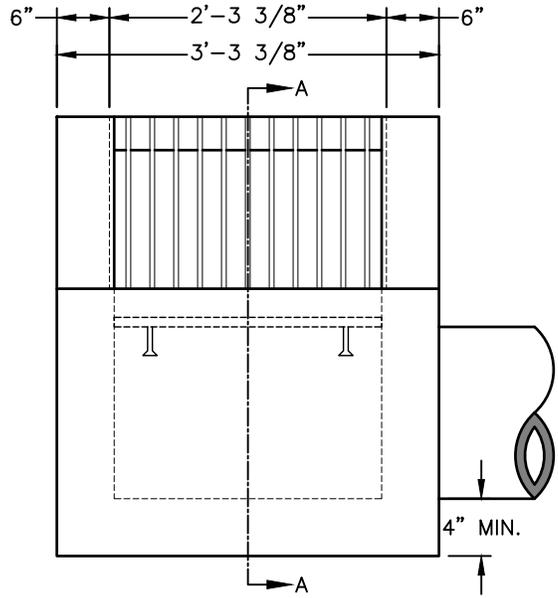

SECTION A-A

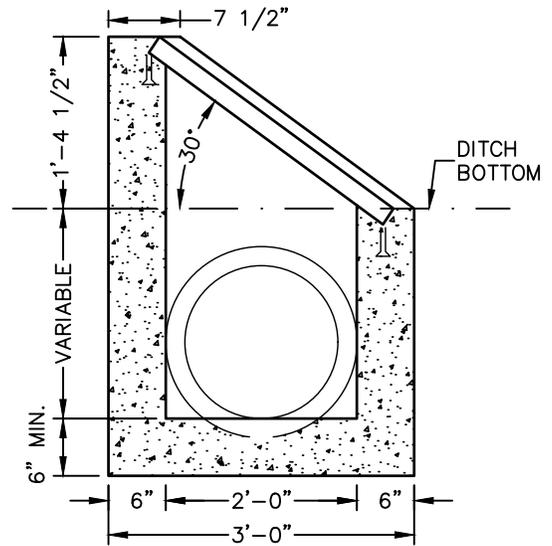

NOTES:

1. LOCATION, PIPE SIZE, AND ELEVATION, SHALL BE SHOWN ON PROJECT PLANS.
2. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DETAIL 'TYPE 1 AND CLEANOUT' FOR MORE DETAILS.
3. CATCH BASIN MAY BE BUILT WITH OR WITHOUT A SUMP, AS DIRECTED BY THE COUNTY ENGINEER.
4. FRAME AND GRATE MATERIAL SHALL BE STEEL (A.S.T.M. A-36) AND BE GALVANIZED IN ACCORDANCE WITH A.S.T.M A-123.

Standard Drawing 19

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




TYPE 3 CATCH BASIN FRAME AND GRATE

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	


CREATION DATE: 02/08/1985	REVISION DATE: 12/28/2022	SCALE: N.T.S	SHEET: 4 OF 7
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMIT\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\CATCH BASIN DETAILS.DWG PLOTTED: 2023/01/03 12:08 PM


**TYPE A GRATE**  
1-1/4" CLEAR SPACING

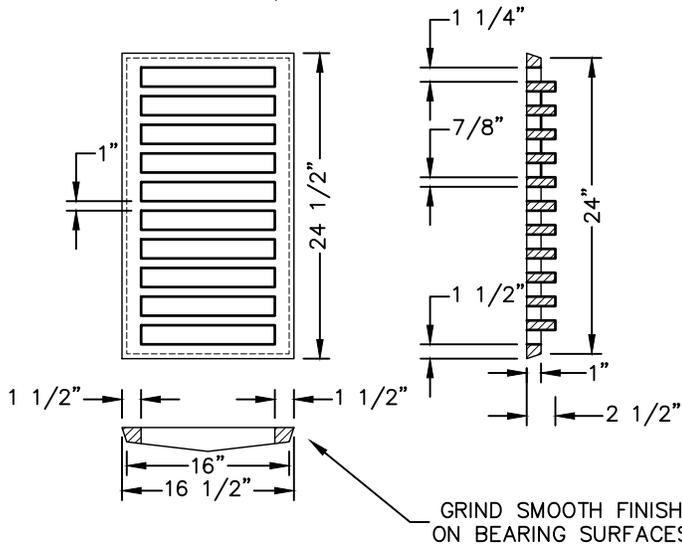

**TYPE B GRATE**  
1-3/8" CLEAR SPACING

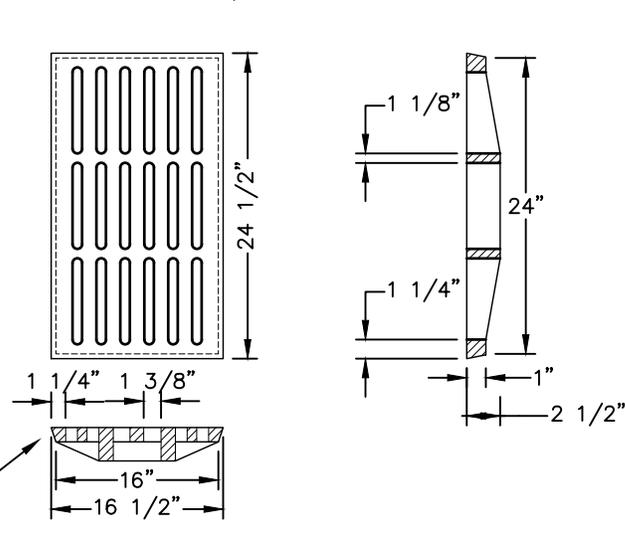

**CAST IRON / CAST STEEL GRATE FRAMES**

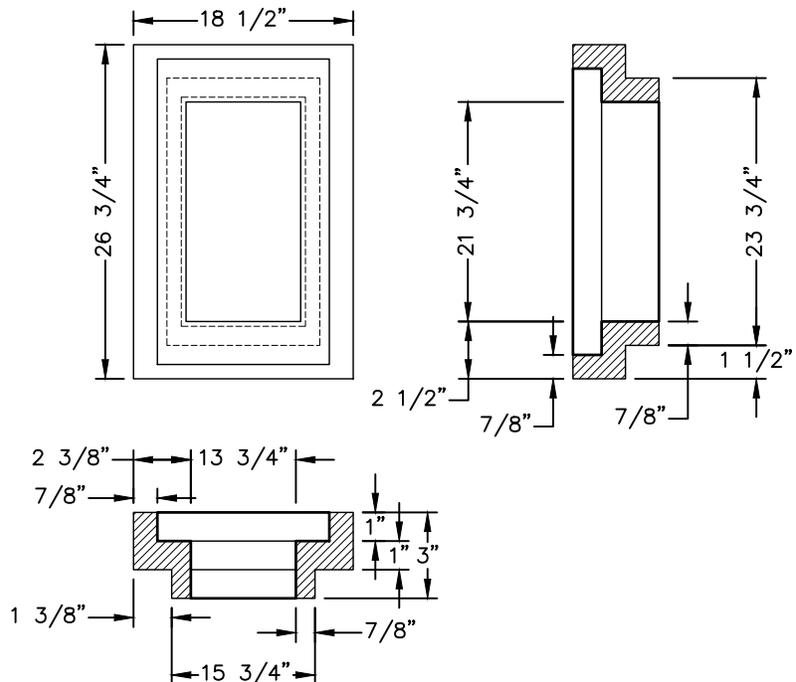

**NOTES**

1. ALL CASTINGS SHALL CONFORM TO ASTM A-48 (AASHTO M105) FOR GRAY IRON CASTINGS, CLASS 30, OR (AASHTO M192), CLASS 70, FOR CAST STEEL.
2. ROUNDS, FILLETS, TAPERS AND OTHER MINOR MODIFICATIONS TO THE DIMENSIONS SHOWN FOR CASTINGS MAY BE MADE TO CONFORM TO COMMON SHOP PRACTICES, AS DETERMINED BY COUNTY ENGINEER.

Standard Drawing 20

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**CATCH BASIN GRATES AND FRAMES TYPES A AND B**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 02/08/1985	REVISION DATE: 12/28/2022	SCALE: N.T.S	SHEET: 7 OF 7
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDEN&PERMITS\SHARED\ENGINEERING\DETAILS\STORM DRAIN STANDARD PRECAST MANHOLE.DWG PLOTTED: 2023/01/23 10:25 AM

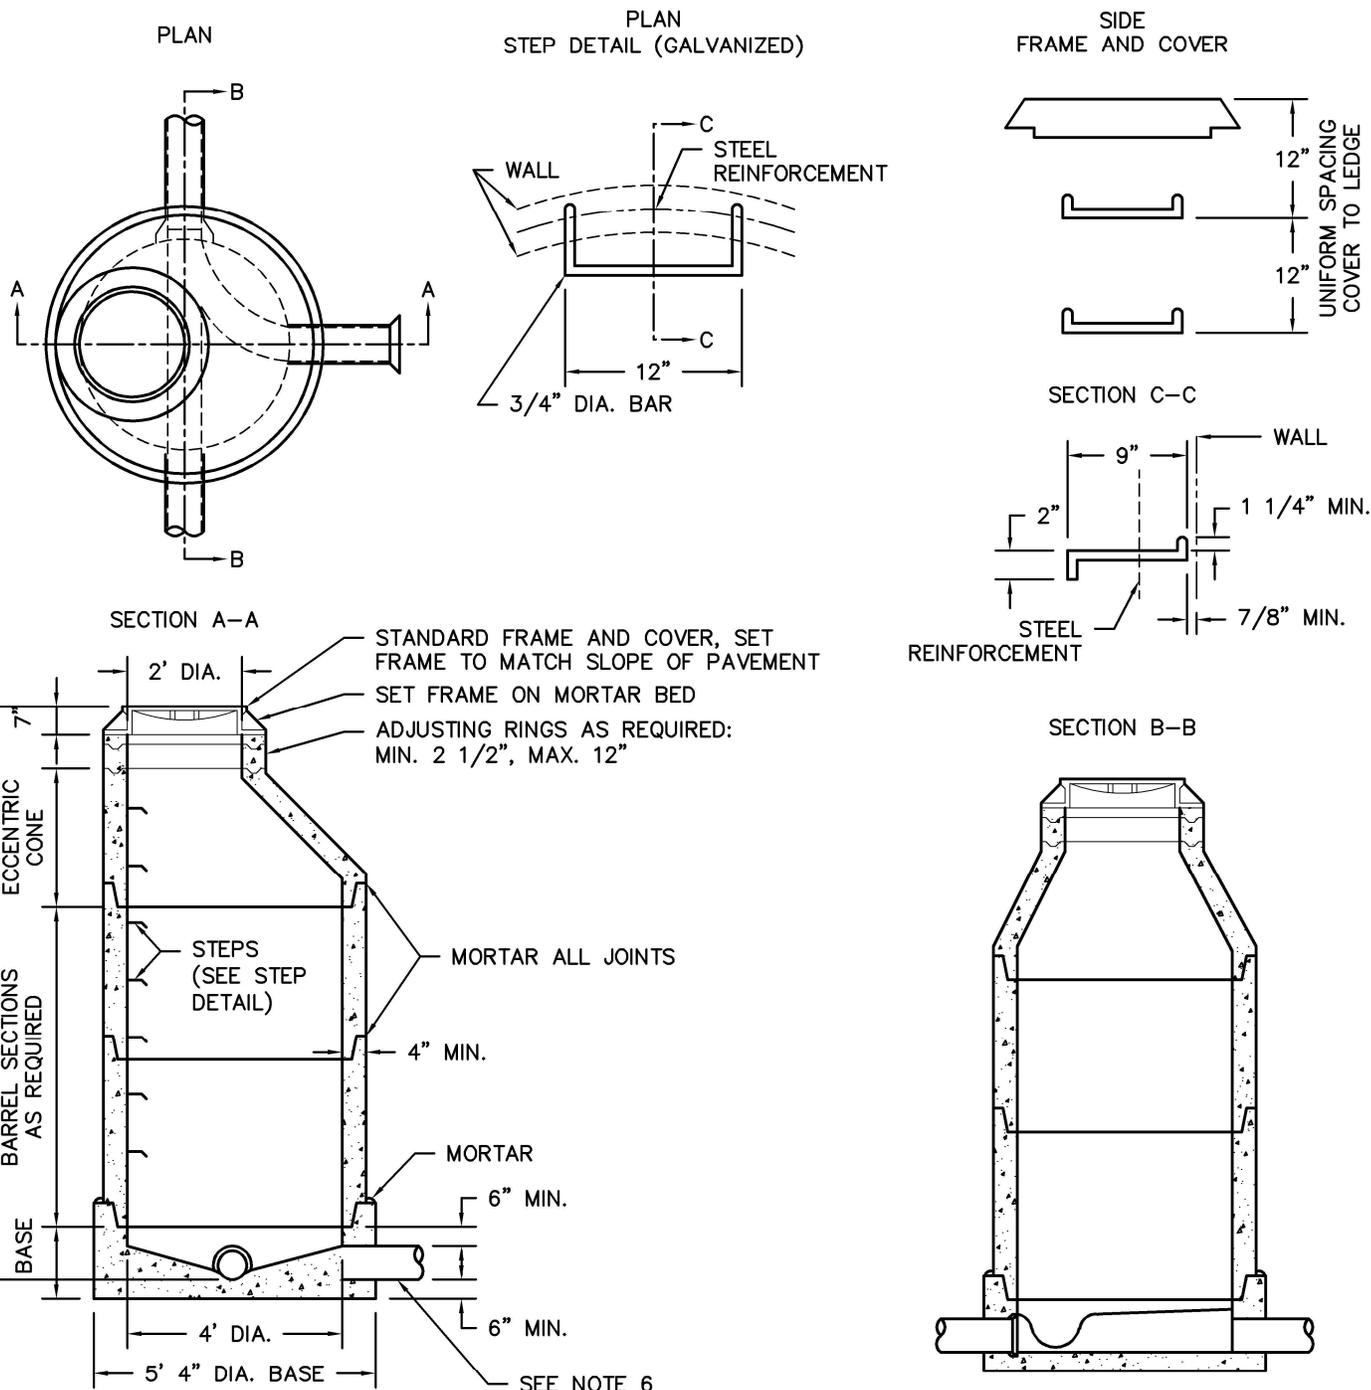

- NOTES:
1. PRECAST BARREL, CONE, AND ADJUSTMENT RINGS SHALL BE REINFORCED CONCRETE MANHOLE SECTIONS CONFORMING TO ASTM C 478, AASHTO M199.
  2. FOR STANDARD MANHOLE FRAME AND COVER DETAILS SEE ENGINEERING STANDARD DETAIL 'STANDARD MANHOLE CASTING DETAILS'.
  3. FOR MANHOLE WITH "H" LESS THAN 4'-0" SEE ENGINEERING STANDARD DETAIL 'STORM DRAIN SHALLOW PRECAST MANHOLE (H LESS THAN 4'-0")'.
  4. INSIDE JOINTS SHALL NOT EXCEED 3/8" IN THICKNESS.
  5. FORM CHANNELS IN MANHOLE BASE AS SHOWN.
  6. MAXIMUM PIPE SIZE SHALL BE 21". LOCATION, PIPE SIZE, AND ELEVATION SHALL BE SHOWN ON PROJECT PLANS.
  7. PLYWOOD FORM MANHOLE BASE.
  8. CONCRETE FOR BASE SHALL BE CLASS 3000 1-1/2.

Standard Drawing 21A

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**STORM DRAIN STANDARD PRECAST MANHOLE**

CREATION DATE: 06/27/1994	REVISION DATE: 01/23/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------


REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\STORM DRAIN SHALLOW PRECAST MANHOLE.DWG PLOTTED: 2023/01/17 11:26 AM


PLAN  
(FRAME AND COVER NOT SHOWN)

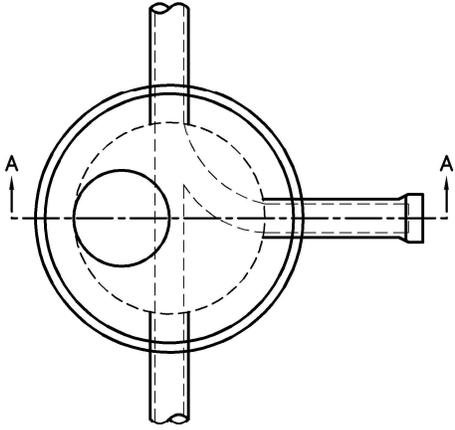

SECTION A-A

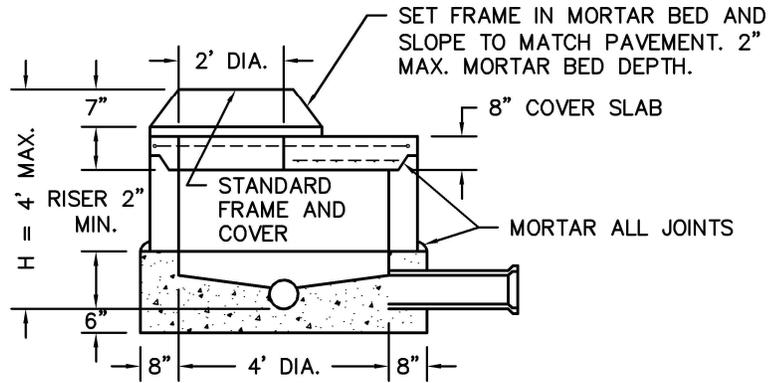

COVER SLAB REINFORCEMENT

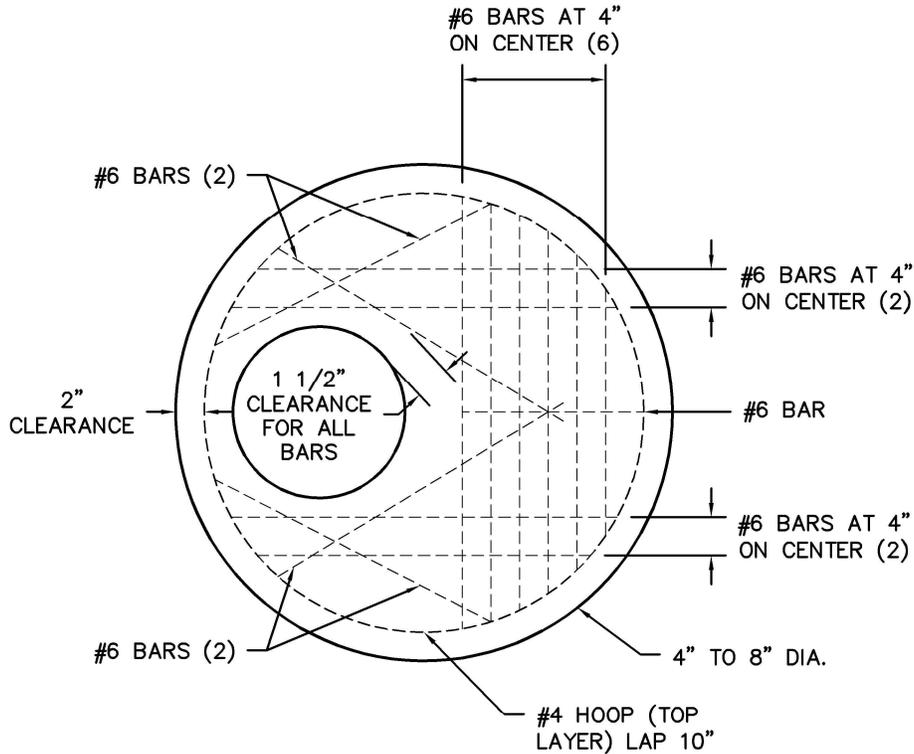

NOTES:

1. PRECAST BARREL SHALL BE REINFORCED CONCRETE MANHOLE SECTION CONFORMING TO ASTM C478, AASHTO M199.
2. SEE ENGINEERING STANDARD DETAIL 'STANDARD MANHOLE CASTING DETAILS' FOR MANHOLE FRAME AND COVER SPECIFICATIONS.
3. ALL CONCRETE SHALL BE CLASS 3000-1 1/2.
4. FORM CHANNELS IN MANHOLE AS SHOWN.
5. MAXIMUM PIPE SIZE SHALL BE 21". LOCATION, SIZE, AND ELEVATION SHALL BE SHOWN ON PROJECT PLANS.
6. PLYWOOD FORM MANHOLE BASE.

Standard Drawing 21B

MARION COUNTY DEPARTMENT OF PUBLIC WORKS





STORM DRAIN SHALLOW  
PRECAST MANHOLE  
(H LESS THAN 4'-0")

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 06/27/1994	REVISION DATE: 01/17/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

SPECIAL BASE FOR MANHOLES AT ANGLE POINT IN LINE

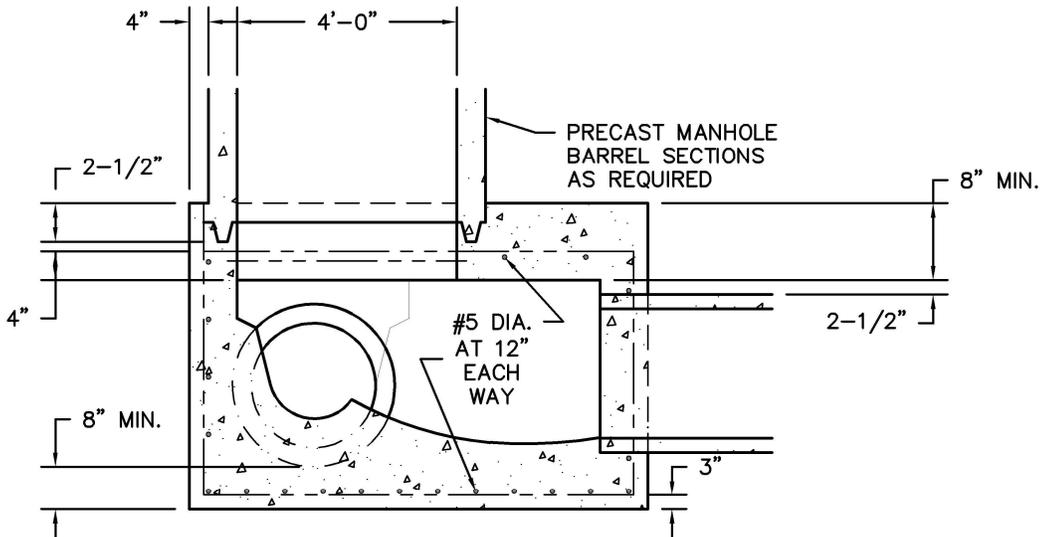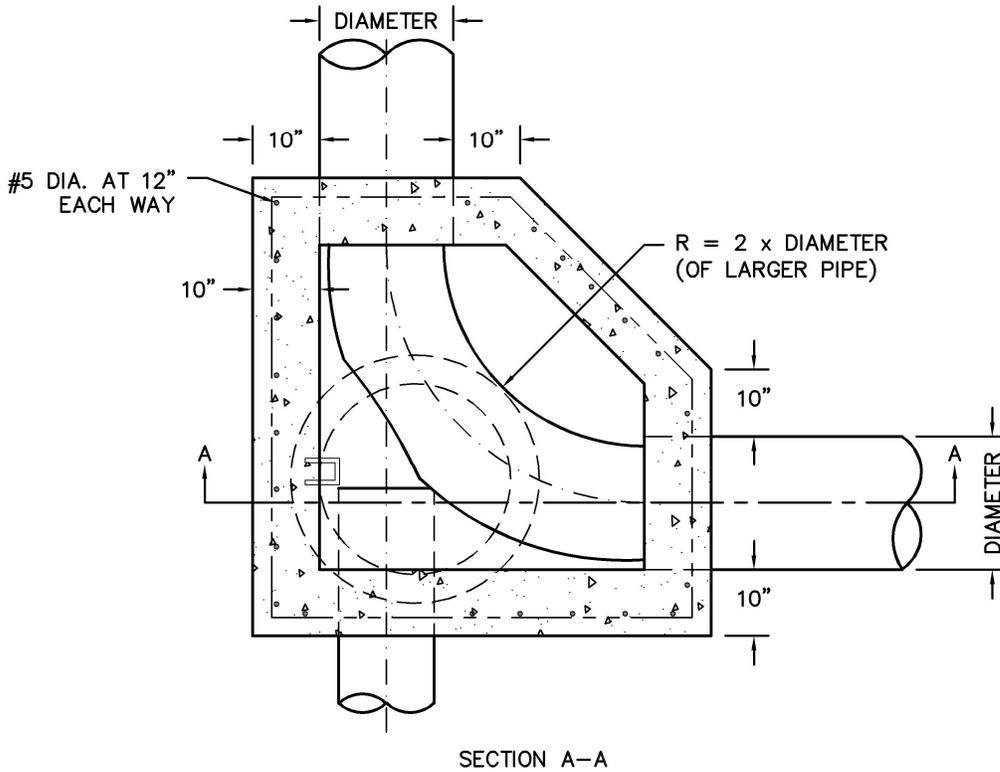

NOTES:

1. PRECAST MANHOLE BARREL SECTIONS, ECCENTRIC CONE AND STANDARD FRAME AND COVER SHALL CONFORM TO ENGINEERING STANDARD DETAIL 'STORM DRAIN STANDARD PRECAST MANHOLE'.
2. ALL CONCRETE SHALL BE CLASS 3000 -1 1/2.
3. FORM CHANNELS IN MANHOLE AS SHOWN TO CONFORM TO INSIDE DIAMETERS OF PIPES.
4. PLYWOOD FORM MANHOLE BASE.
5. LOCATION, PIPE SIZE AND ELEVATION SHALL BE SHOWN ON PROJECT PLANS.

Standard Drawing 22

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




STORM DRAIN MANHOLE  
FOR PIPE 24" AND OVER

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	


CREATION DATE: 06/28/1994	REVISION DATE: 01/17/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\STANDARD MANHOLE CASTING DETAILS.DWG PLOTTED: 2023/01/27 3:23 PM


MANHOLE COVER

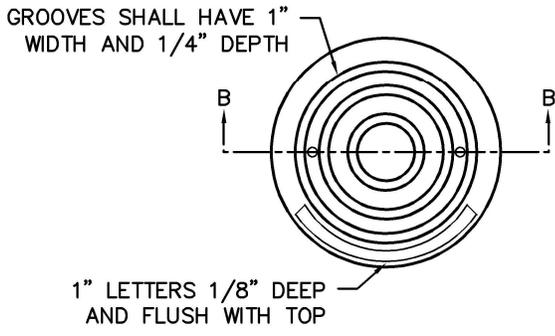


SECTION B-B

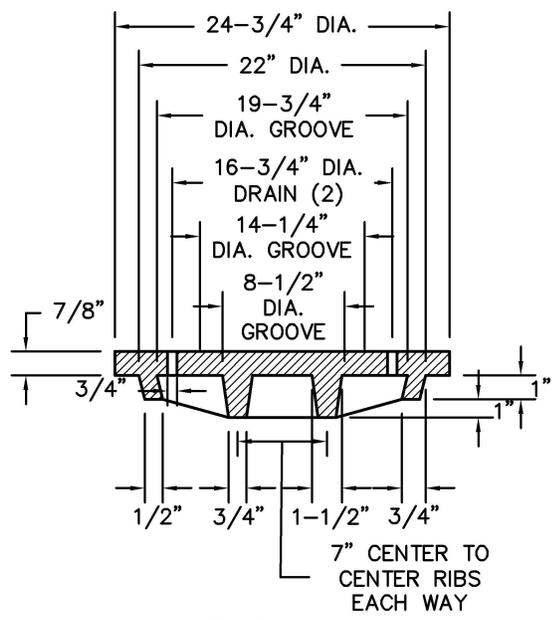


MANHOLE FRAME

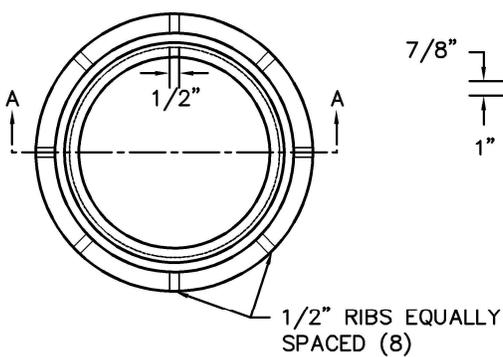


SECTION A-A

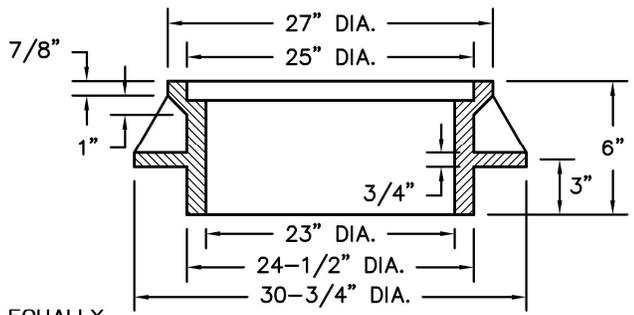

ADJUSTMENT RING

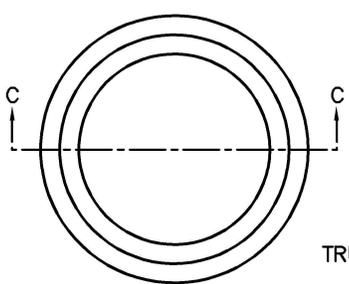

SECTION C-C

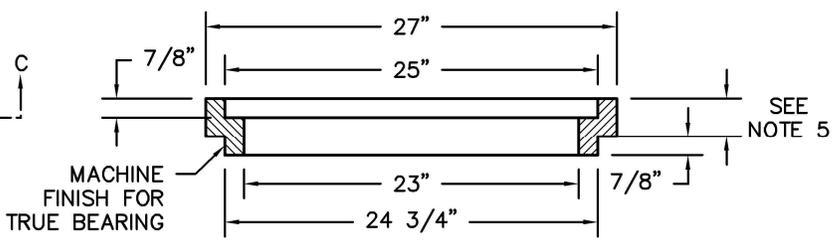

NOTES:

1. COVER AND FRAME TO BE MACHINED FOR TRUE BEARING.
2. SANITARY SEWER MANHOLE COVERS SHALL HAVE 2 HOLE LIDS.
3. STORM DRAIN MANHOLE COVERS SHALL HAVE 16 HOLE LIDS.
4. CAST IRON ADJUSTMENT RINGS ALLOWED ONLY WITH OVERLAYS AND NOT ON NEW MANHOLES. MAXIMUM 1 ADJUSTMENT RING PER MANHOLE.
5. STANDARD DEPTHS ARE 1.5", 2", 2.5", OR 3".

Standard Drawing 23

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




STANDARD MANHOLE CASTING DETAILS

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 06/30/1994	REVISION DATE: 01/27/2023	SCALE: N.T.S	SHEET: 1 of 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\LATERAL CONNECTION TO STORM DRAIN PIPE\_PVT.DWG PLOTTED: 2022/10/20 2:03 PM

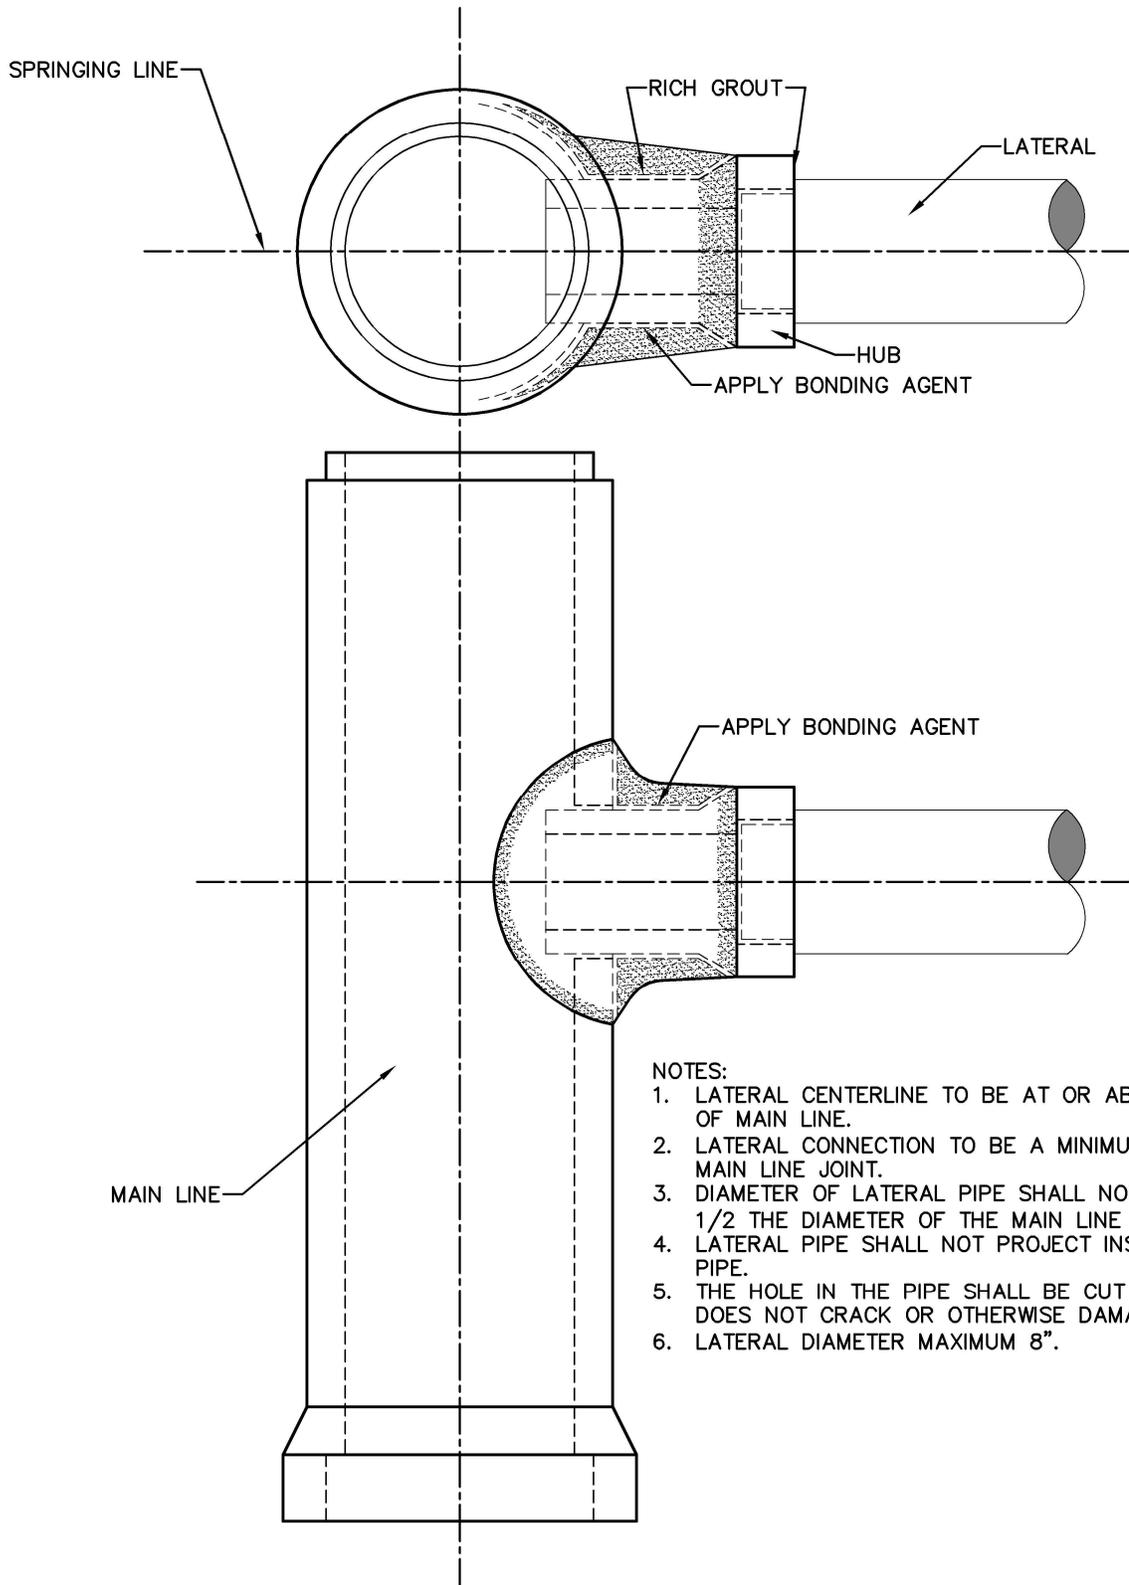

- NOTES:
1. LATERAL CENTERLINE TO BE AT OR ABOVE SPRINGING LINE OF MAIN LINE.
  2. LATERAL CONNECTION TO BE A MINIMUM OF 1 1/2' FROM MAIN LINE JOINT.
  3. DIAMETER OF LATERAL PIPE SHALL NOT BE GREATER THAN 1/2 THE DIAMETER OF THE MAIN LINE PIPE.
  4. LATERAL PIPE SHALL NOT PROJECT INSIDE OF THE MAIN LINE PIPE.
  5. THE HOLE IN THE PIPE SHALL BE CUT IN A MANNER THAT DOES NOT CRACK OR OTHERWISE DAMAGE THE PIPE.
  6. LATERAL DIAMETER MAXIMUM 8".

Standard Drawing 24


MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**LATERAL CONNECTION TO STORM DRAIN PIPE FROM PRIVATE PROPERTY**


REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 07/05/1994	REVISION DATE: 09/15/2022	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

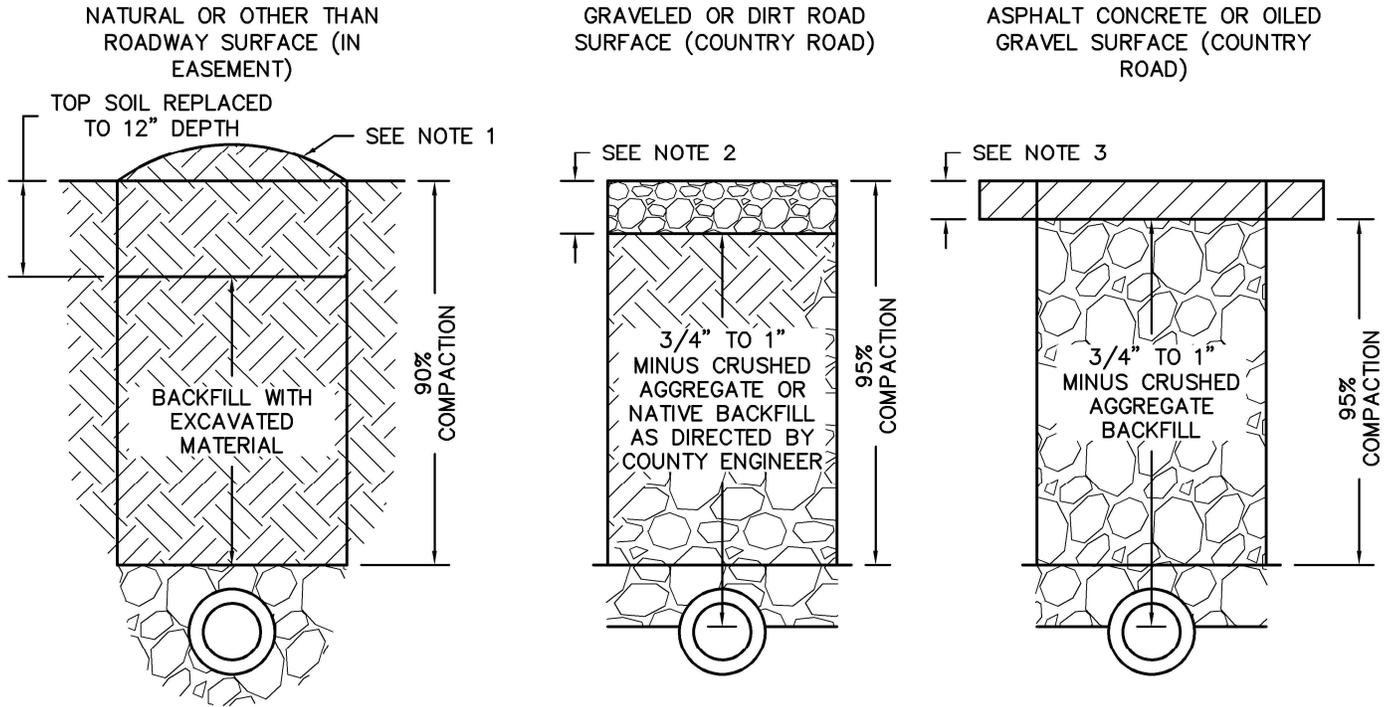

CLASS B  
LOAD FACTOR = 1.9

INSIDE DIAMETER	MINIMUM DEPTH OF BEDDING MATERIAL BELOW PIPE
27" OR LESS	4"
30"-60"	5"
66" OR MORE	6"

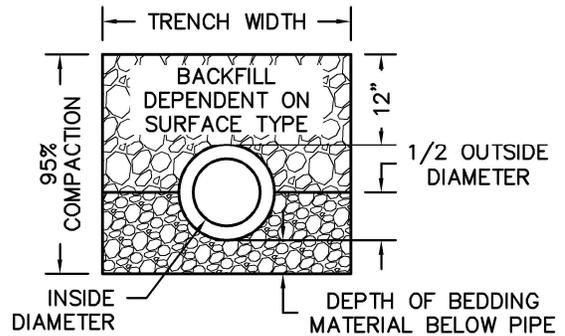

**NOTES:**

- UNLESS OTHERWISE DIRECTED BY THE COUNTY ENGINEER, MOUND TOP OF TRENCH.
- UNLESS OTHERWISE SPECIFIED, RESURFACING SHALL CONSIST OF 8" OF 3/4" TO 1" MINUS CRUSHED AGGREGATE.
- UNLESS OTHERWISE SPECIFIED, PAVEMENT THICKNESS SHALL CONFORM WITH MARION COUNTY ENGINEERING STANDARDS.
- FOR ROCK OR OTHER INCOMPRESSIBLE MATERIALS, THE TRENCH SHALL BE OVEREXCAVATED A MINIMUM OF 6" AND REFILLED WITH AGGREGATE MATERIAL AS DIRECTED BY THE COUNTY ENGINEER.
- BEDDING AND BACKFILL MATERIALS IN THE PIPE ZONE SHALL BE COMPACTED AS SPECIFIED PRIOR TO BACKFILLING THE REMAINDER OF THE TRENCH.
- ENGINEER MAY REQUIRE NON-COMPRESSIBLE BACKFILL IN PLACE OF AGGREGATE. SEE MARION COUNTY DEPARTMENT OF PUBLIC WORKS ENGINEERING STANDARD DETAIL 'NON-COMPRESSIBLE BACKFILL (CDF - CONTROLLED DENSITY FILL)' FOR SPECIFICS.

Standard Drawing 25

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**PIPE BEDDING AND  
TRENCH BACKFILL**


REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 07/05/1994	REVISION DATE: 01/25/2023	SCALE: N.T.S	SHEET: 1 of 1
------------------------------	------------------------------	-----------------	------------------



FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\RAINFALL INTENSITY DURATION CURVES.DWG PLOTTED: 2023/02/21 4:49 PM

# Plate 1: Rainfall I-D-R Curve Zone Map

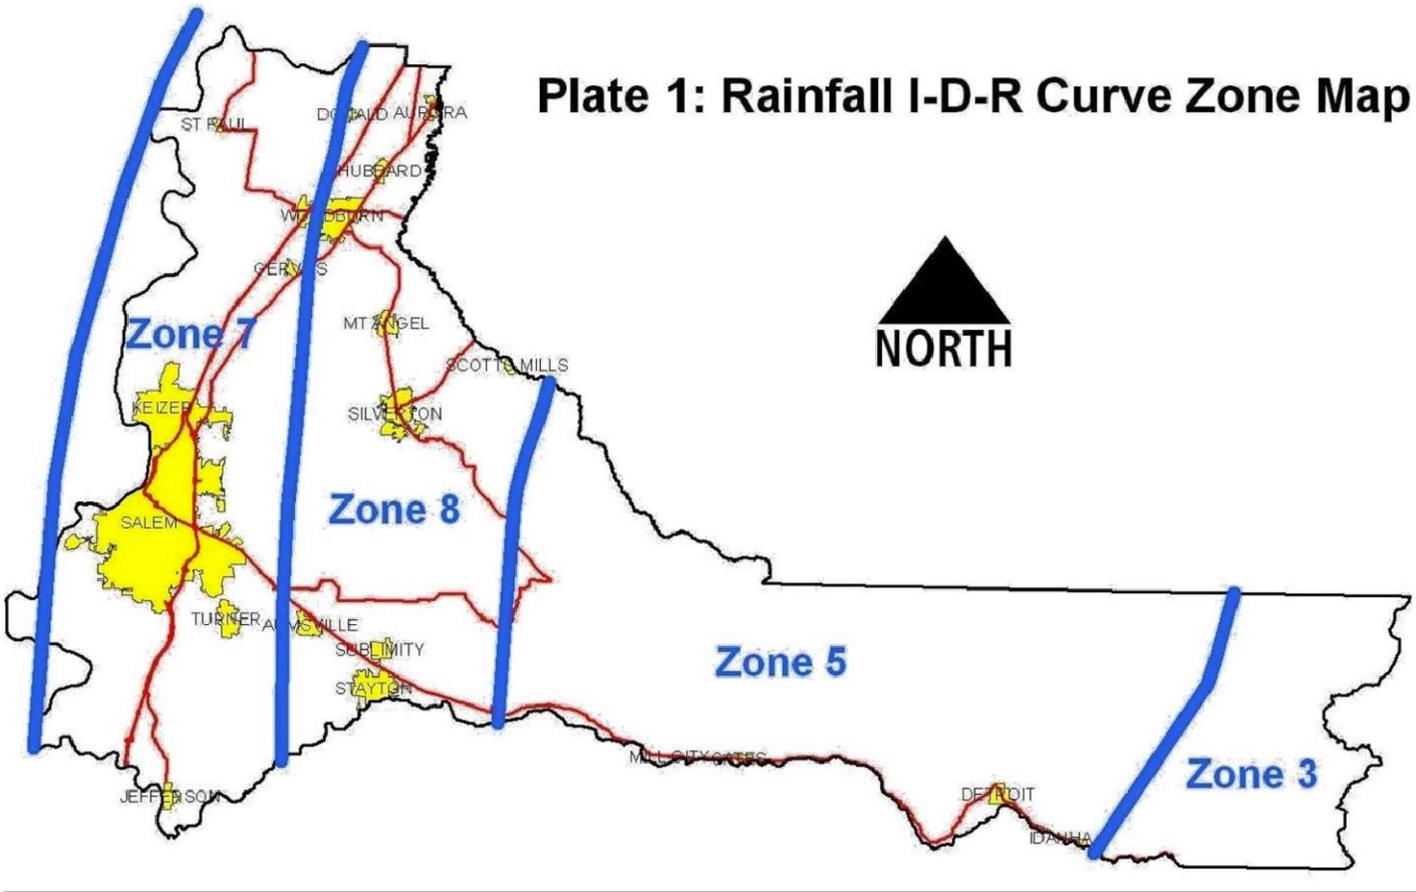

**NOTES:**

1. PEAK INTENSITY SHALL BE DERIVED FROM ODOT'S RAINFALL INTENSITY-DURATION-RECURRENCE (IDR) CURVES FOR A GIVEN ZONE.

Standard Drawing 27A

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




## RAINFALL INTENSITY-DURATION CURVES: ZONE MAP


REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 01/18/1983	REVISION DATE: 02/21/2023	SCALE: N.T.S	SHEET: 1 OF 3
------------------------------	------------------------------	-----------------	------------------

RAINFALL INTENSITY - DURATION - RECURRENCE INTERVAL CURVES

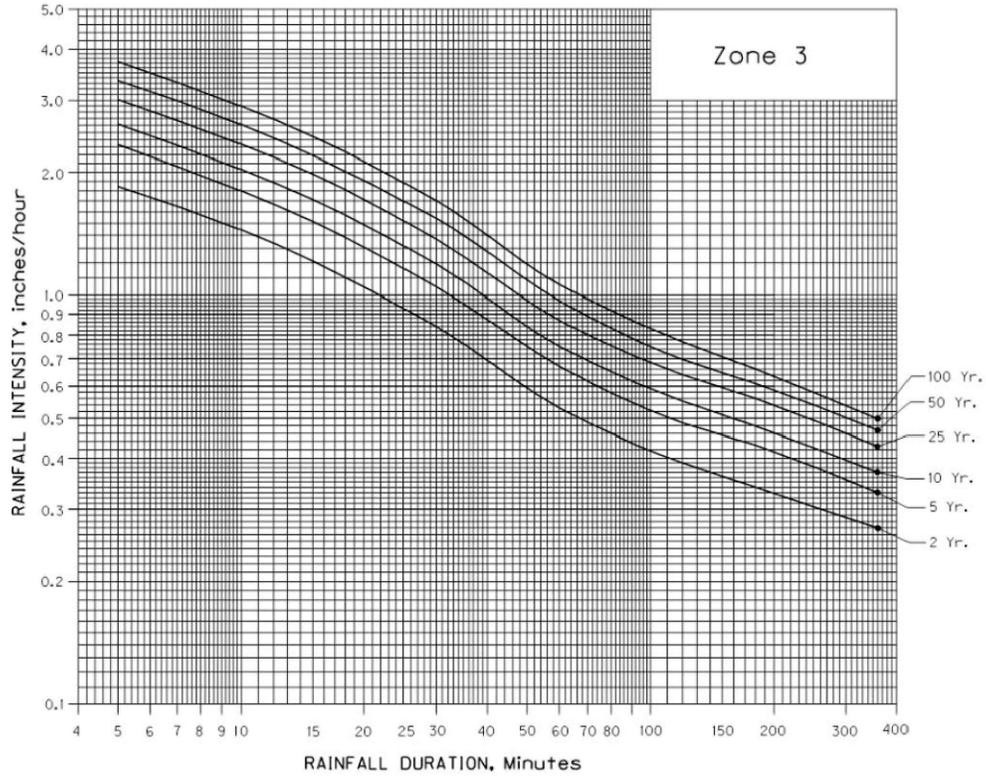

RAINFALL INTENSITY - DURATION - RECURRENCE INTERVAL CURVES

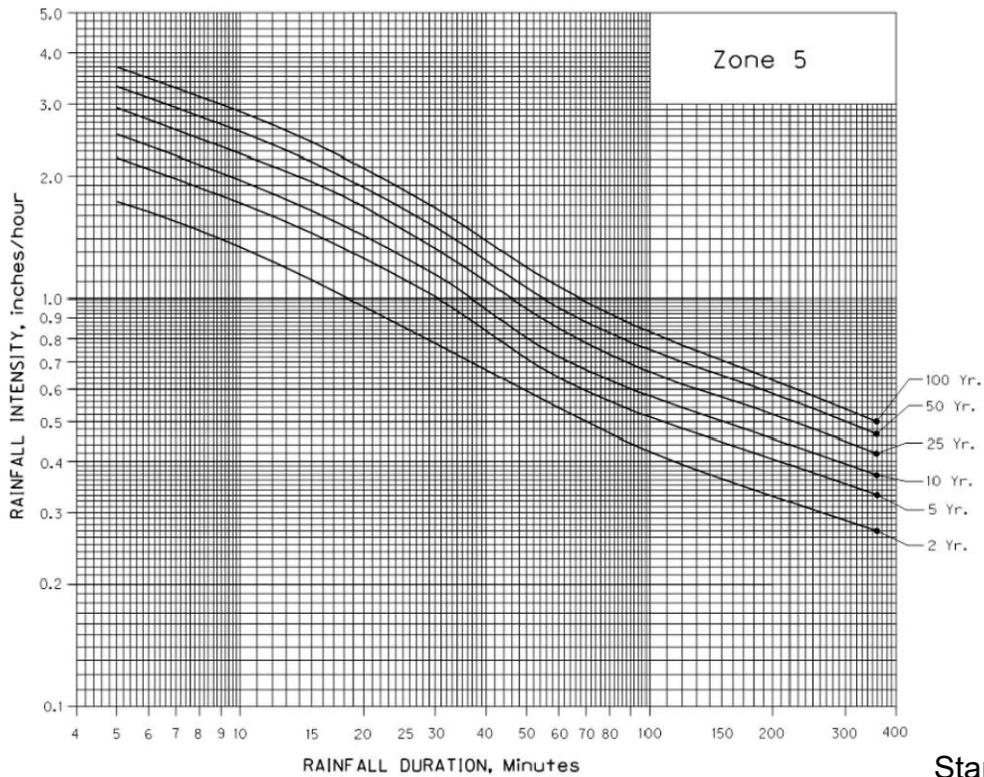

Standard Drawing 27B

SOURCE:

1. OREGON DEPARTMENT OF TRANSPORTATION HIGHWAY DIVISION HYDRAULICS DESIGN MANUAL, 2014.

MARION COUNTY DEPARTMENT OF PUBLIC WORKS





RAINFALL INTENSITY-DURATION CURVES: ZONES 3 AND 5

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 01/18/1983	REVISION DATE: 02/21/2023	SCALE: N.T.S	SHEET: 2 OF 3
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDEN&PERMIT\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\RAINFALL INTENSITY DURATION CURVES.DWG PLOTTED: 2023/02/21 4:49 PM

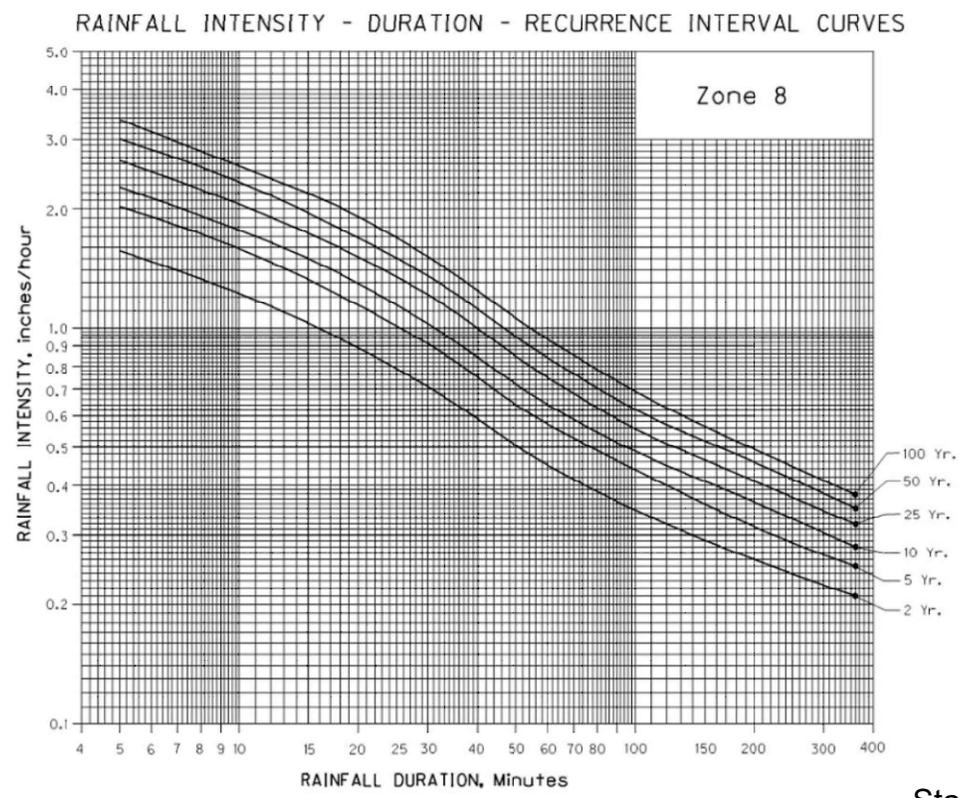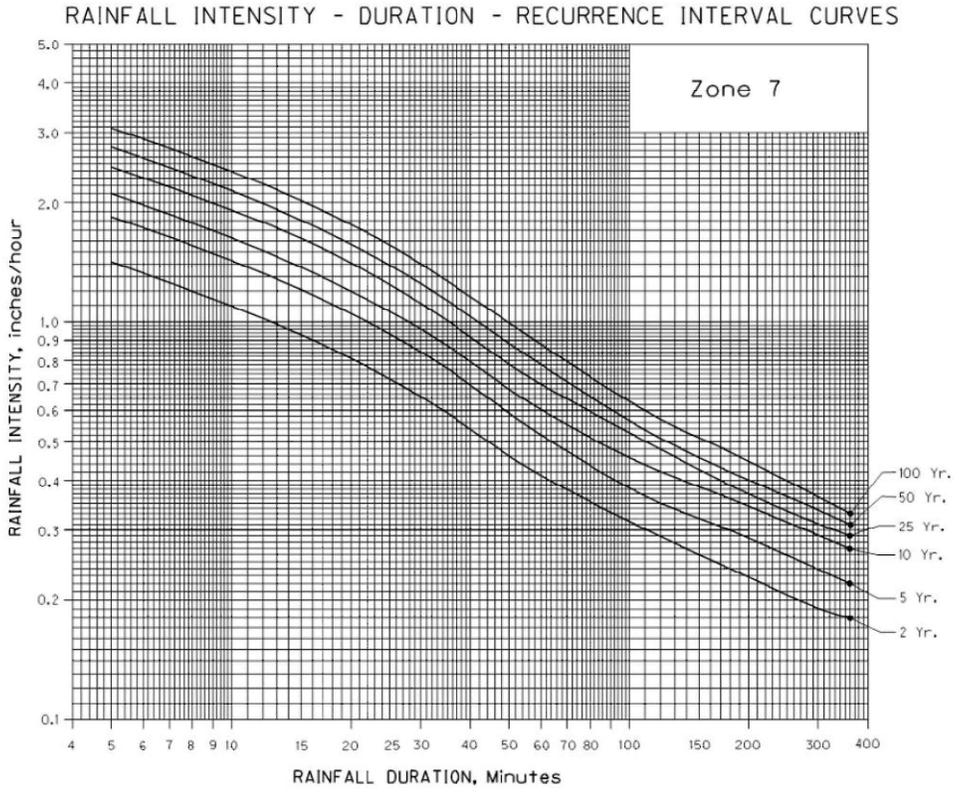

Standard Drawing 27C

SOURCE:  
1. OREGON DEPARTMENT OF TRANSPORTATION HIGHWAY DIVISION  
HYDRAULICS DESIGN MANUAL, 2014.

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**RAINFALL INTENSITY-DURATION CURVES: ZONES 7 AND 8**

CREATION DATE: 01/18/1983	REVISION DATE: 02/21/2023	SCALE: N.T.S	SHEET: 3 OF 3
------------------------------	------------------------------	-----------------	------------------

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

# SOIL CONSERVATION SERVICE TR-55 LAG-T<sub>c</sub> METHOD PEAK DISCHARGE COMPUTATION SHEET

PROJECT \_\_\_\_\_ WATERSHED CONDITION \_\_\_\_\_  
 BY \_\_\_\_\_ DATE \_\_\_\_\_  
 CHECKED BY \_\_\_\_\_ DATE \_\_\_\_\_

## INPUT

1.  (IN) (24 HOUR) (\_\_\_\_-YR FREQ.) FIGURE 10

RAINFALL  
(MAP EXHIBIT 2-3A)

2.

RUNOFF CURVE NO.  
(EXHIBIT 2-2A)

3.  FT FIGURE 3-3

HYDRAULIC LENGTH

4.  % FIGURE 3-4

WATERSHED SLOPE

5.  %

HYDR. LENGTH MODIFIED

6.  %

IMPERVIOUS AREA

7.  SQ MI

DRAINAGE AREA (DA)

8.  %

PONDS, SWAMPS

TABLE E-2, E-3, OR E-4  
(LOCATION DETERMINES TABLE)

**T<sub>c</sub>**  
**FACTOR**

**1.67**

CONSTANT  
X

9.  HR

BASIC LOG  
X

10.

HYDR. LENGTH ADJ.  
X

11.

IMP. AREA ADJ.  
=

12.  HR

**T<sub>c</sub>**

**PEAK**  
**FACTOR**

13.  IN

RUNOFF VOLUME  
X

14.  CSM/IN

BASIC PEAK DISCHARGE  
X

15.  SQ. MI.

DRAINAGE AREA  
X

16.

PONDS, SWAMPS ADJ.  
=

17.  CFS

**ADJUSTED PEAK DISCHARGE**

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\PEAK DISCHARGE COMPUTATION SHEET.DWG PLOTTED: 2022/11/30 8:45 AM

Standard Drawing 28

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



## PEAK DISCHARGE COMPUTATION SHEET

CREATION DATE: 07/08/1994	REVISION DATE: 11/29/2022	SCALE: N.T.S	SHEET: 1 of 1
------------------------------	------------------------------	-----------------	------------------




FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\STORM WATER DETENTION 5 ACRES OR LESS.DWG PLOTTED: 2023/02/21 5:02 PM

AREAS OF DEVELOPED SITE (ACRES) SEE NOTE 1	ALLOWABLE OUTFLOW (CUBIC FEET PER SECOND)	ORIFICE DIAMETER (INCHES) SEE NOTE 2	VOLUME OF WATER TO BE STORED (CUBIC FEET)	WEATER DEPTH OVER INLET GRATE (FEET) SEE NOTE 3	WATER STORAGE AREA (SQUARE FEET) SEE NOTE 3
0.5	0.10	1 11/16	780	0.5	4,690
1.0	0.20	2 3/8	1,560	0.5	9,380
1.5	0.30	2 7/8	2,350	0.5	14,070
2.0	0.40	3 5/16	3,130	0.5	18,760
2.5	0.50	3 11/16	3,910	0.5	23,450
3.0	0.60	4	4,690	0.5	28,150
3.5	0.70	4 3/8	5,470	0.5	32,830
4.0	0.80	4 11/16	6,250	0.5	37,520
4.5	0.90	4 15/16	7,040	0.5	42,220
5.0	1.00	5 3/16	7,820	0.5	46,910

**NOTES:**

1. FOR AREAS LESS THAN 0.5 ACRE, DETENTION IS NOT REQUIRED. FOR AREAS GREATER THAN 5.0 ACRES, THE DETENTION SYSTEM MUST BE DESIGNED ON A SITE-SPECIFIC BASIS WITH AN ALLOWABLE OUTFLOW BASED ON A 5-YEAR STORM WITH A RUNOFF FACTOR OF 0.20 AND STORAGE FOR A 10-YEAR STORM WITH A RUNOFF FACTOR OF 0.90.
2. ORIFICE DIAMETER (Do) IS BASED ON THE ALLOWABLE FLOW (Qo) AND AN ASSUMED TOTAL HEAD (Ho) ON THE ORIFICE OF 2.00 FEET (SEE TYPICAL DETAILS). IF THE TOTAL HEAD IS DIFFERENT, THE DIAMETER MUST BE DETERMINED FROM THE GRAPH ON SHEET 2.
3. IF SITE CONDITIONS NECESSITATE THE USE OF A DIFFERENT WATER STORAGE AREA, THE WATER DEPTH MUST BE CALCULATED AND AN ORIFICE DIAMETER DETERMINED PER NOTE 2 ABOVE. IN MOST CASES, THE FOLLOWING FORMULA CAN BE USED FOR CALCULATING THE DEPTH:
  - 3.1. WATER DEPTH = 3 X VOLUME OF STORED WATER ÷ WATER STORAGE AREA
4. CATCH BASIN MAY BE ROUND, SQUARE, OR RECTANGULAR.

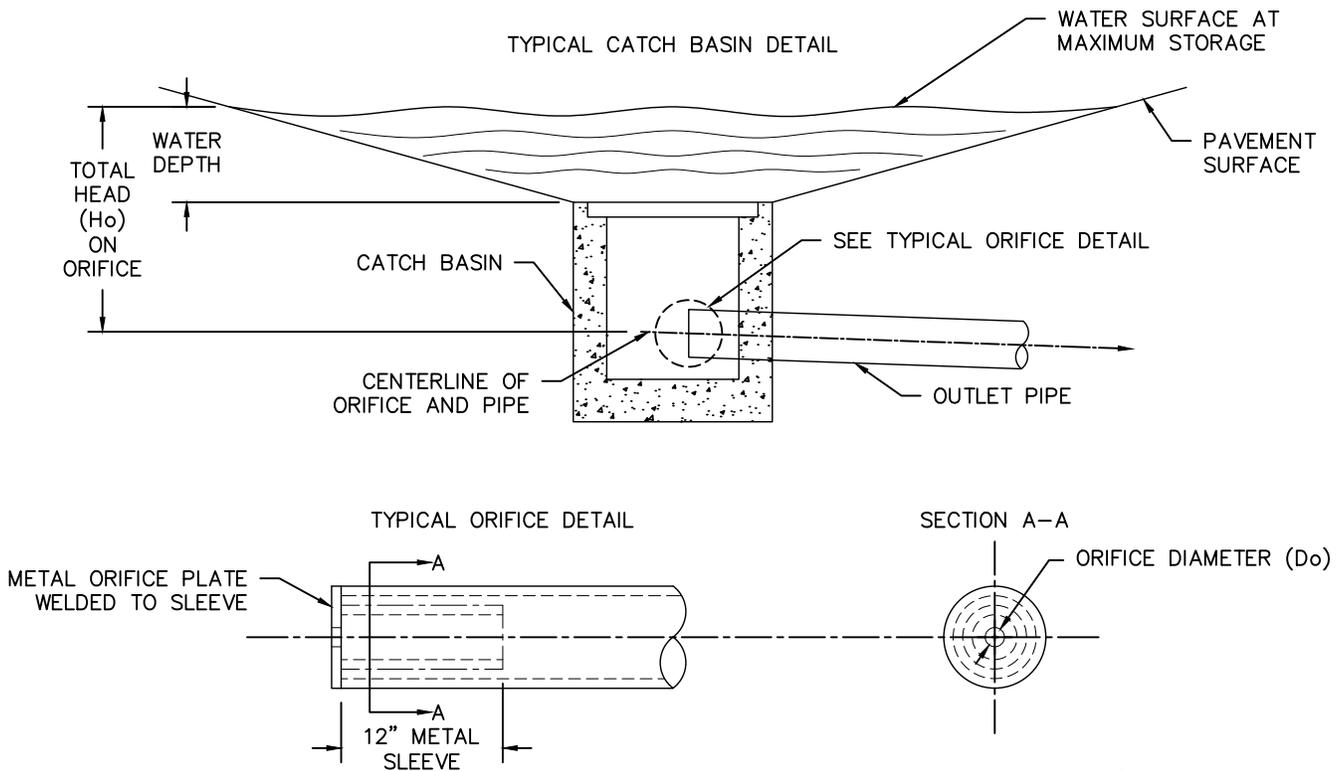

Standard Drawing 30A

MARION COUNTY DEPARTMENT OF PUBLIC WORKS




**STORM WATER DETENTION  
FOR SITES OF  
5 ACRES OR LESS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 10/10/1985	REVISION DATE: 02/21/2023	SCALE: N.T.S	SHEET: 1 OF 2
------------------------------	------------------------------	-----------------	------------------

**TOTAL HEAD ON ORIFICE ( $H_o$ ) -**  
feet

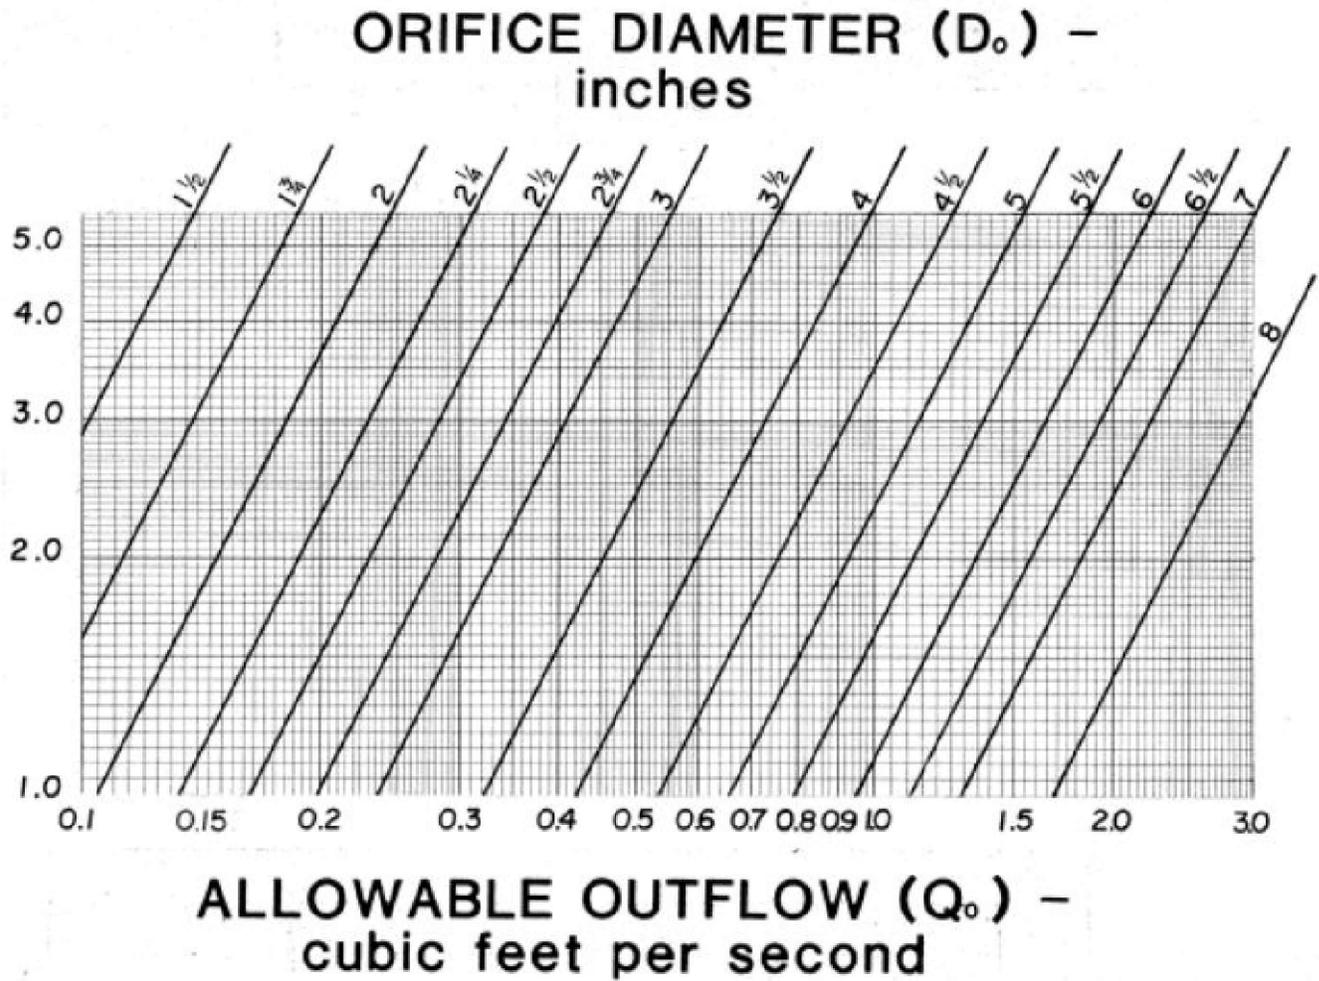

Standard Drawing 30B

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



**STORM WATER DETENTION  
FOR SITES OF  
5 ACRES OR LESS**

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	


CREATION DATE: 10/10/1985	REVISION DATE: 02/17/2023	SCALE: N.T.S	SHEET: 2 OF 2
------------------------------	------------------------------	-----------------	------------------

STANDARD HATCHES


HATCH EXAMPLE      NAME OF PATTERN – REPRESENTED USE




SOLID (TRANSPARENCY 25% TO 50%) – VARIOUS USES




AR SAND – VARIOUS USES




ANSI31 – PAVEMENT




ANSI37 – VARIOUS USES




AR-CONC – CONCRETE



GRASS – ABOVE SURFACE EARTH



EARTH – BELOW SURFACE EARTH



GRAVEL – VARIOUS TYPES OF AGGREGATE

STANDARD ABBREVIATIONS

- MIN. = MINIMUM
- MAX. = MAXIMUM
- P.C.C. = PORTLAND CEMENT CONCRETE
- P.S.I. = POUNDS PER SQUARE INCH
- TYP. = TYPICAL
- CL = CENTERLINE
- DIA. = DIAMETER
- FT = FEET
- ' = FEET
- " = INCHES
- PMAC = POLYMER MODIFIED ASPHALT CEMENT
- HMAC = HOT MIX ASPHALTIC CEMENT
- PUE = PUBLIC UTILITY EASEMENT
- O.C. = ON CENTER
- ODOT = OREGON DEPARTMENT OF TRANSPORTATION

Standard Drawing 31

MARION COUNTY DEPARTMENT OF PUBLIC WORKS



DRAFTING CONVENTIONS

REVISIONS		
DATE:	DESCRIPTION OF CHANGES:	BY:
	NONE	

CREATION DATE: 06/01/1994	REVISION DATE: 02/21/2023	SCALE: N.T.S	SHEET: 1 OF 1
------------------------------	------------------------------	-----------------	------------------

FILE: G:\ENGINEERING\LDENG&PERMITS\SHARED\ENGINEERING\DETAILS\ENGINEERING STANDARD DETAILS\DRAWING CONVENTIONS.DWG PLOTTED: 2023/02/21 4:31 PM